



Highlights

- This report covers **565** drinking water sources monitored in **7** governorates. The percentages in this report represents only the sources monitored.
- **86% (486/565)** of the drinking water sources monitored were functioning. **14% (79/565)** were not functioning.
- In the areas that their stations are suspended, agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The treated water sources were **43% (209/486)**, while the operating stations without treatment were **57% (277/486)**. The monitored drinking water sources in Dar'a were all treated, whereas none were treated in Quneitra and Hama.
- Of the functioning water stations, **71% (344/486)** delivered water using a piping network and **29% (142/486)** delivered water using tankering.
- Coordination with UNICEF and WASH cluster to survey water plants infrastructure (mechanical equipments, electrical equipments, civil buildings and chemical equipments).

Coverage

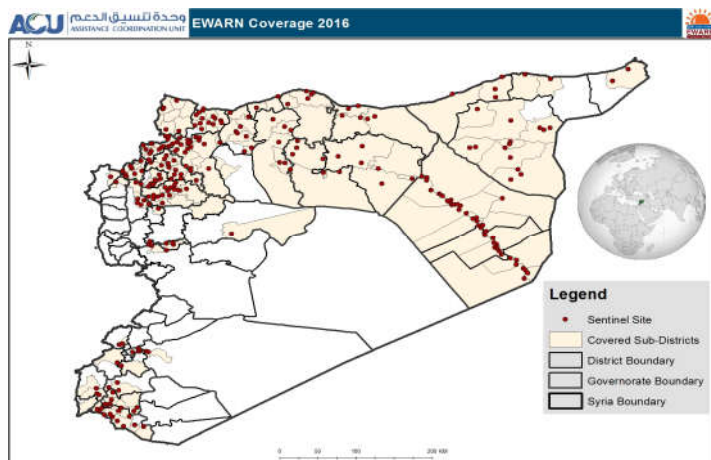

EWARN covers **126** sub-districts, **38** districts in **12** governorates

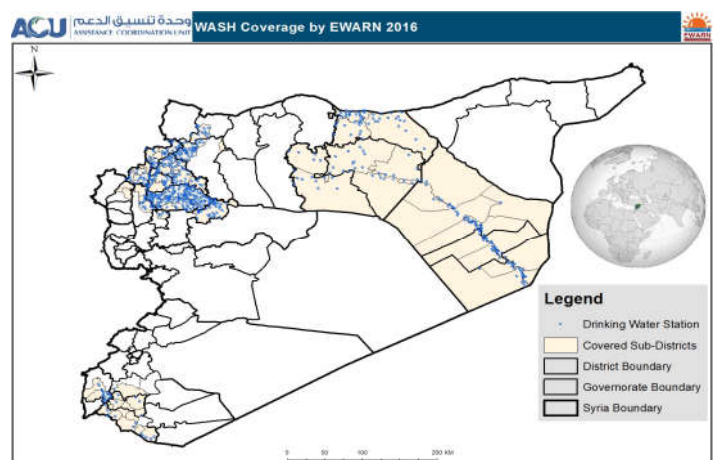

WASH covers **70** sub-districts, **19** districts in **7** governorates


Drinking Water Stations Status in Each Governorate

| Governorate | Drinking Water Stations Status | | |
|--------------|--------------------------------|-------------|-----------|
| | Total | Functioning | Suspended |
| Aleppo | 46 | 35 | 11 |
| Idleb | 274 | 243 | 31 |
| Hama | 20 | 13 | 7 |
| Ar-raqqa | 92 | 80 | 12 |
| Deir-ez-Zor | 103 | 92 | 11 |
| Dara | 16 | 14 | 2 |
| Quneitra | 14 | 9 | 5 |
| Total | 565 | 486 | 79 |


| Governorate | Functioning DWS Chlorination Status | | |
|--------------|-------------------------------------|-------------------|----------------------|
| | Total | With disinfection | Without disinfection |
| Aleppo | 35 | 3 | 32 |
| Idleb | 243 | 74 | 169 |
| Hama | 13 | 0 | 13 |
| Ar-raqqa | 80 | 33 | 47 |
| Deir-ez-Zor | 92 | 85 | 7 |
| Dara | 14 | 14 | 0 |
| Quneitra | 9 | 0 | 9 |
| Total | 486 | 209 | 277 |

Drinking Water Stations Status


Drinking Water Stations Status

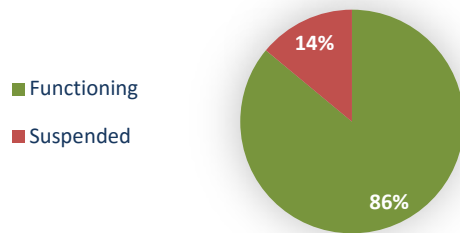


Functioning DWS Chlorination Status

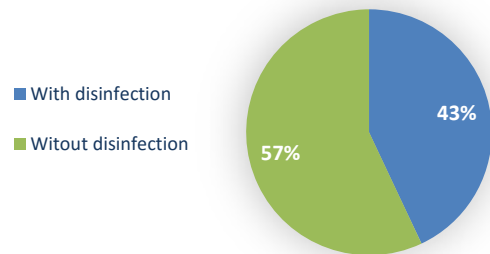

Drinking Water Stations Status in Governorates

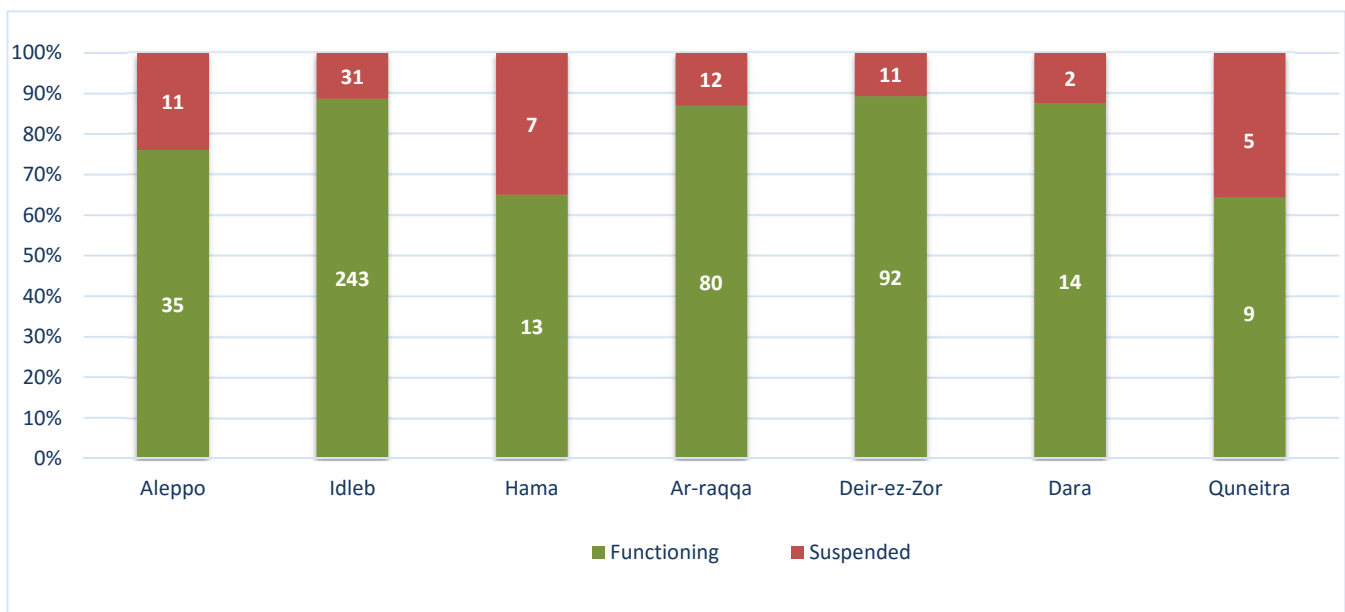


Functioning Drinking Water Stations Chlorination Status

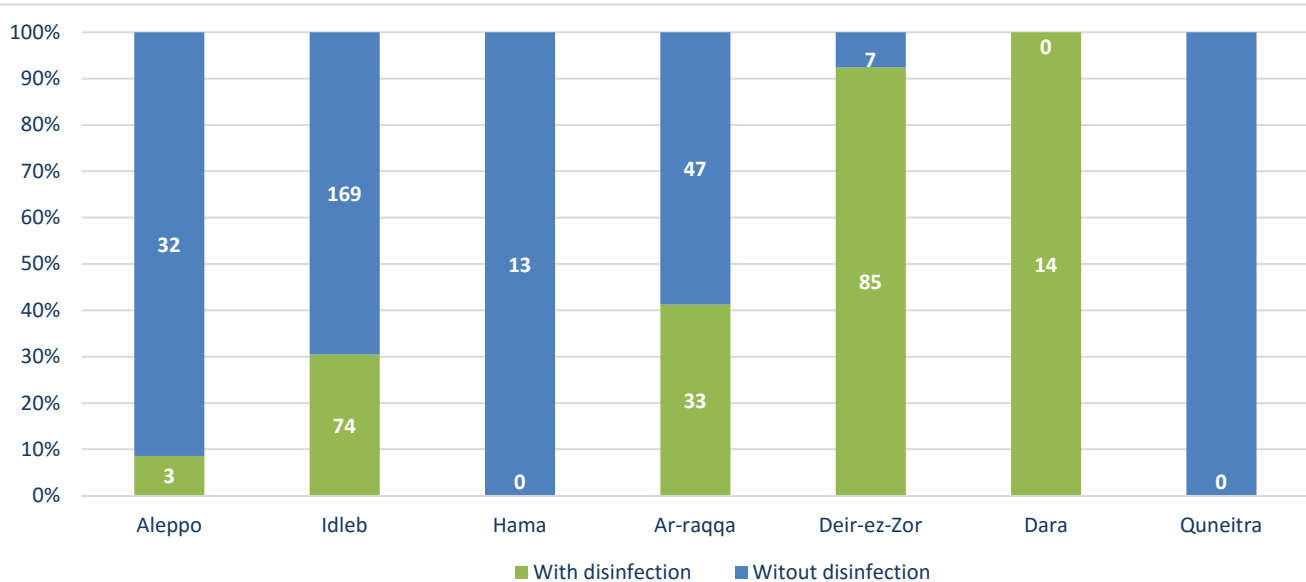


Method


| Governorate | Functioning DWS | Method | |
|--------------|-----------------|------------|------------|
| | | Network | Tankering |
| Aleppo | 35 | 34 | 1 |
| Idleb | 243 | 106 | 137 |
| Hama | 13 | 10 | 3 |
| Ar-raqqqa | 80 | 80 | 0 |
| Deir-ez-Zor | 92 | 91 | 1 |
| Dara | 14 | 14 | 0 |
| Quneitra | 9 | 9 | 0 |
| Total | 486 | 344 | 142 |

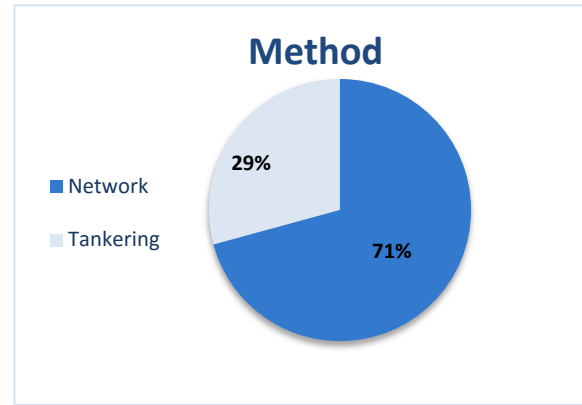


Drinking Water Stations Distribution in Aleppo

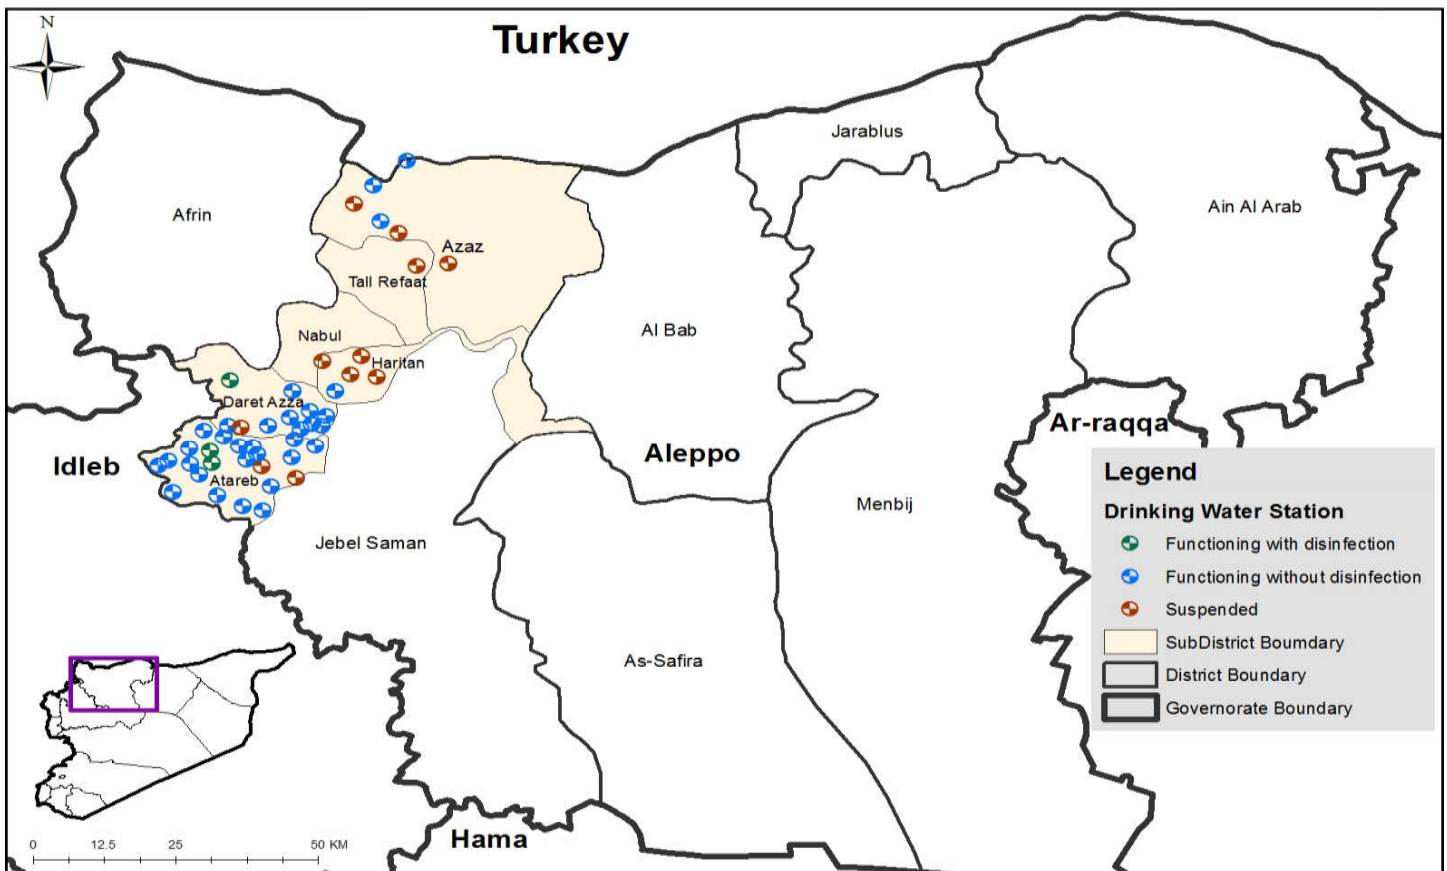


Drinking Water Stations Distribution in Idleb

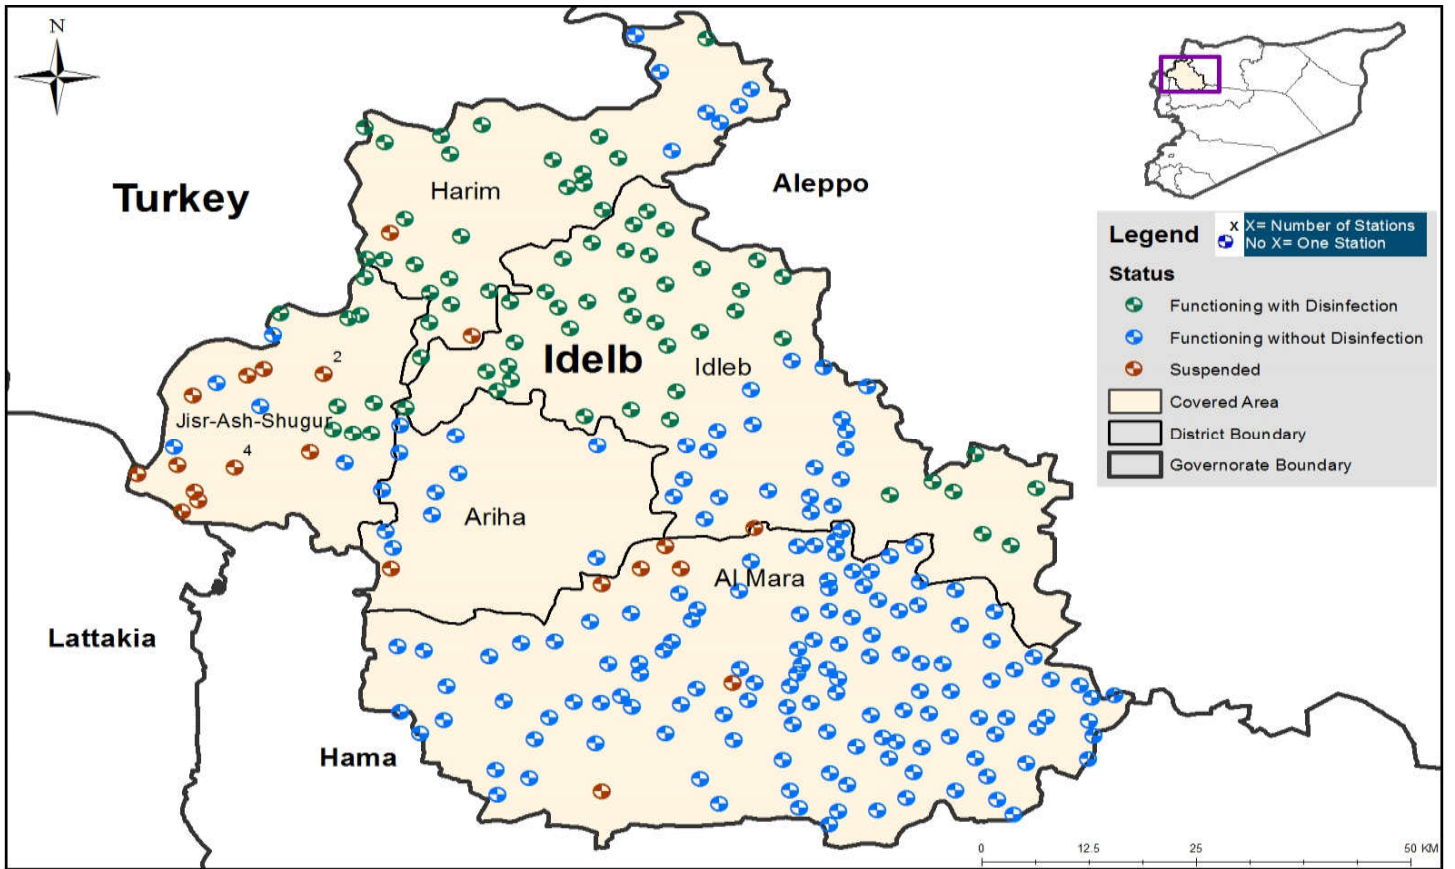


Drinking Water Stations Distribution in Hama

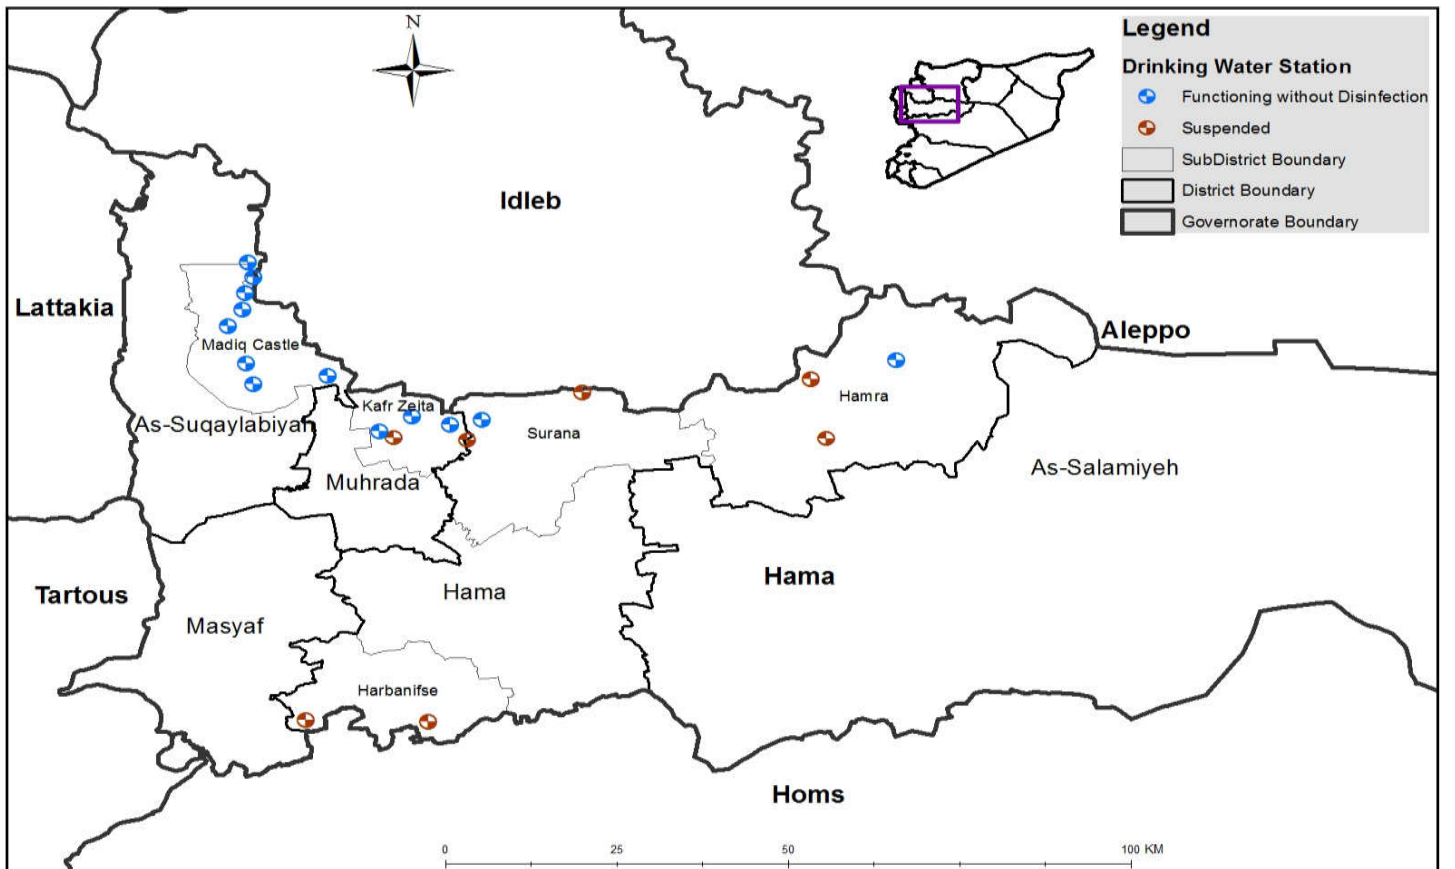


Drinking Water Stations Distribution in Ar-raqqa

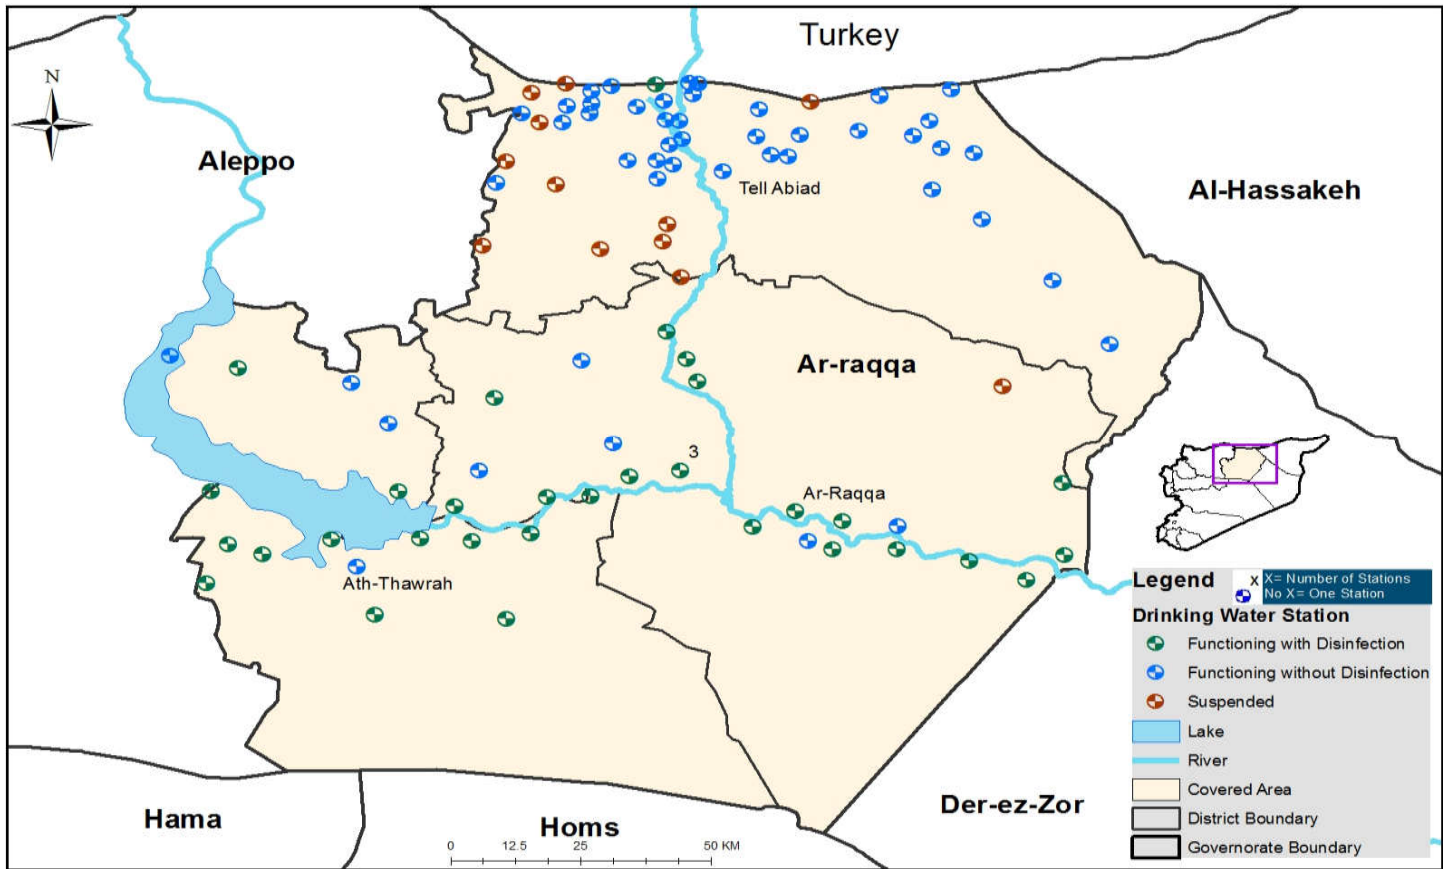


Drinking Water Stations Distribution in Deir-ez-Zor

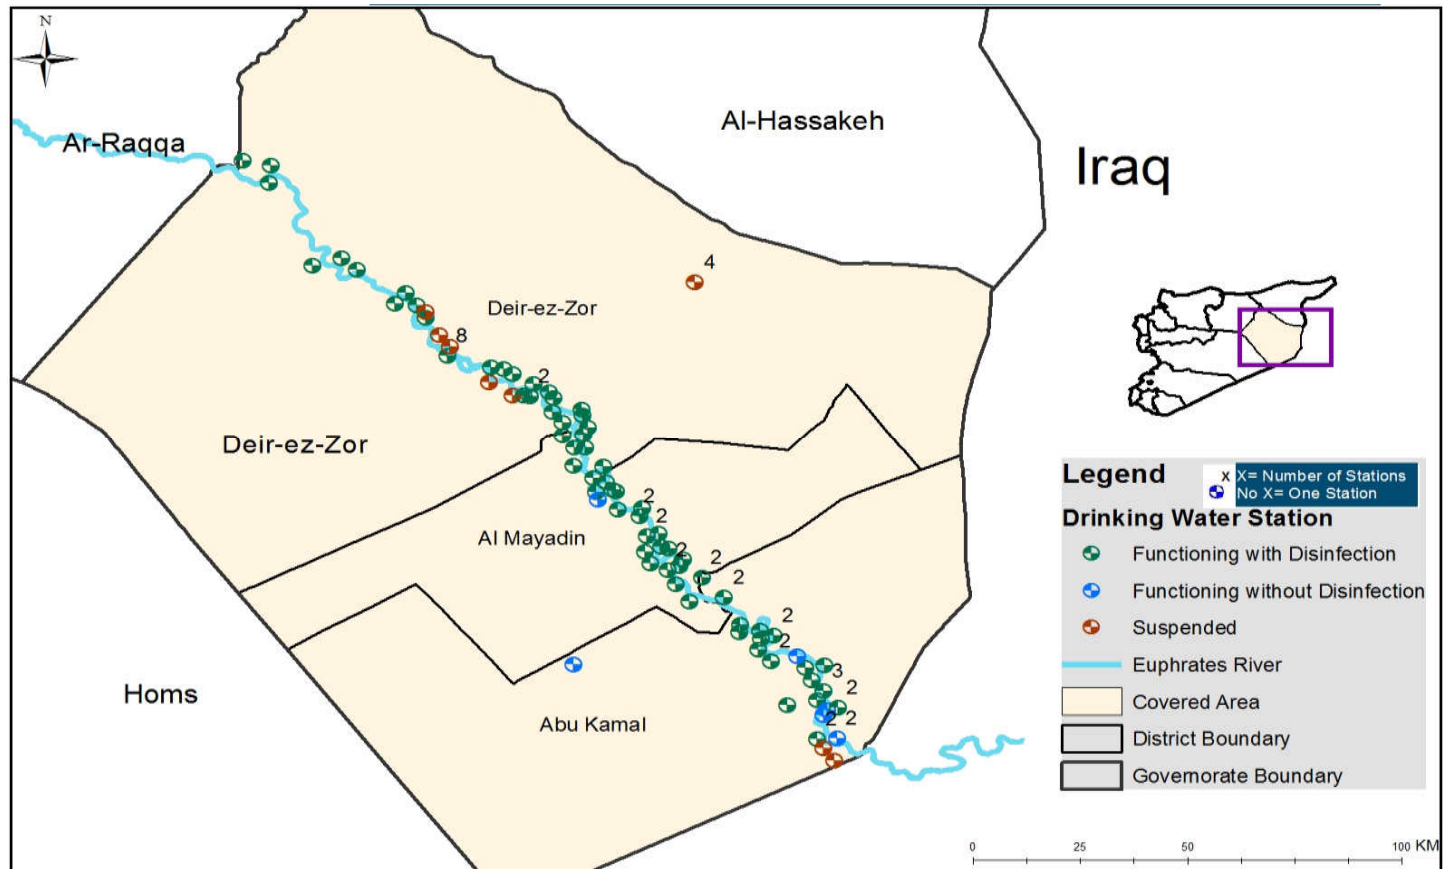

Drinking Water Stations Distribution in Dara

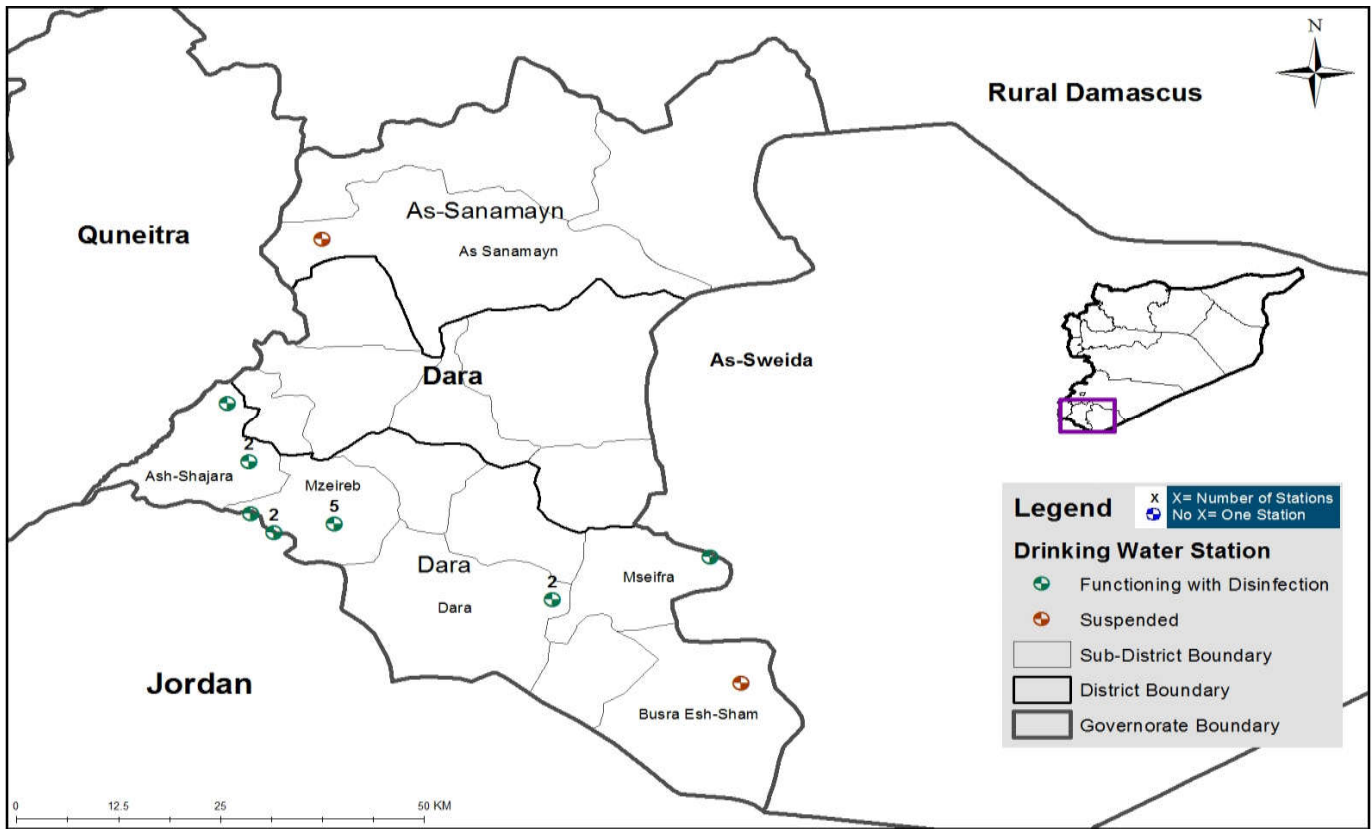

Drinking Water Stations Distribution in Quneitra

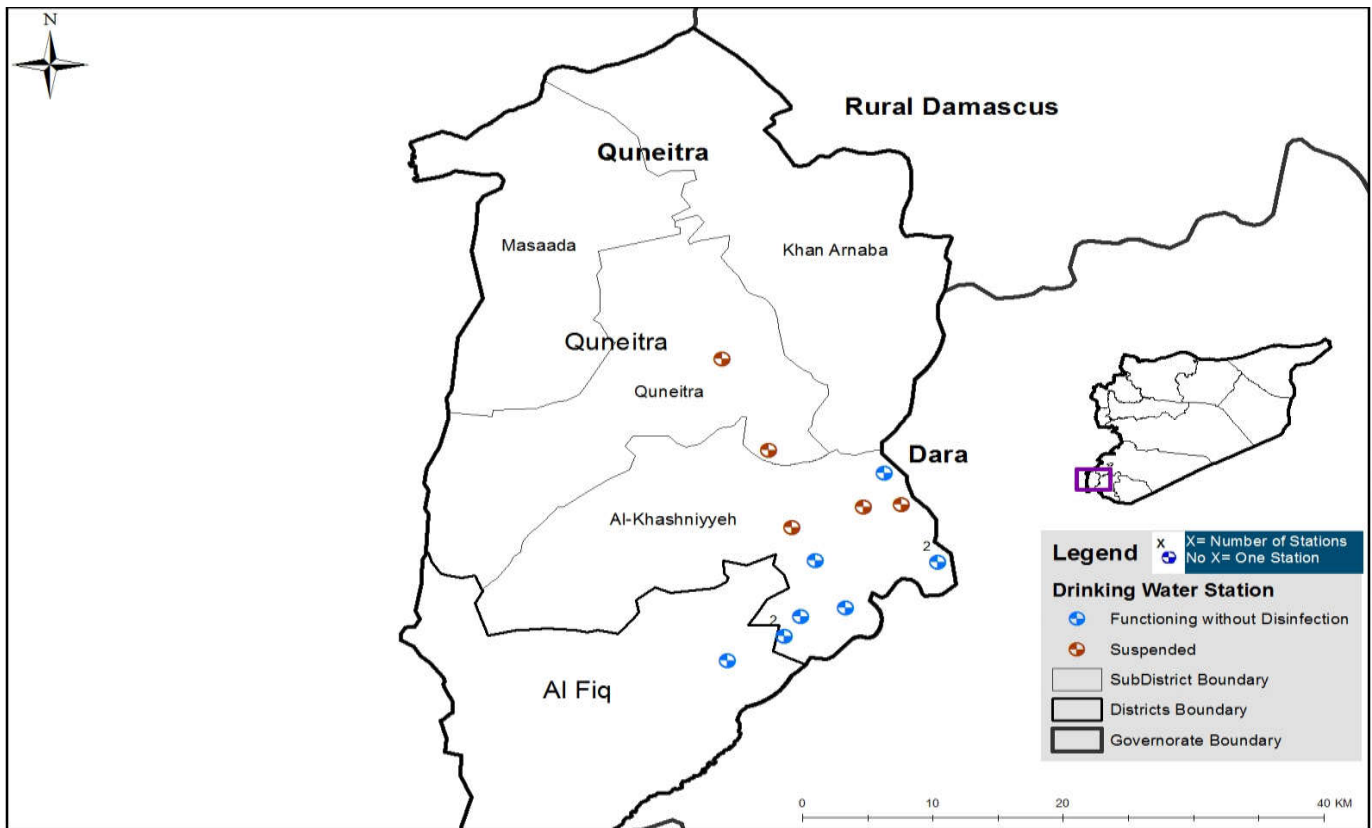

WASH = Water Sanitation and Hygiene

DWS = Drinking Water Station