


Date: 17 Apr 2016 - 30 Apr 2016

Week No. 17-18


Highlights

- This report covers **482** drinking water sources monitored in **7** governorates. The percentages in this report represents only the sources monitored.
- **76% (366/482)** of the drinking water sources monitored were functioning. **24% (116/482)** were not functioning.
- In the areas that their stations are suspended, agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The treated water sources were **44% (161/366)**, while the operating stations without treatment were **56% (205/366)**. The monitored drinking water sources in Dar'a were all treated, whereas none were treated in Quneitra and Hama.
- Of the functioning water stations, **94% (344/366)** delivered water using a piping network and **6% (22/366)** delivered water using tankering.
- Coordination with UNICEF and WASH cluster to survey water plants infrastructure (mechanical equipments, electrical equipments, civil buildings and chemical equipments) **482** had been done.

Coverage

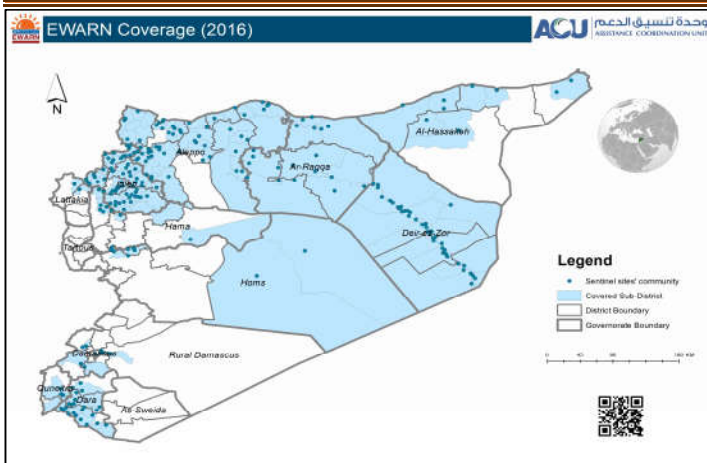

EWARN covers **130** sub-districts, **40** districts in **12** governorates

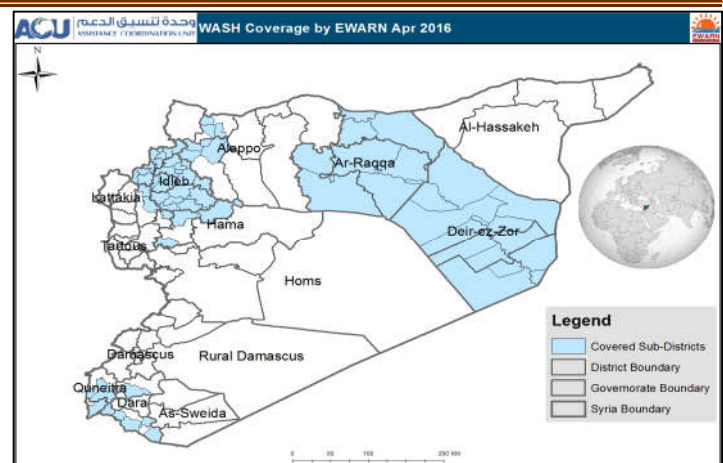

WASH covers **71** sub-districts, **20** districts in **7** governorates


Drinking Water Stations Status in Each Governorate

Governorate	Drinking Water Stations Status		
	Total	Functioning	Suspended
Aleppo	42	37	5
Aleppo City	12	8	4
Idleb	176	120	56
Hama	29	12	17
Ar-raqqa	92	80	12
Deir-ez-Zor	95	84	11
Dara	23	18	5
Quneitra	13	7	6
Total	482	366	116


Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Without disinfection
Aleppo	37	4	33
Aleppo City	8	6	2
Idleb	120	55	65
Hama	12	0	12
Ar-raqqa	80	9	71
Deir-ez-Zor	84	69	15
Dara	18	18	0
Quneitra	7	0	7
Total	366	161	205

Drinking Water Stations Status


Drinking Water Stations Status

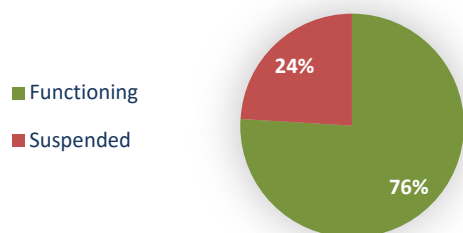


Functioning DWS Chlorination Status

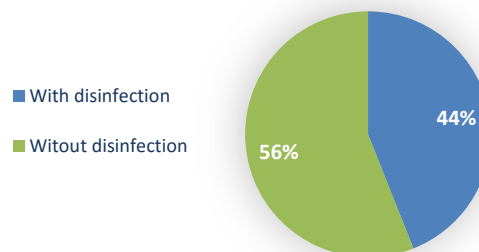

Drinking Water Stations Status in Governorates

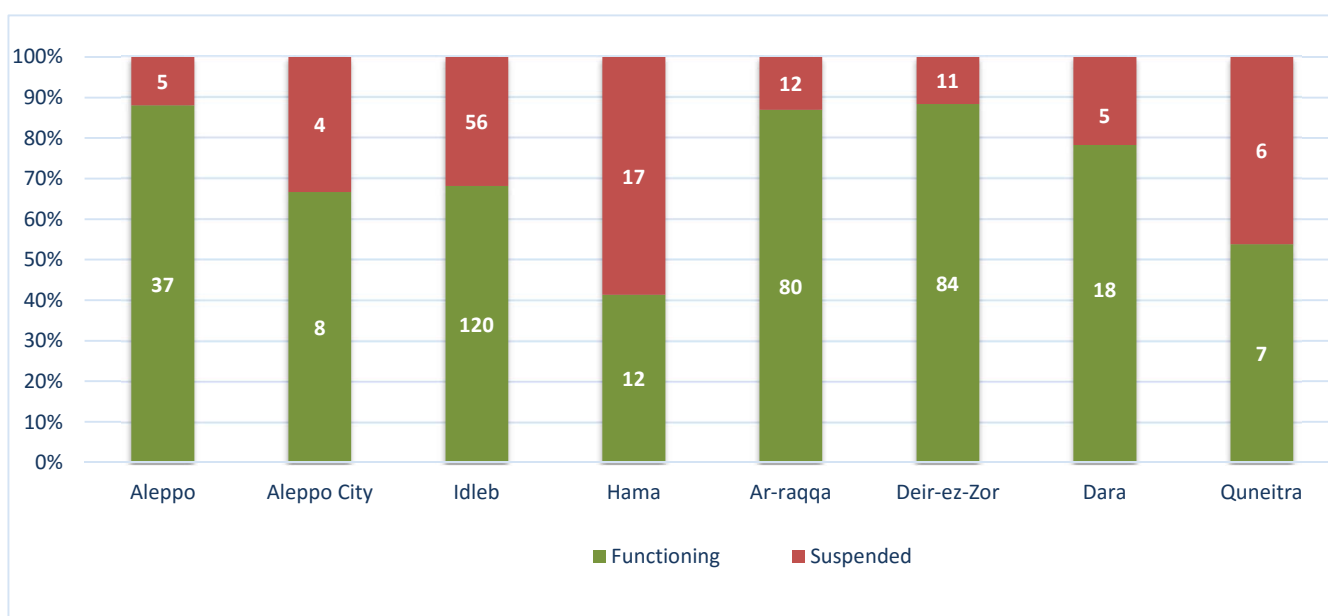


Functioning Drinking Water Stations Chlorination Status

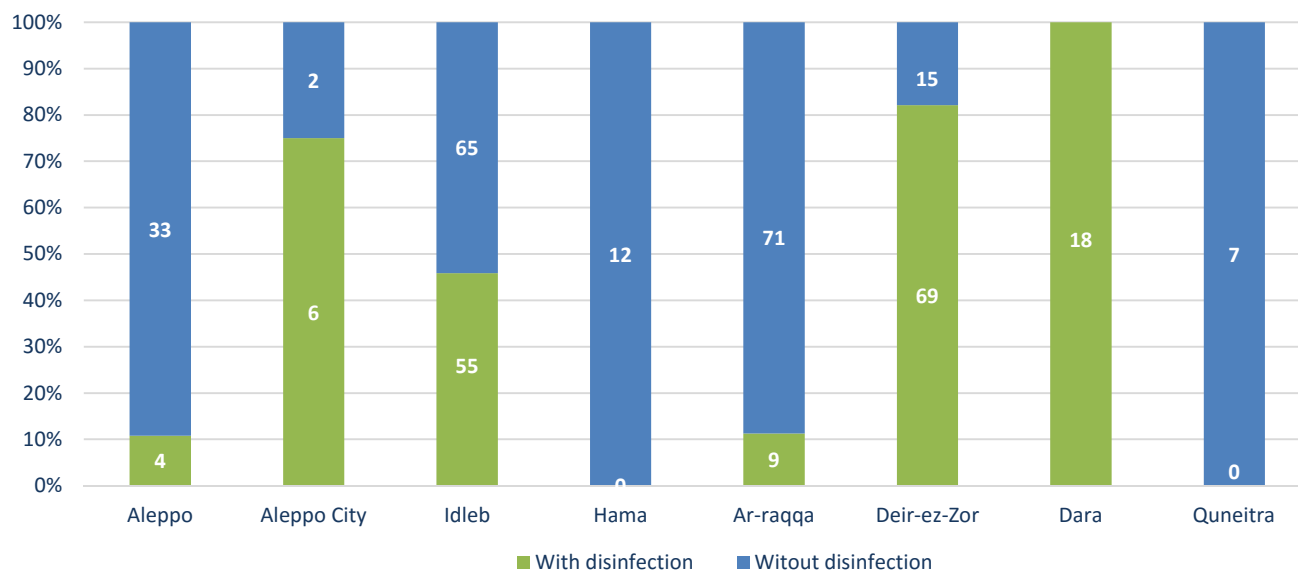


Method


Governorate	Functioning DWS	Method	
		Network	Tankering
Aleppo	37	29	8
Aleppo City	8	2	6
Idleb	120	115	5
Hama	12	10	2
Ar-raqqa	80	80	0
Deir-ez-Zor	84	83	1
Dara	18	18	0
Quneitra	7	7	0
Total	366	344	22

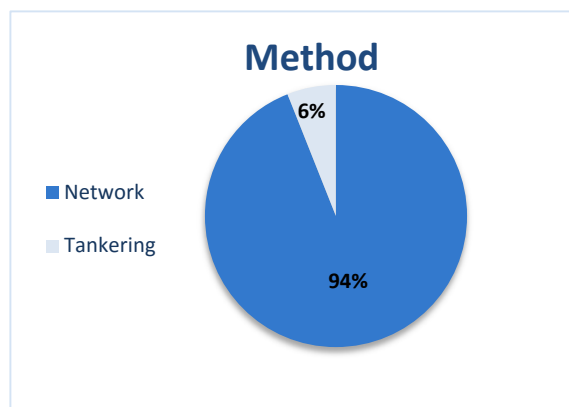


Drinking Water Stations Distribution in Aleppo

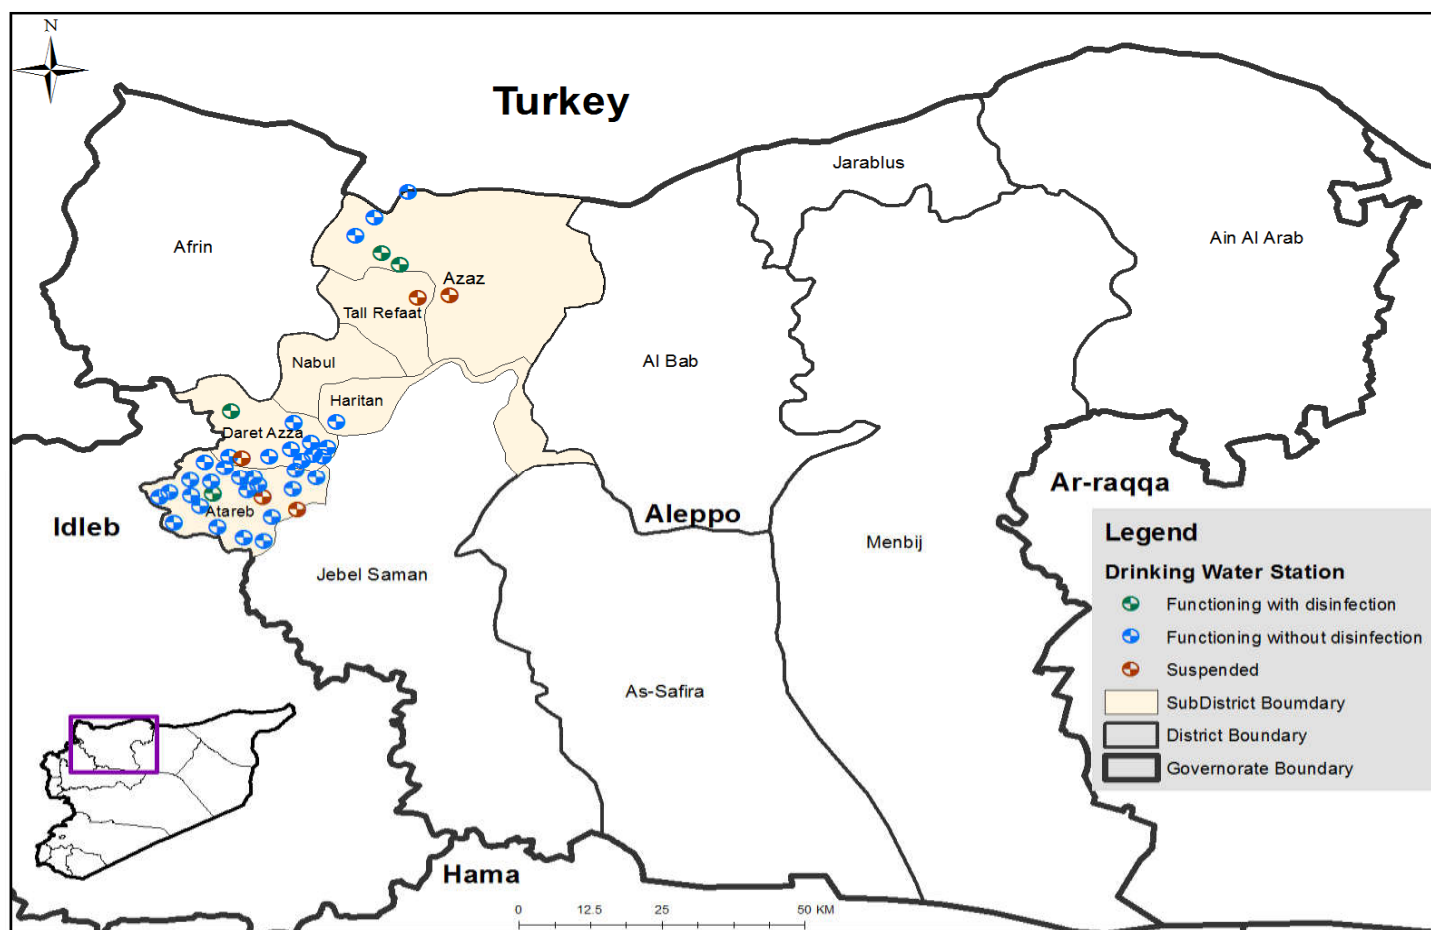


Drinking Water Stations Distribution in Aleppo City

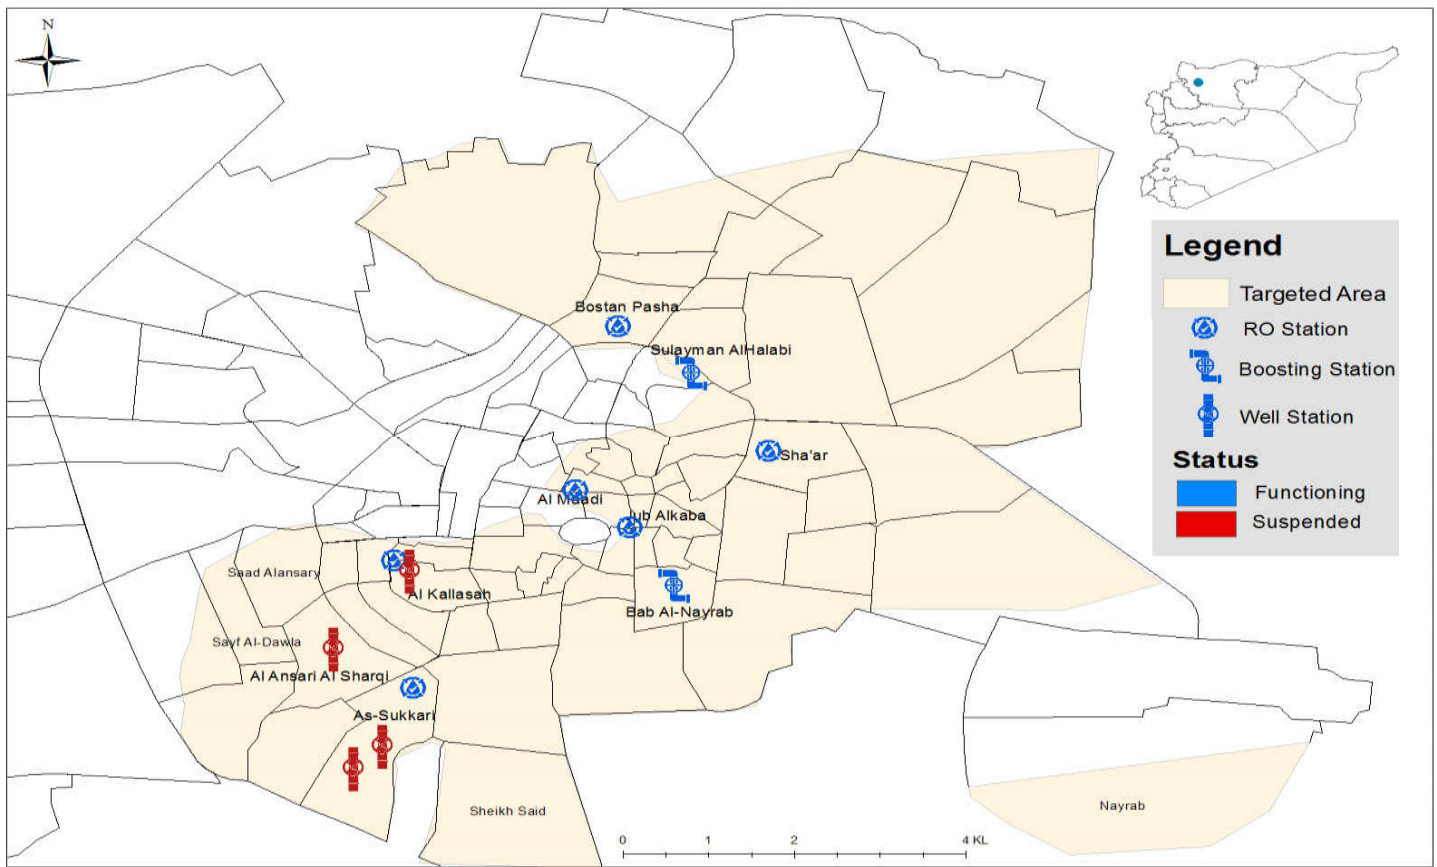


Drinking Water Stations Distribution in Idleb

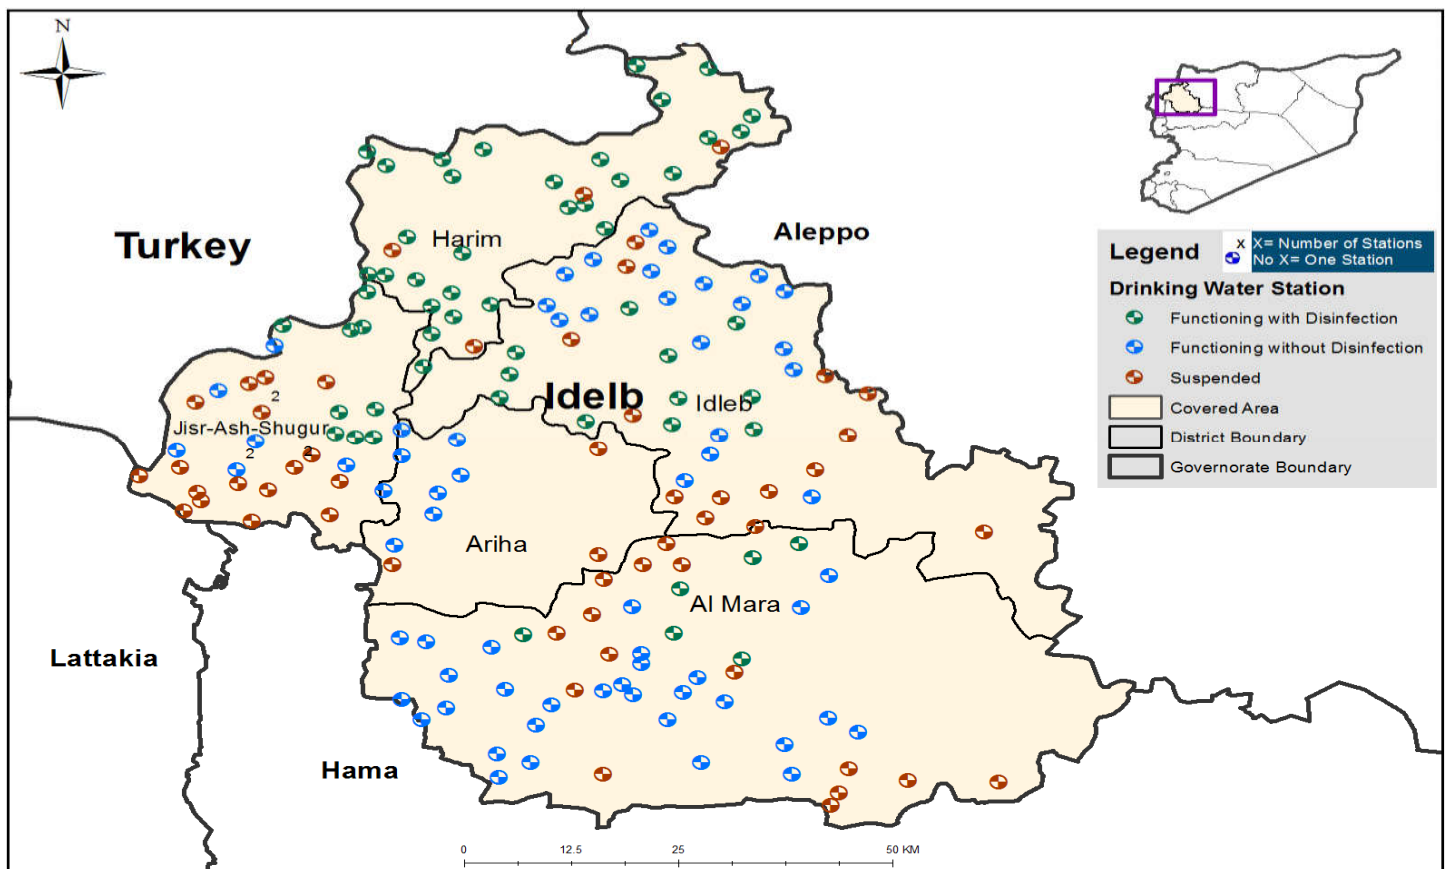


Drinking Water Stations Distribution in Hama

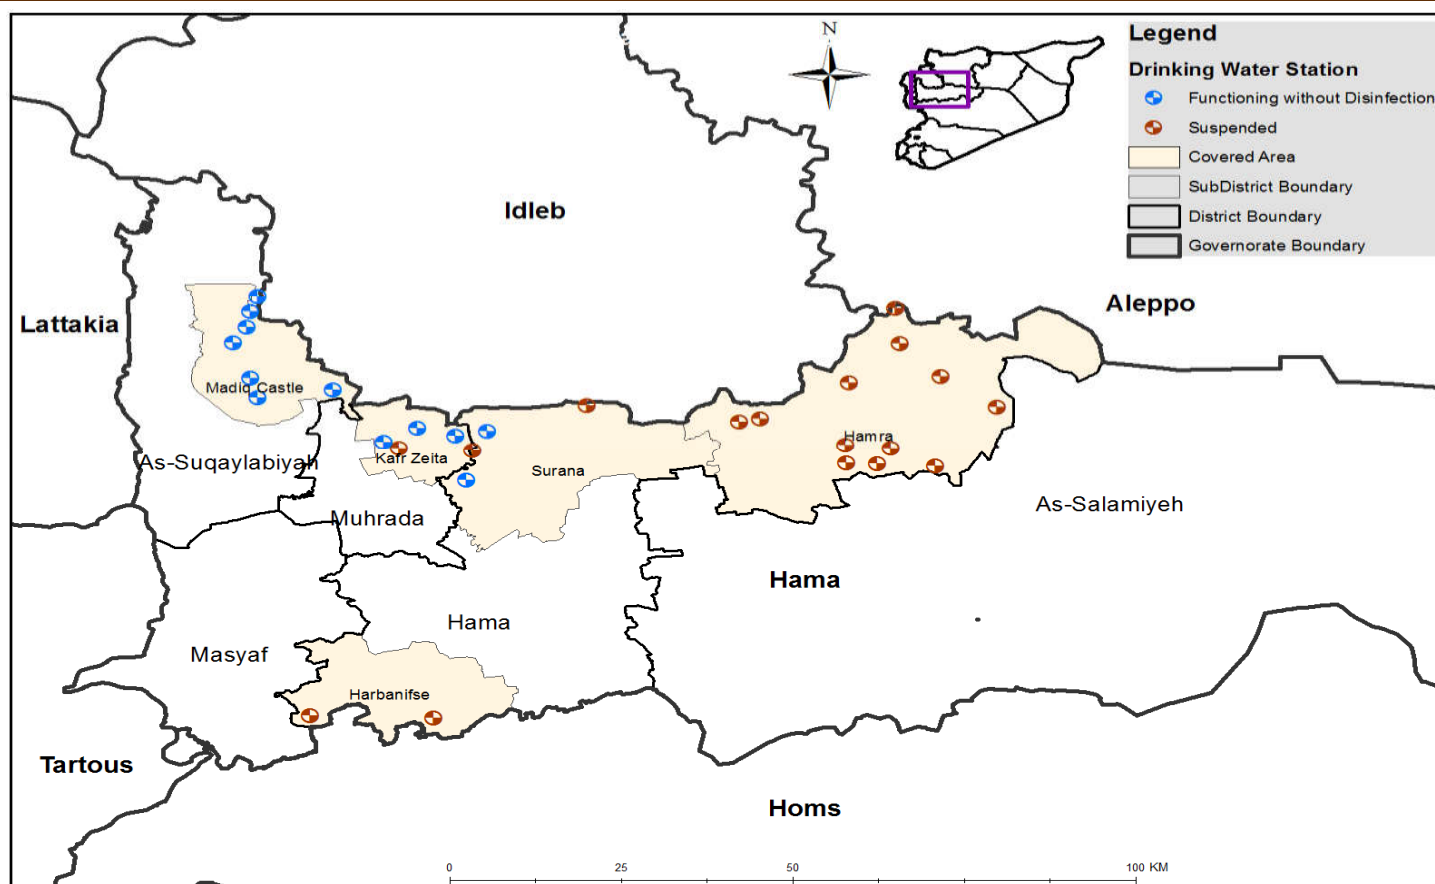


Drinking Water Stations Distribution in Ar-raqqa

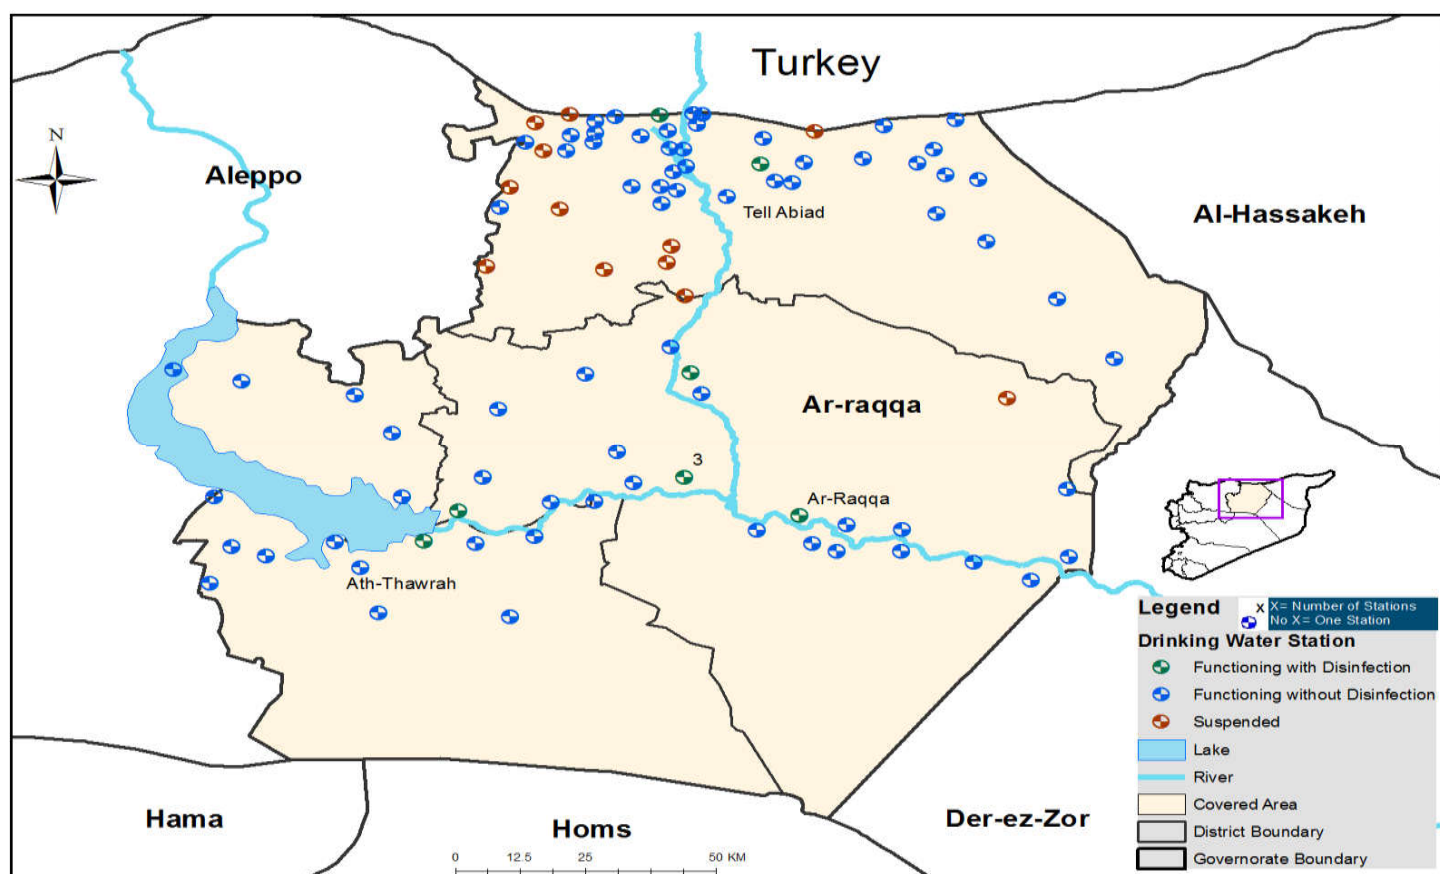


Drinking Water Stations Distribution in Deir-ez-Zor

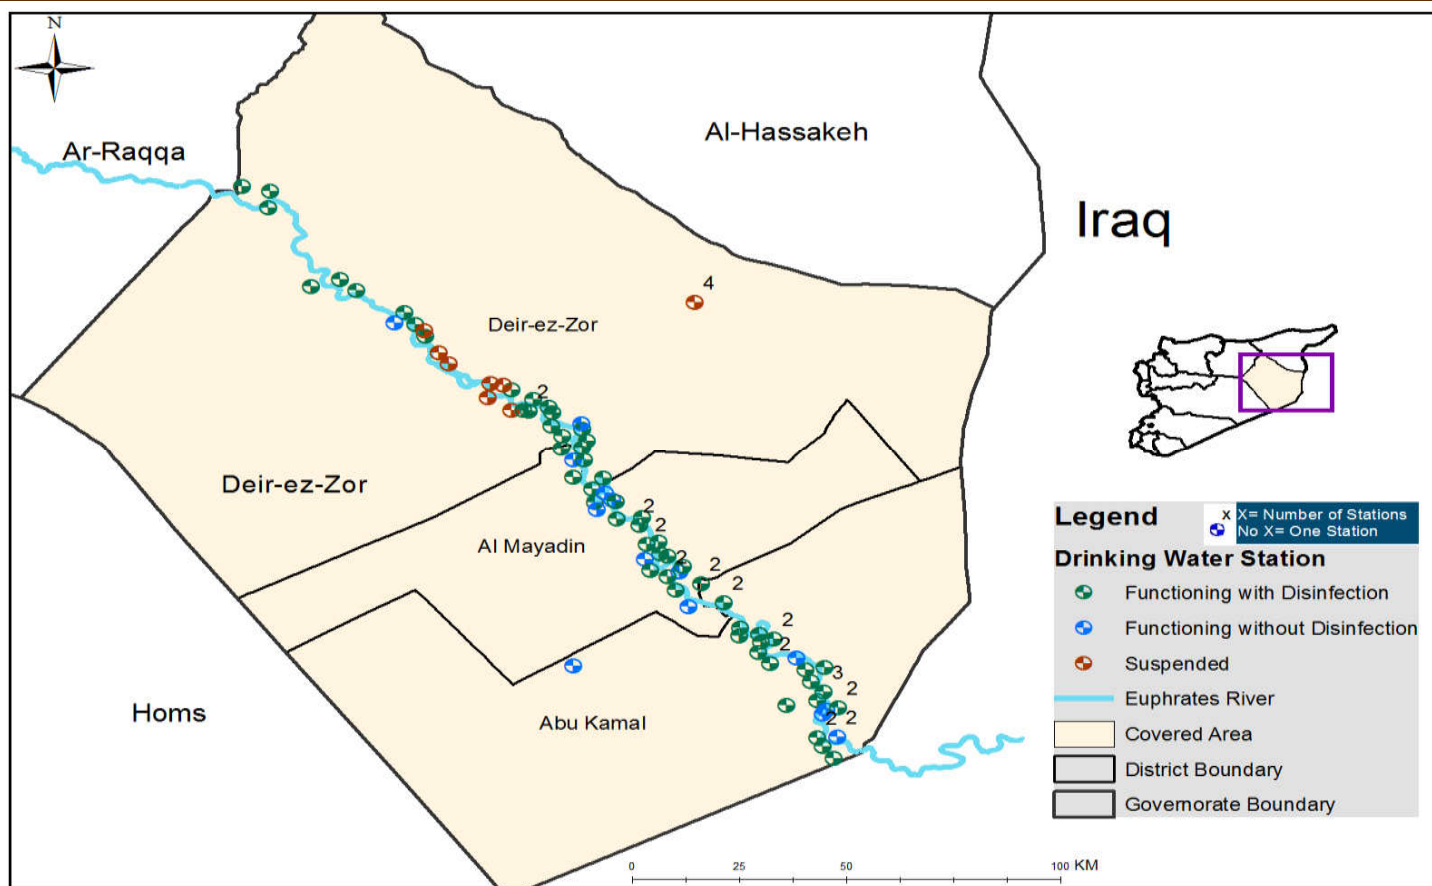

Drinking Water Stations Distribution in Dara

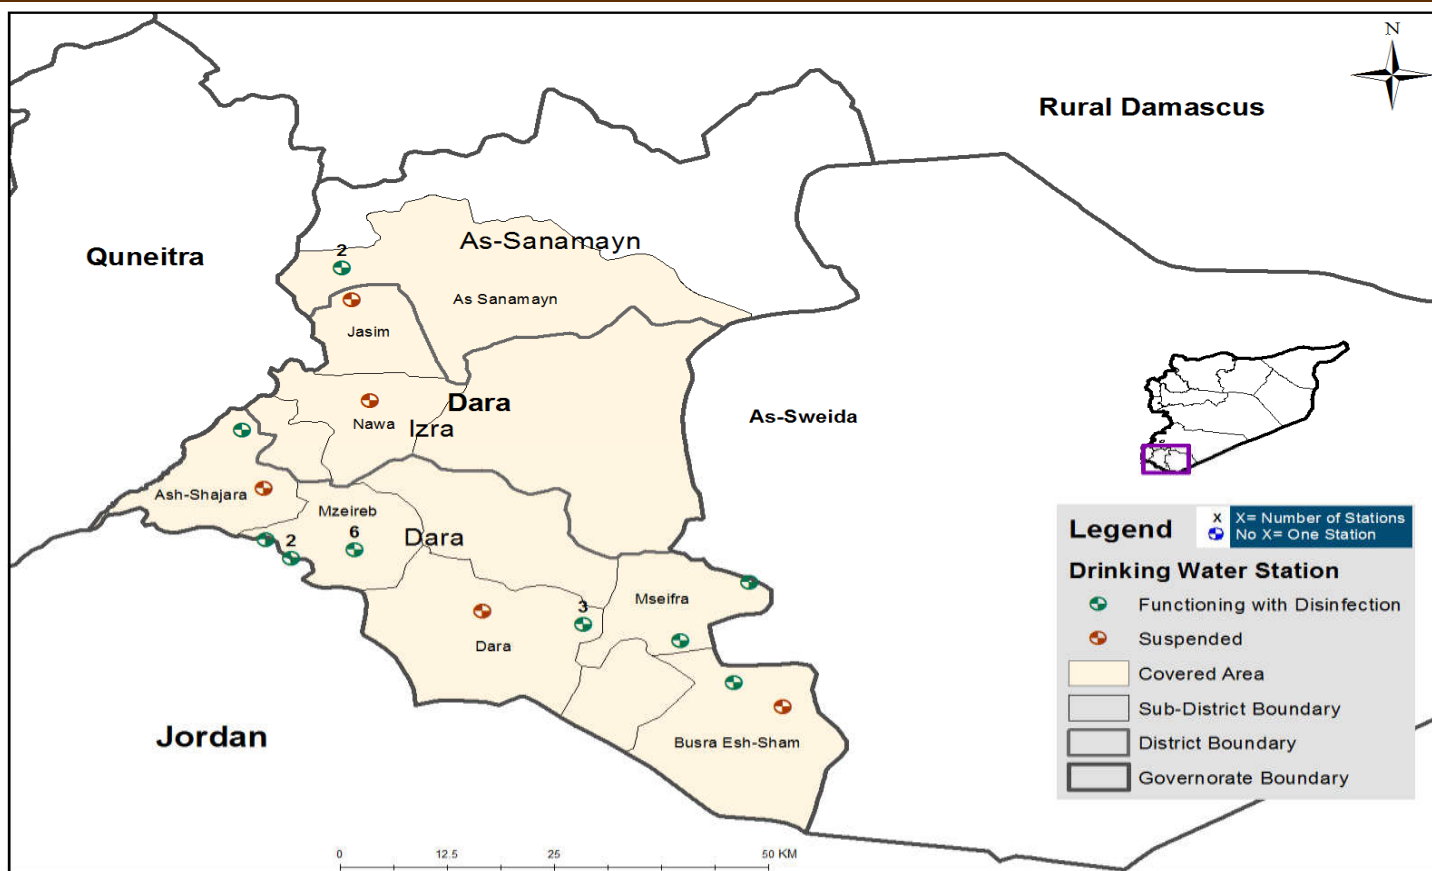

Drinking Water Stations Distribution in Quneitra

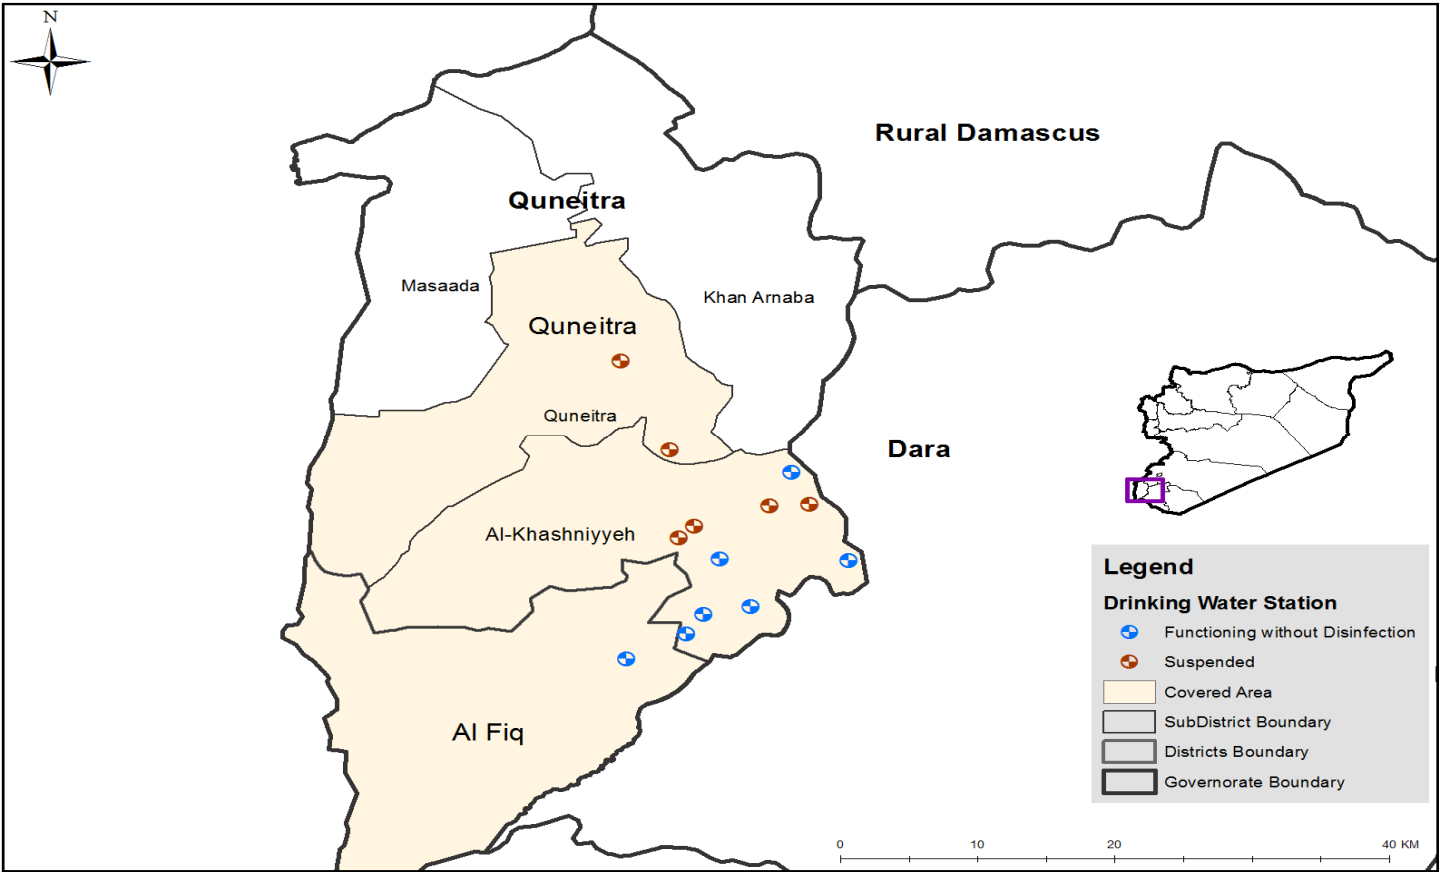

WASH = Water Sanitation and Hygiene

DWS = Drinking Water Station