


Date: 26 Jun 2016 - 9 Jul 2016

Week No. 27-28


## Highlights

- This report covers **623** drinking water sources monitored in **7** governorates. The percentages in this report represents only the sources monitored.
- **64% (400/623)** of the drinking water sources monitored were functioning.
- In the areas that their stations are suspended, agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The treated water sources were **48% (192/400)**.
- Of the functioning water stations, **86% (346/400)** delivered water using a piping network, **8% (31/400)** delivered water using tankering and **6% (23/400)** delivered water using both.
- Water quality test performed in the context of investigating the increased numbers of **STF** cases in Salqin - Idleb.
- Assessing the water sources for **86** communities in Idleb and Hama.
- Assessing chlorination status for **15 camps** - Atma - Harim - Idleb.
- Assessing chlorination status for **6 camps** - Azaz - Aleppo.

## Coverage

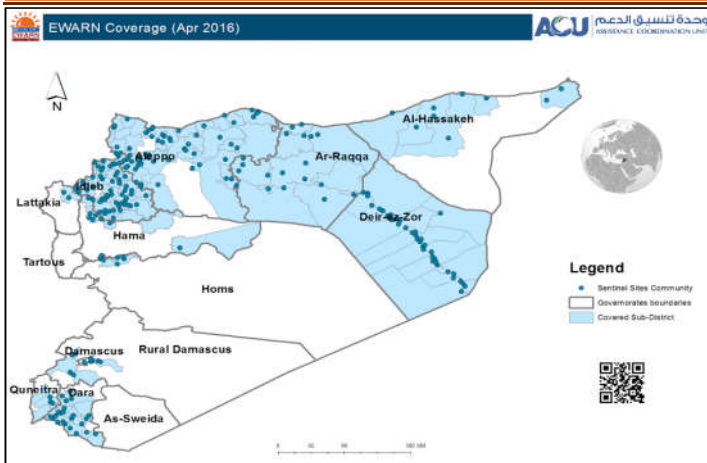


EWARN covers **124** sub-districts, **39** districts in **12** governorates

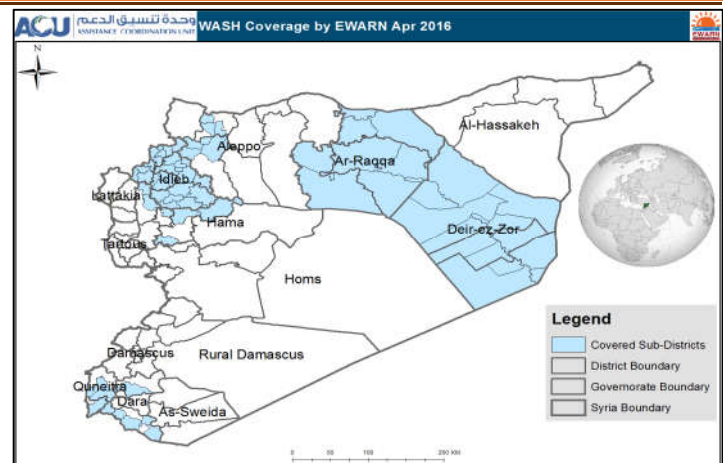

WASH covers **71** sub-districts, **20** districts in **7** governorates

## Completeness and Timeliness


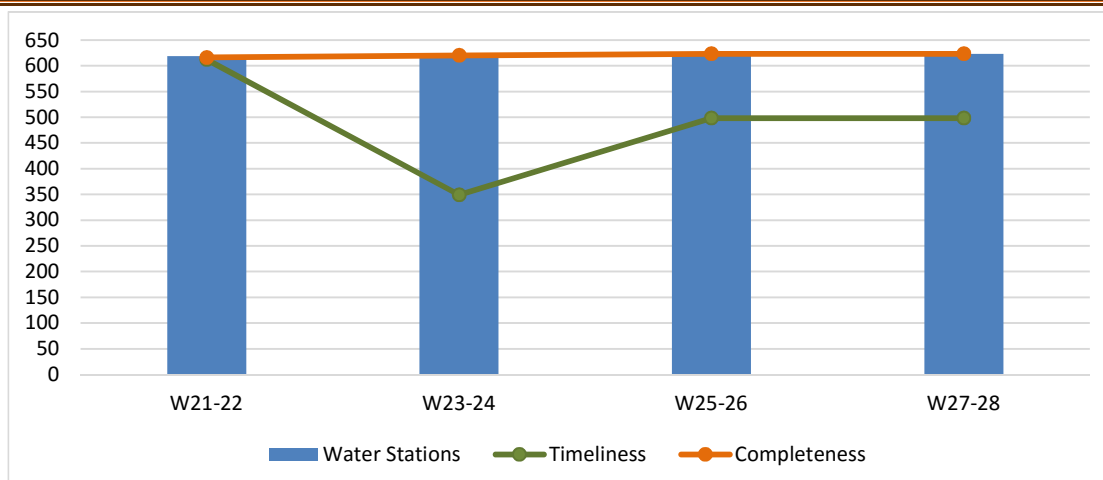


## Drinking Water Stations Status in Each Governorate


Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo	125	39	31%
Aleppo City	14	9	64%
Idleb	211	150	71%
Hama	49	16	33%
Ar-raqqqa	92	80	87%
Deir-ez-Zor	96	85	89%
Dara	23	14	61%
Quneitra	13	7	54%
Total	623	400	64%

Governorate	Functioning DWS Clorination Status		
	Total	With disinfection	Percentage
Aleppo	39	5	13%
Aleppo City	9	8	89%
Idleb	150	68	45%
Hama	16	0	0%
Ar-raqqqa	80	37	46%
Deir-ez-Zor	85	60	71%
Dara	14	14	100%
Quneitra	7	0	0%
Total	400	192	48%


## Drinking Water Stations Status

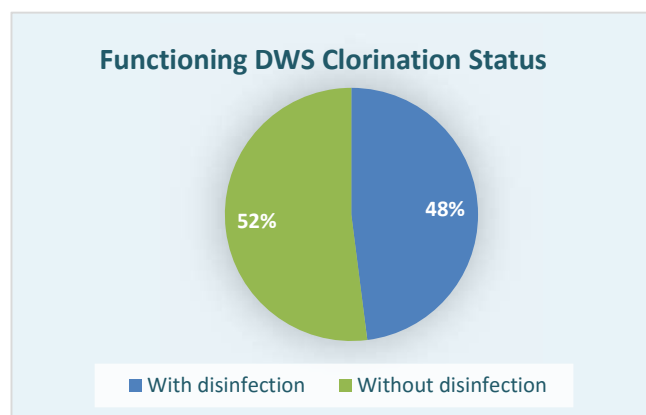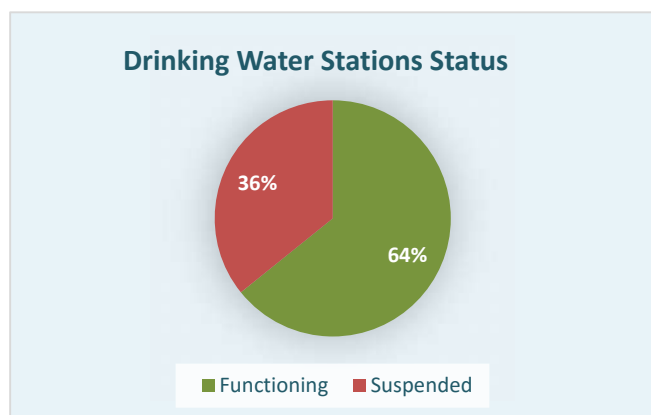

## Drinking Water Stations Status in Governorates

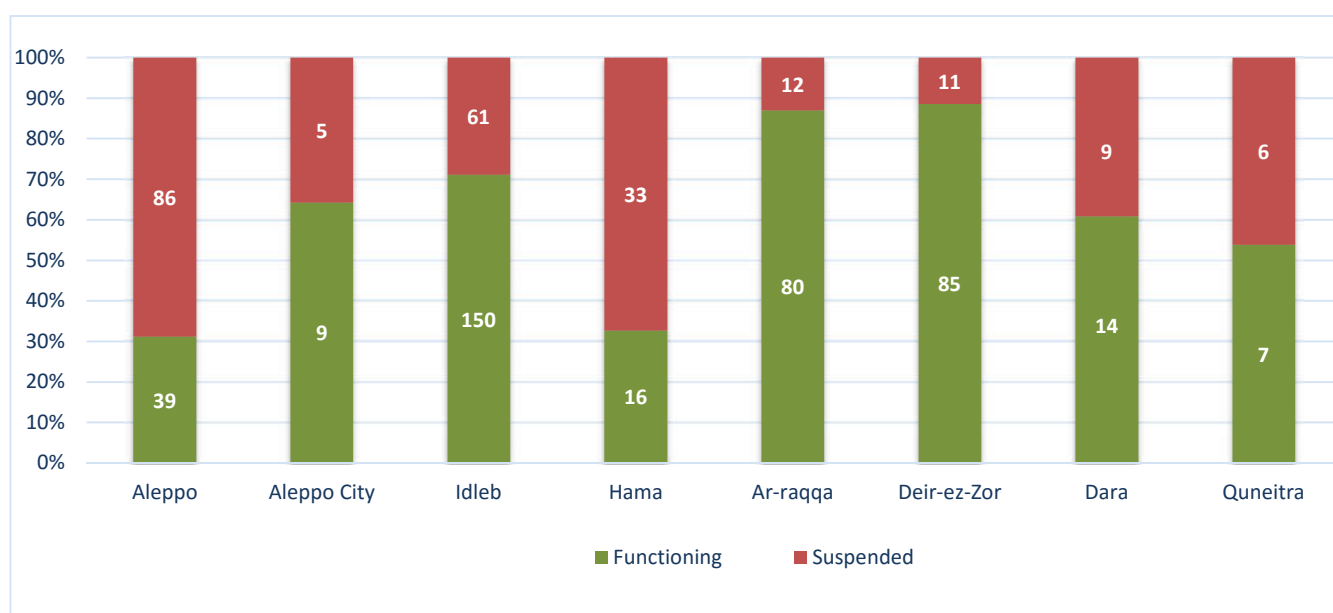


## Functioning Drinking Water Stations Chlorination Status

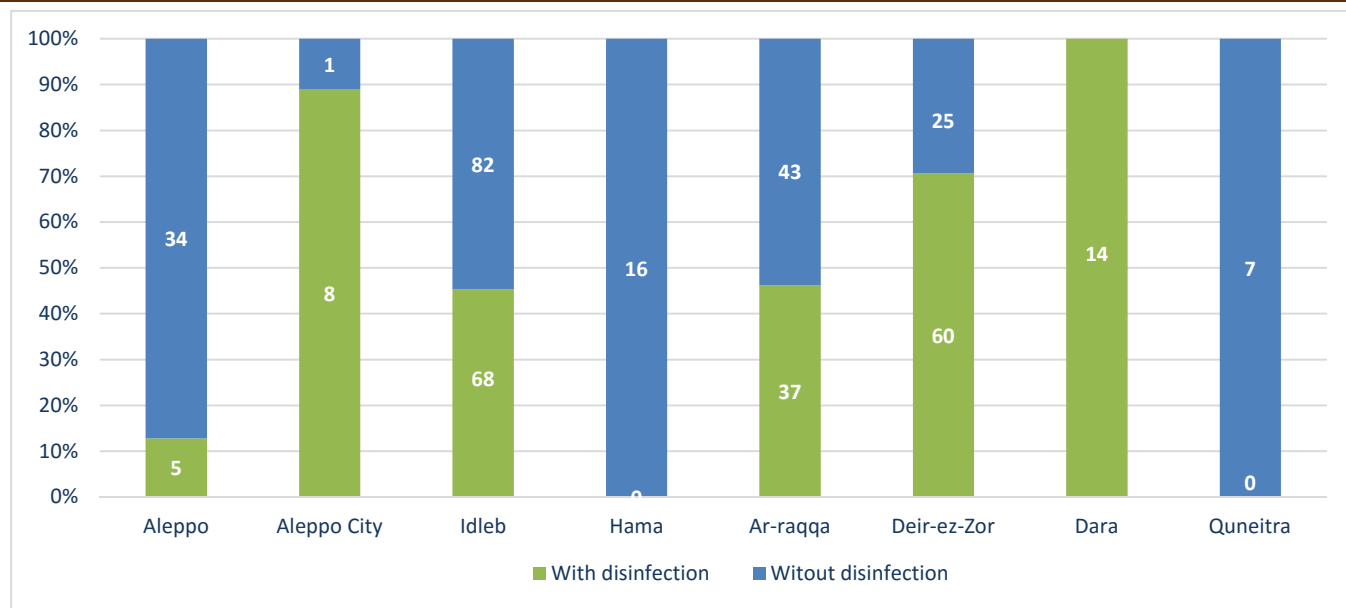


## Method of Delivery


Governorate	Functioning DWS	Method		
		Network	Tankering	Both
Aleppo	39	25	11	3
Aleppo City	9	2	7	0
Idleb	150	133	12	5
Hama	16	1	0	15
Ar-raqqa	80	80	0	0
Deir-ez-Zor	85	84	1	0
Dara	14	14	0	0
Quneitra	7	7	0	0
Total	400	346	31	23

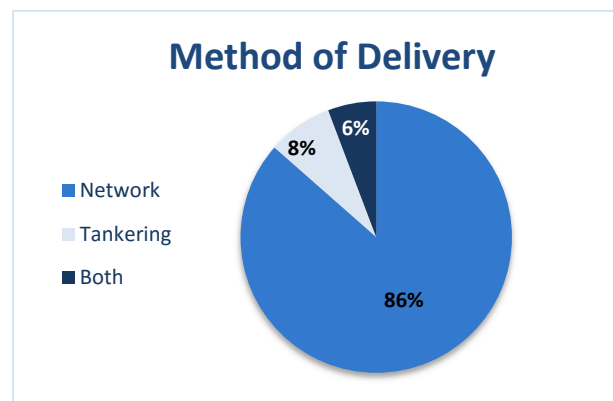


## Chlorination Status

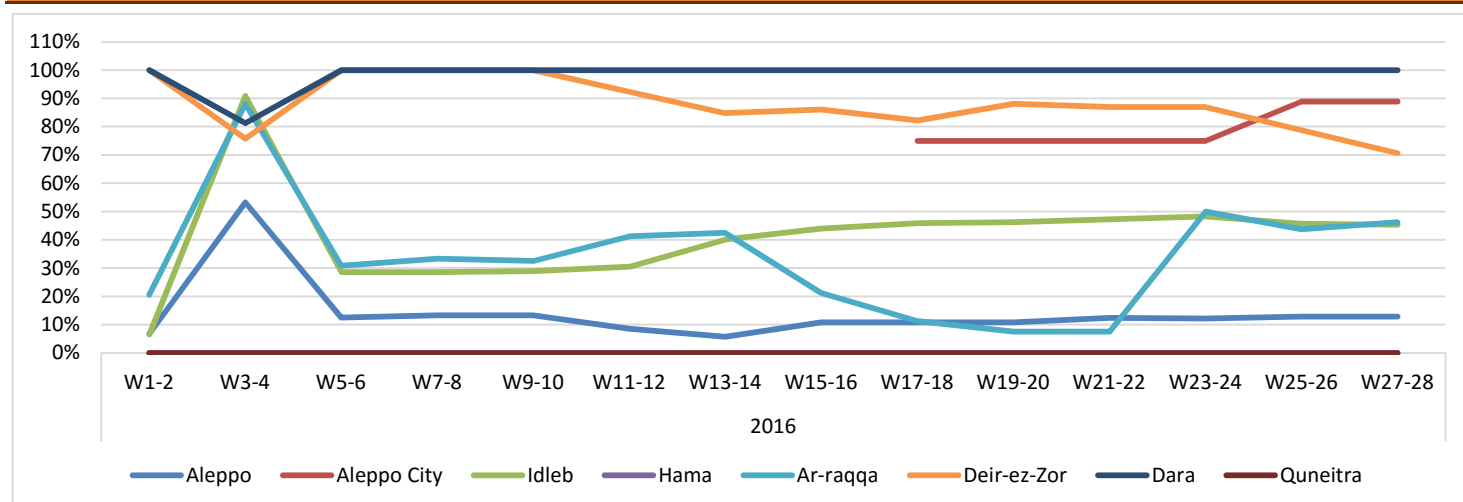


## Drinking Water Stations Distribution in Aleppo

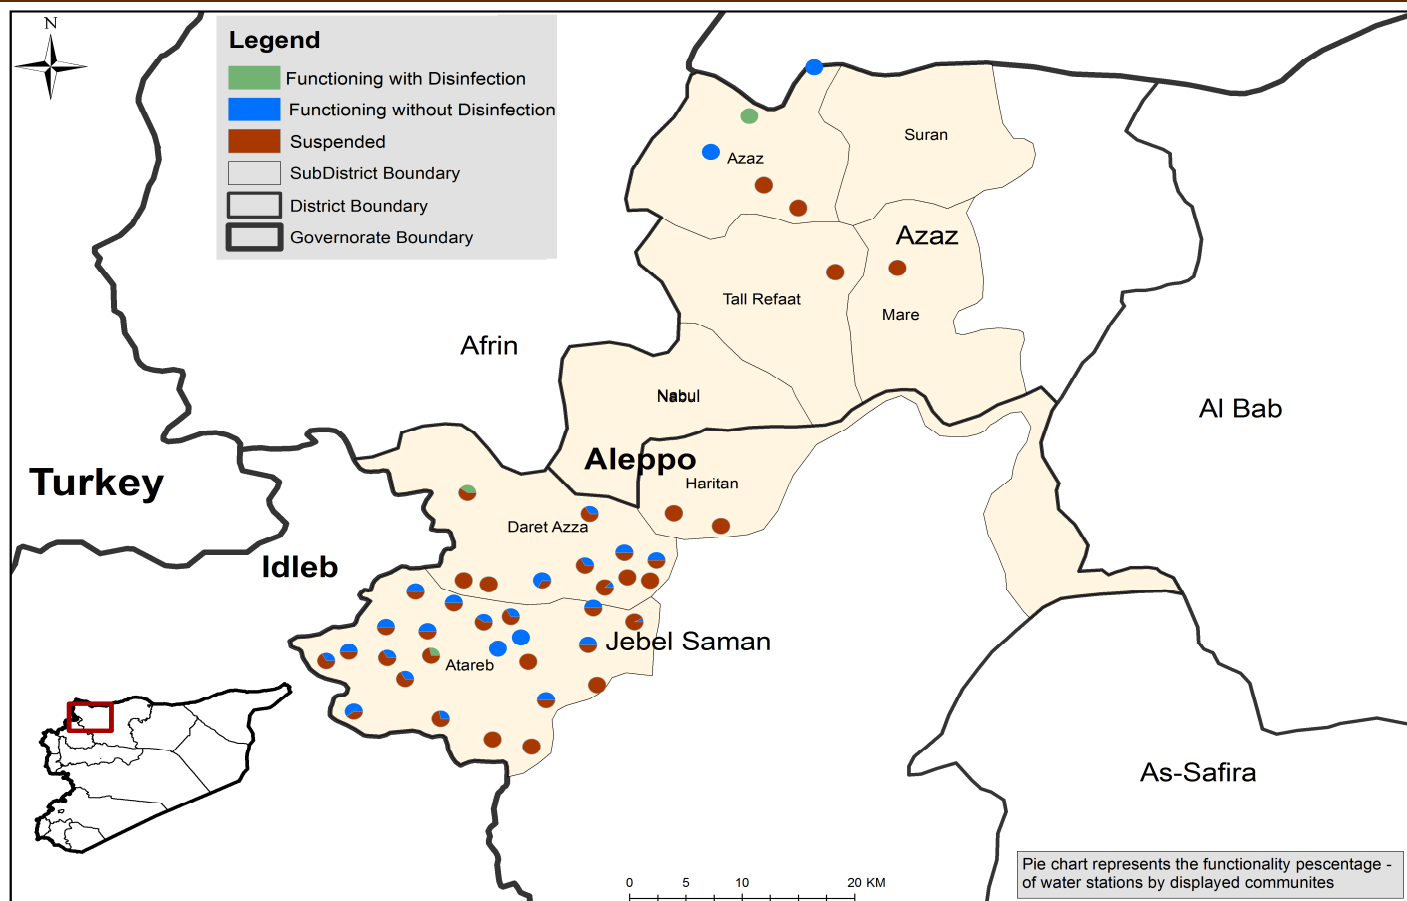


## Drinking Water Stations Distribution in Aleppo City

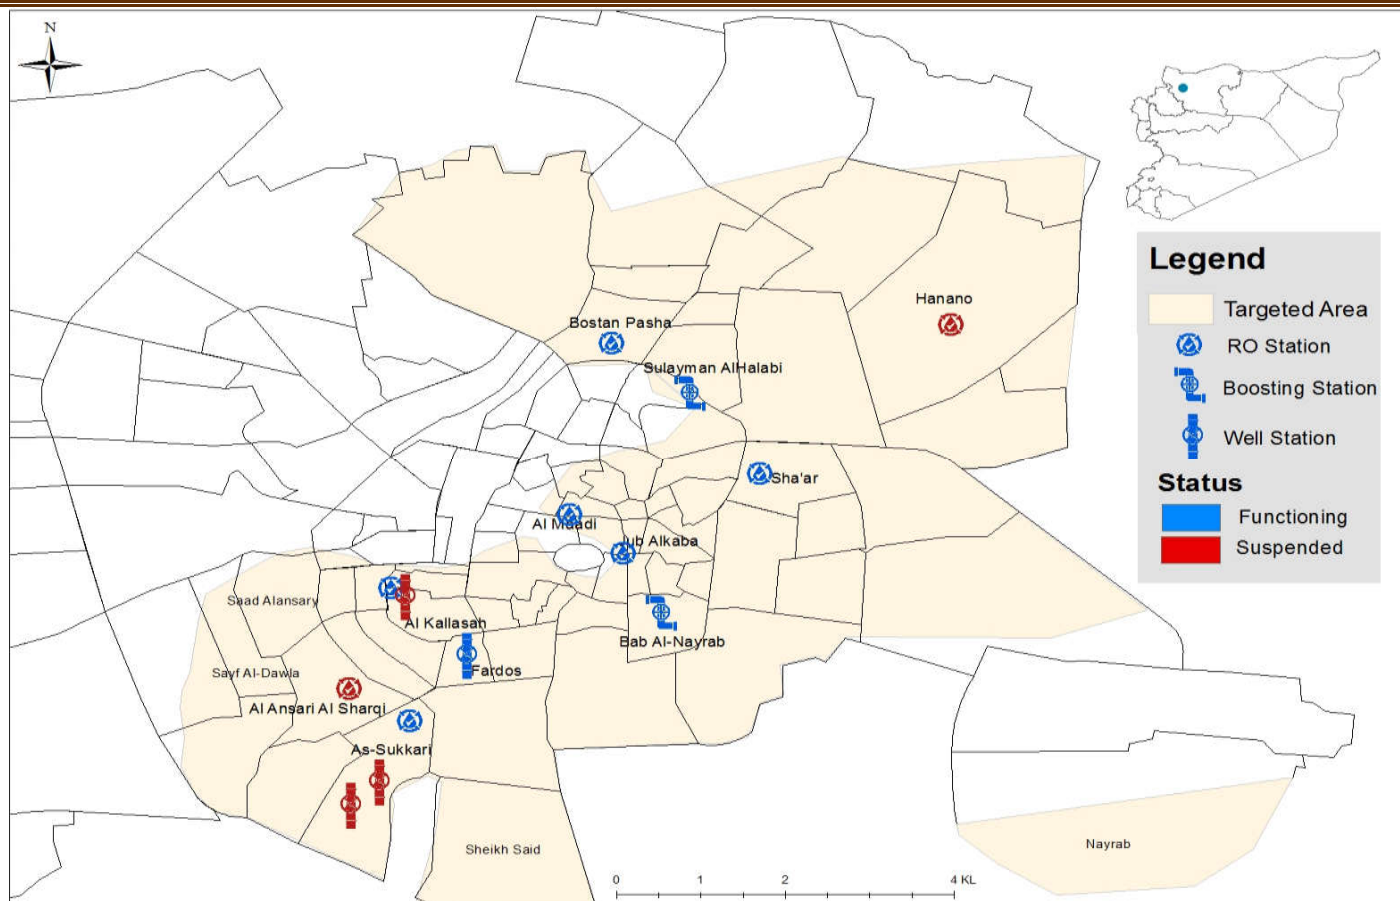


## Drinking Water Stations Distribution in Idlib

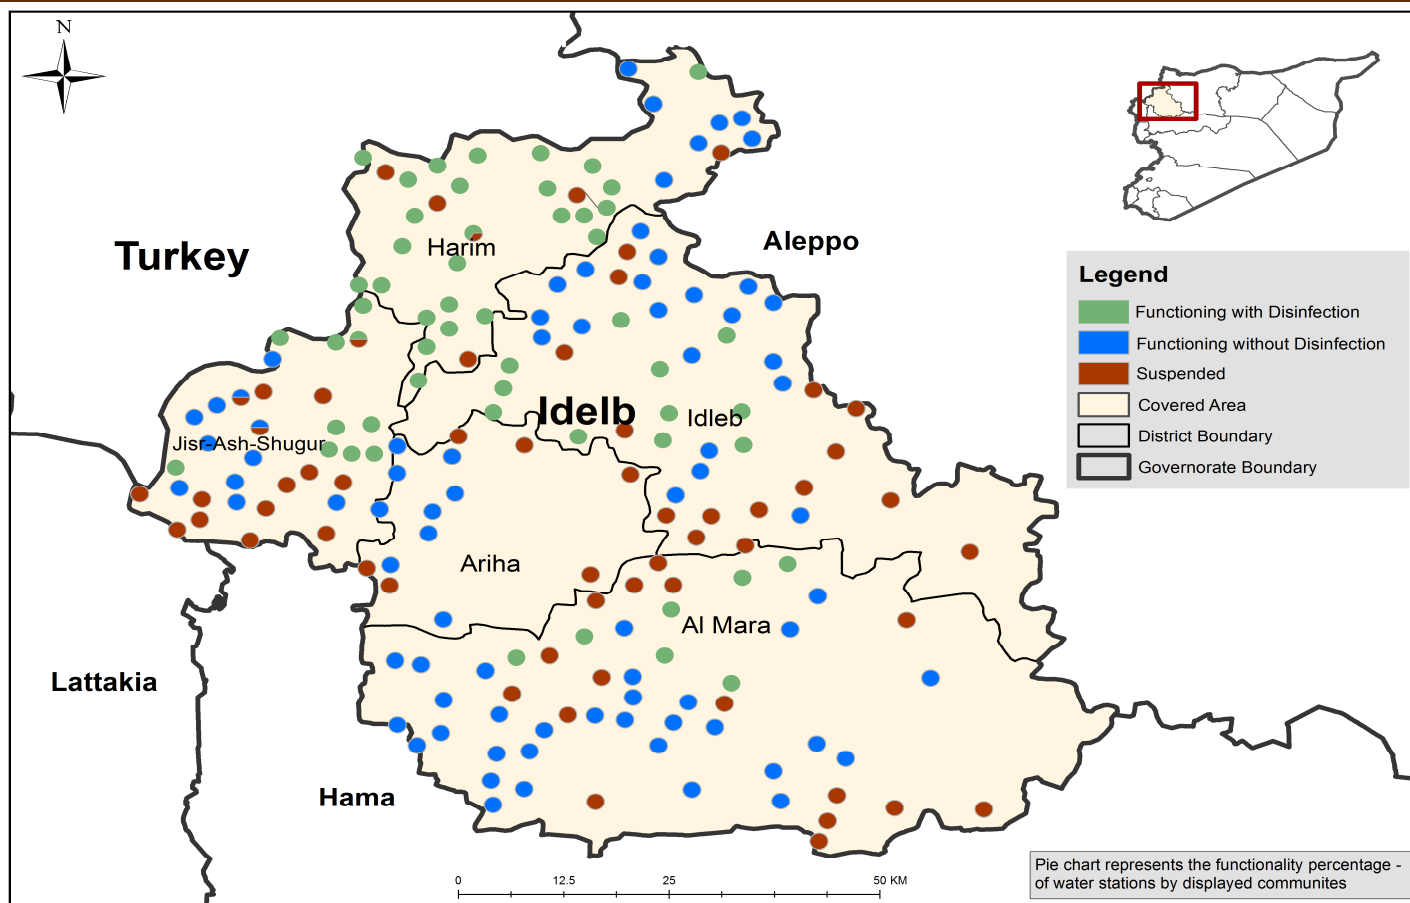


## Drinking Water Stations Distribution in Hama

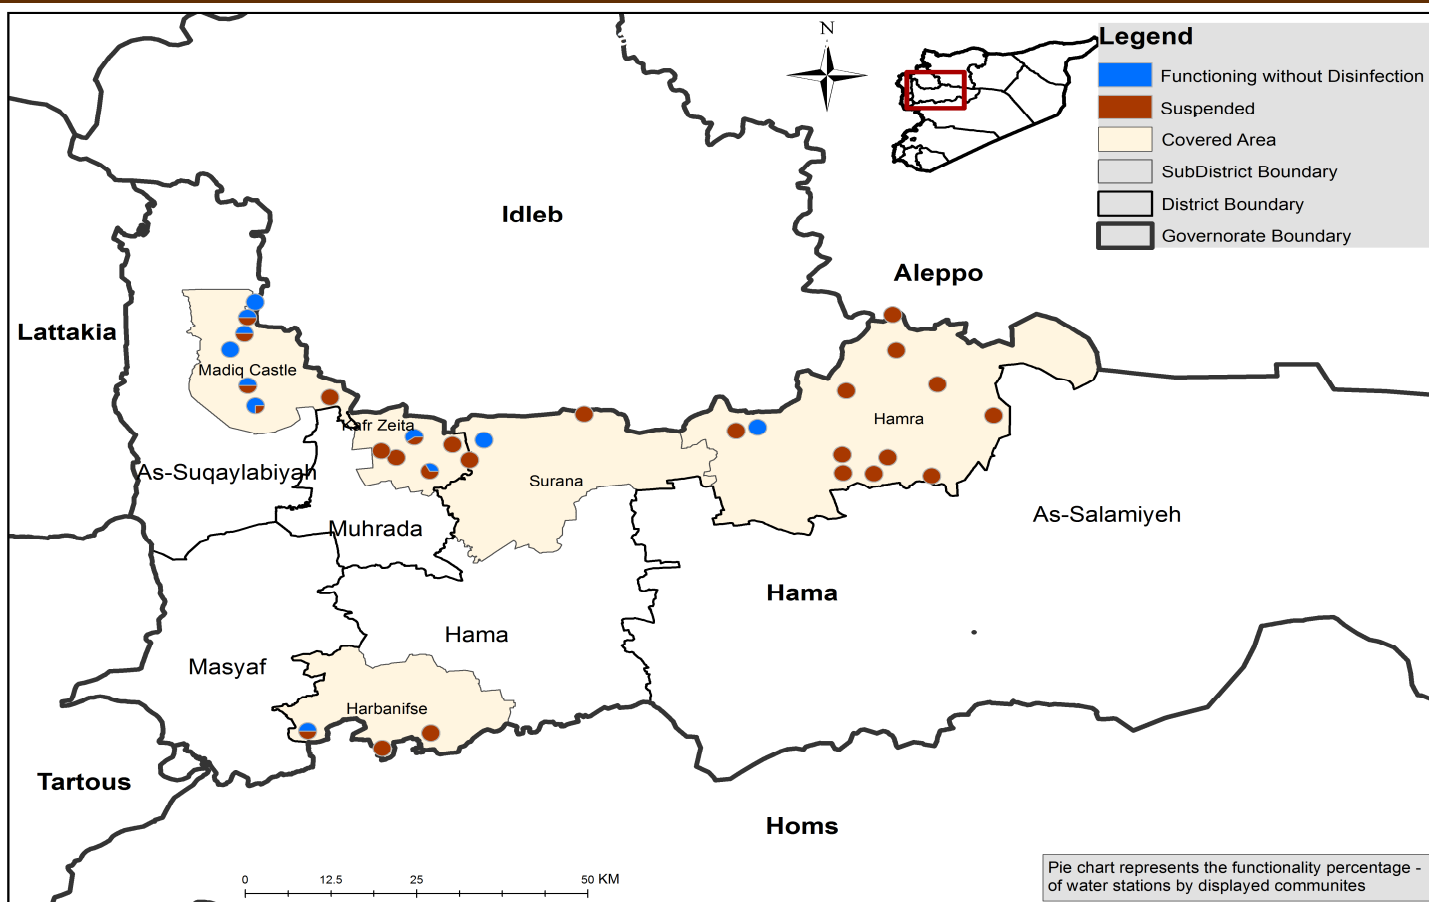


## Drinking Water Stations Distribution in Ar-raqqa

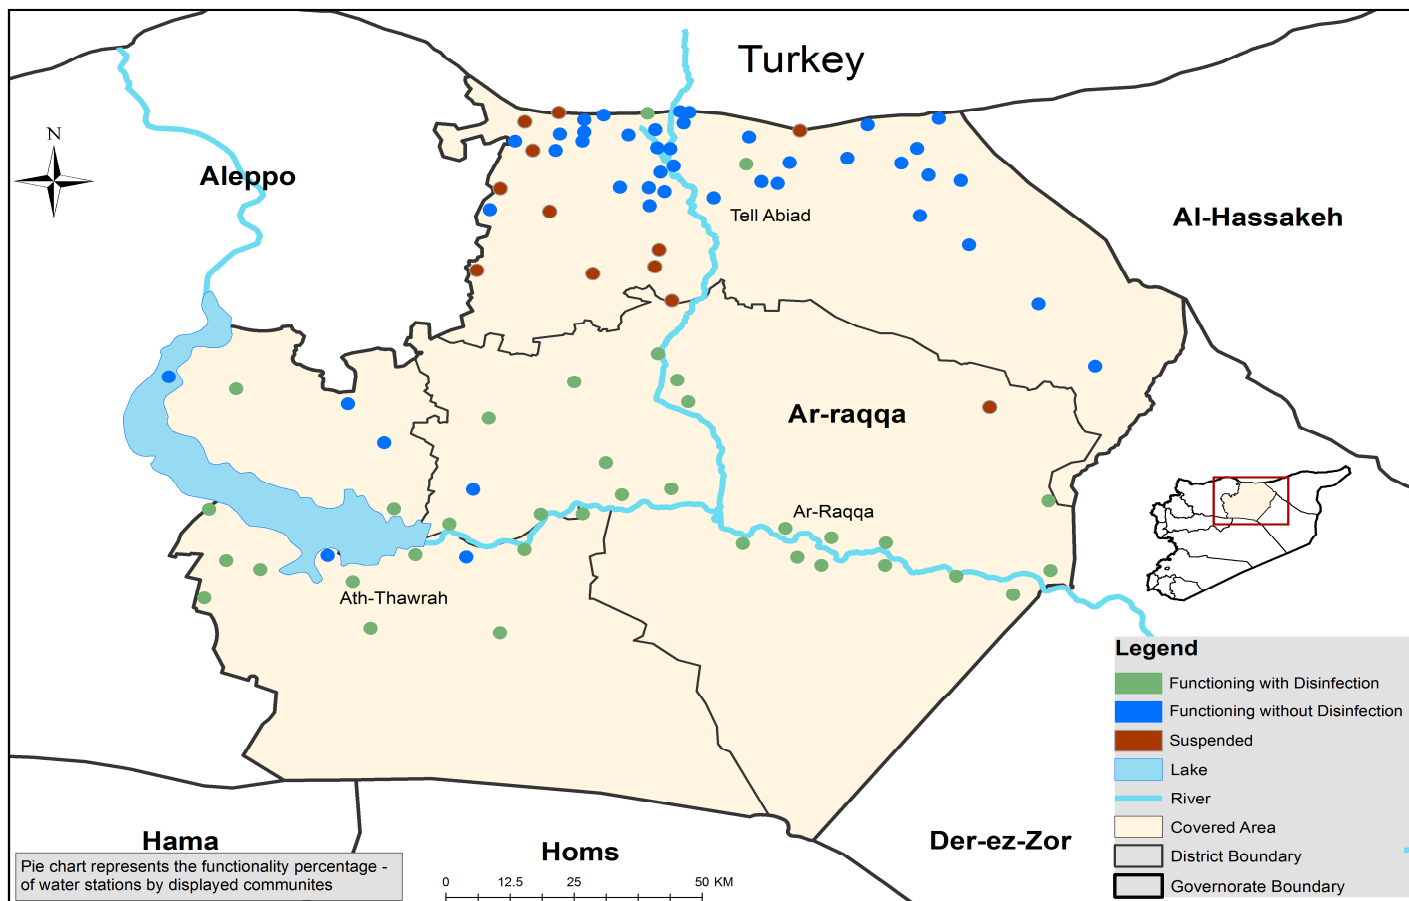

## Drinking Water Stations Distribution in Deir-ez-Zor

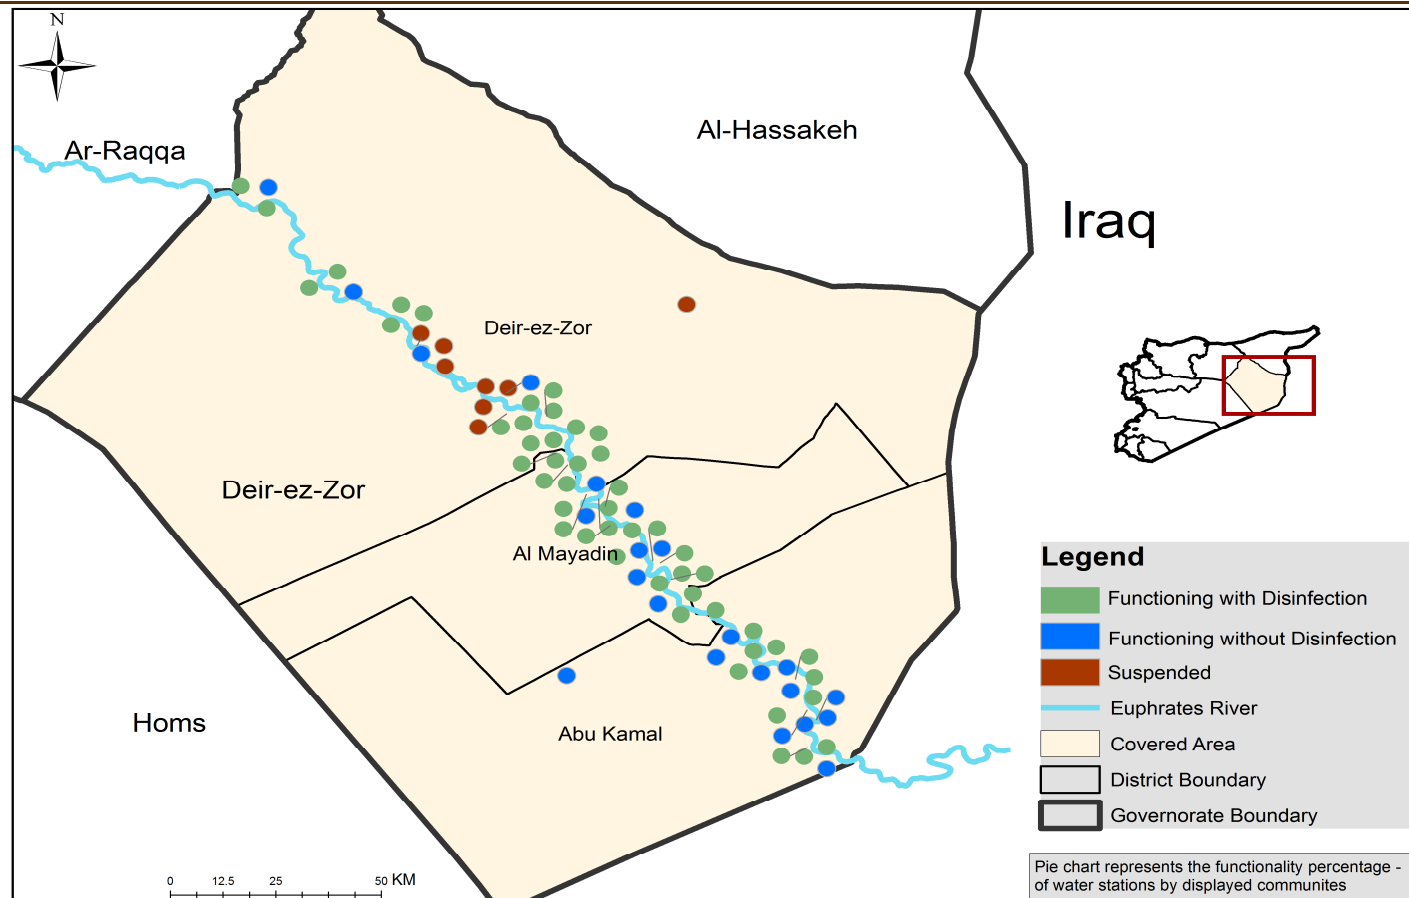

## Drinking Water Stations Distribution in Dara

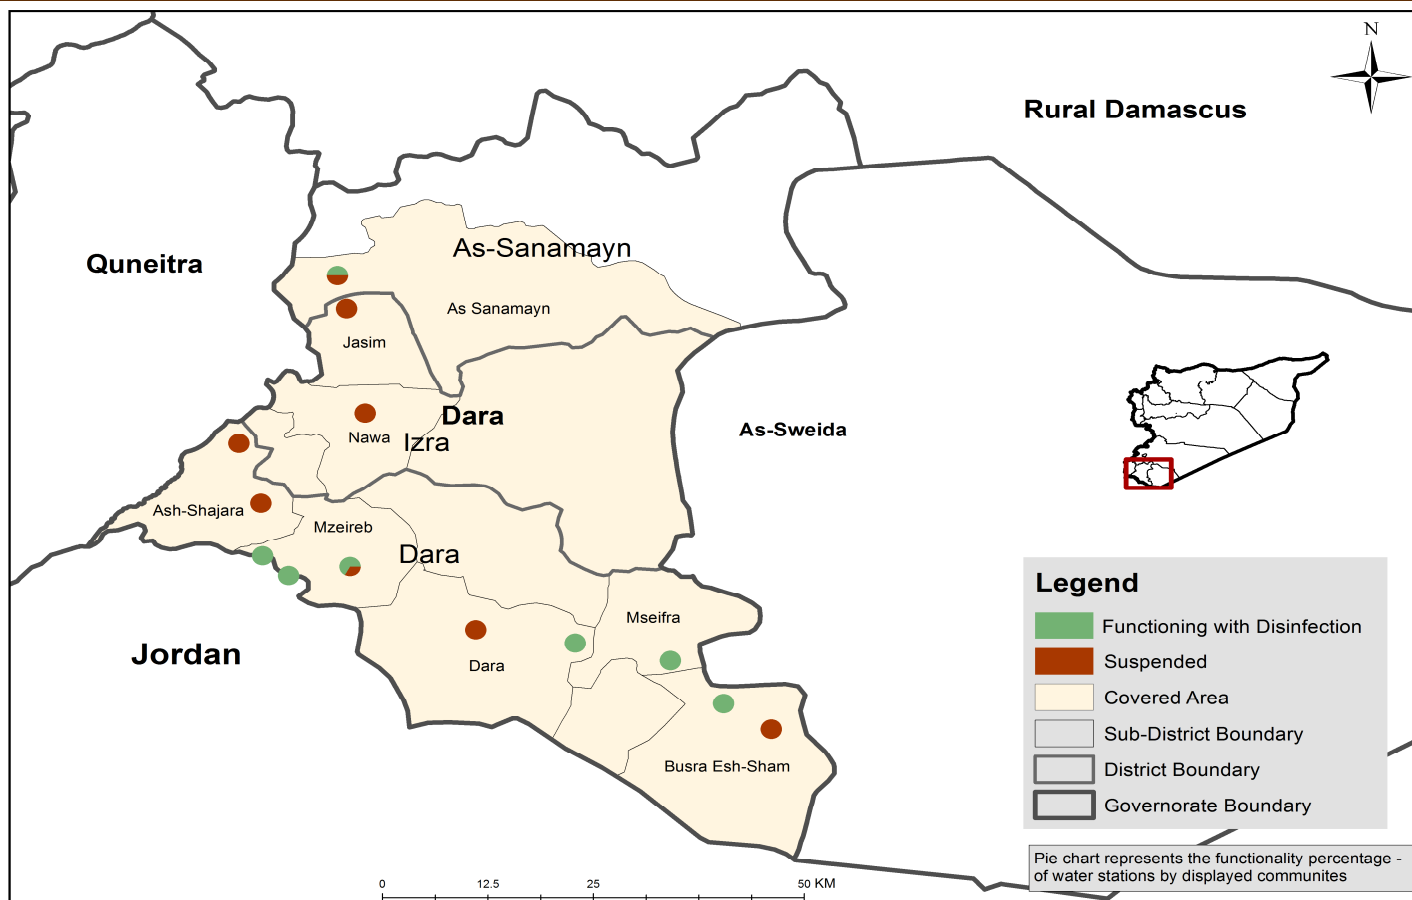

## Drinking Water Stations Distribution in Quneitra

