

## WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network


Date: 27 Feb - 12 Mar 2022

Week No. 09-10


### Highlights

- This report covers 1272 public drinking water stations monitored in 6 governorates, 1092 community-based, and 180 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 68% (871/1272) were functioning.
- The percentage of the suspended stations due to the lack of operational costs is 19%, and the percentage of the suspended stations due to the need for total-scale maintenance is 22%, of the total suspended water stations.
- Of the water stations, 37% depend on the grid and 37% depend on generators as a source of electric power.
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 57% (494/871).
- Of the functioning water stations, percentage of 88% (768/871) delivered water using a piping network, percentage of 07% (65/871) delivered water using tankering and percentage of 04% (33/871) delivered water using both, and 01% (5/871) delivered water using manhal.
- Among monitored drinking water sources, there weren't any biologically contaminated sources during last two weeks. 30 water quality tests were conducted.

### EWARN Coverage

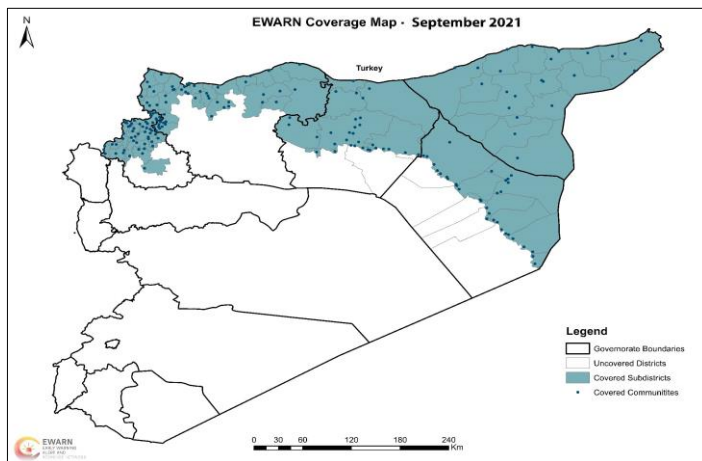


### WASH Coverage by EWARN

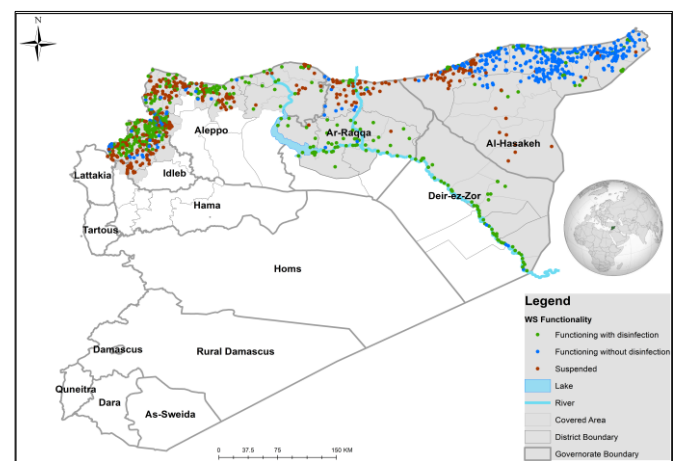

WASH covers **77** sub-districts, **23** districts in **6** governorates

### Completeness and Timeliness of Biweekly Reports

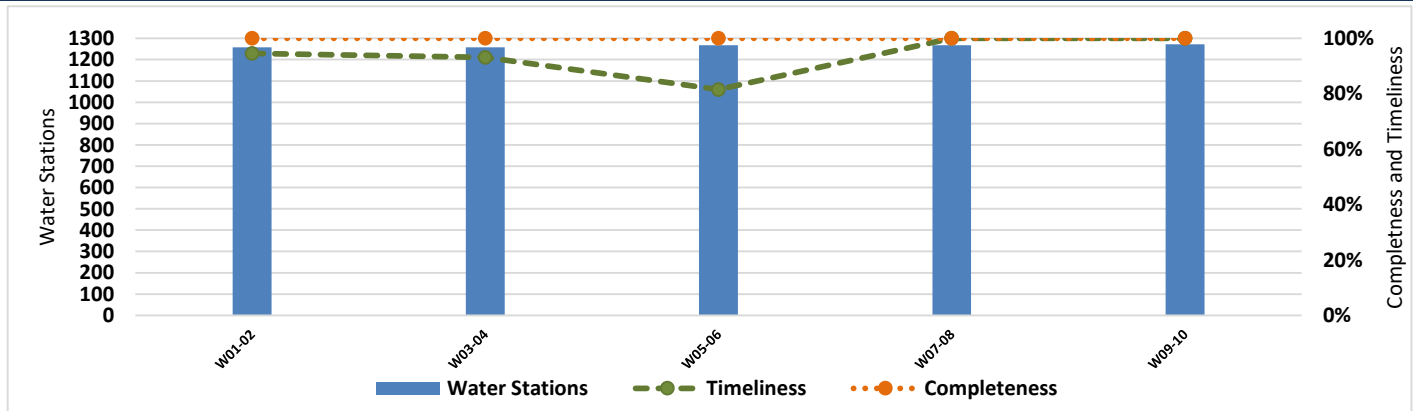


## Drinking Water Stations Status in Each Governorate

Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Non-camps)	256	133	52%
Aleppo (Camps)	41	12	29%
Idleb (Non-camps)	223	135	61%
Idleb (Camps)	139	94	68%
Hama	8	0	0%
Ar-raqqa	120	74	62%
Deir-ez-Zor	60	60	100%
Al-Hasakeh	425	363	85%
<b>Total</b>	<b>1272</b>	<b>871</b>	<b>68%</b>


Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Non-camps)	133	118	89%
Aleppo (Camps)	12	5	42%
Idleb (Non-camps)	135	113	84%
Idleb (Camps)	94	52	55%
Hama	0	0	0%
Ar-raqqa	74	65	88%
Deir-ez-Zor	60	56	93%
Al-Hasakeh	363	85	23%
<b>Total</b>	<b>871</b>	<b>494</b>	<b>57%</b>

## Drinking Water Stations Status


Drinking Water Stations Status

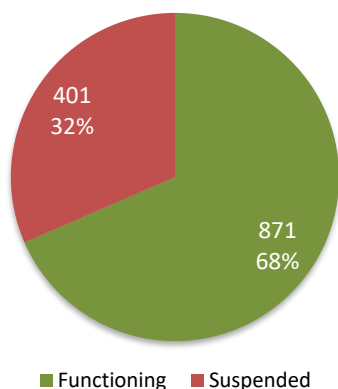

Functioning DWS Chlorination Status

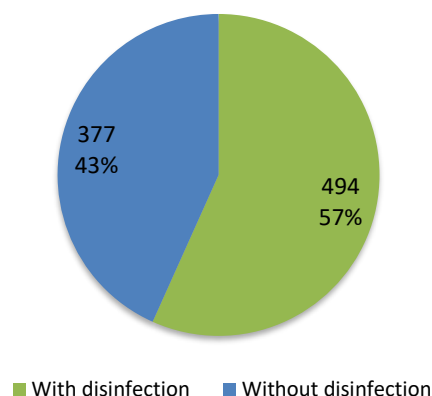


## Drinking Water Stations Status in Governorates

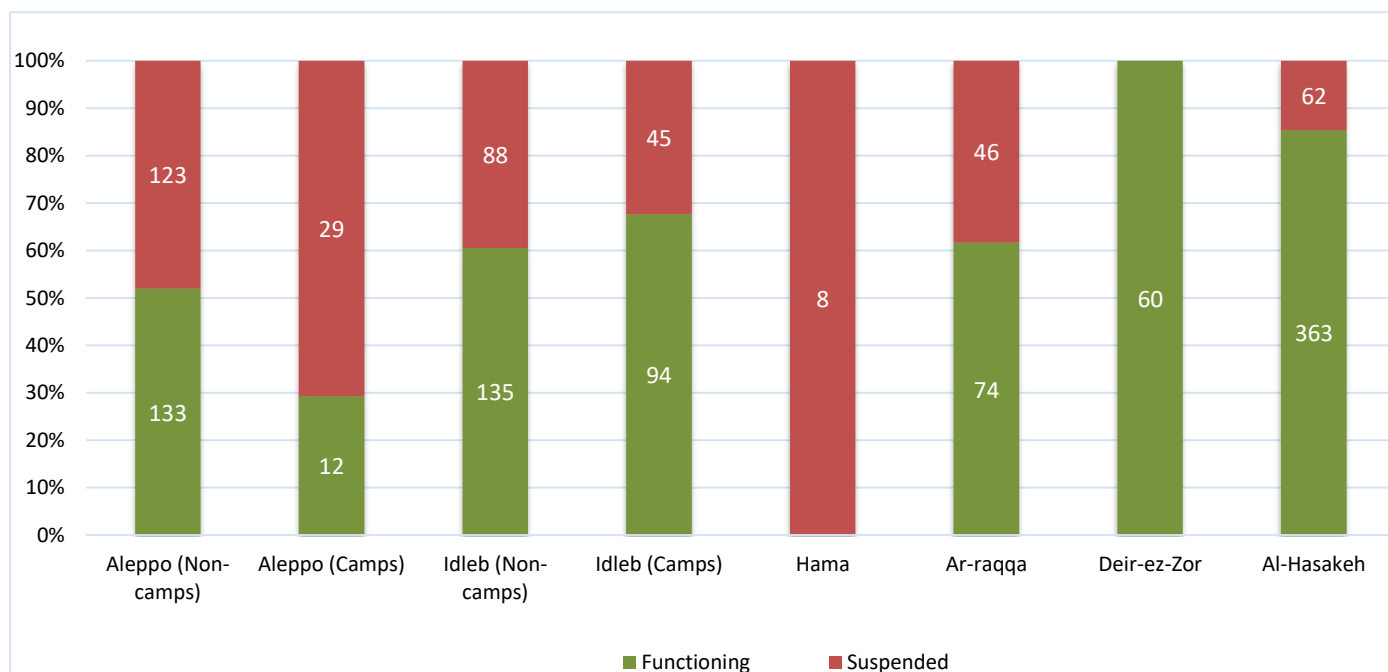


## The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	31	36	3	8	22	39	8	5
Idleb	12	42	1	11	14	39	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	27	0	0	3	6	2	8	0
Deir-ez-Zor	0	0	0	0	0	0	0	0
Al-Hasakeh	25	0	2	2	2	10	19	2
<b>Total</b>	<b>95</b>	<b>78</b>	<b>6</b>	<b>24</b>	<b>44</b>	<b>90</b>	<b>54</b>	<b>10</b>

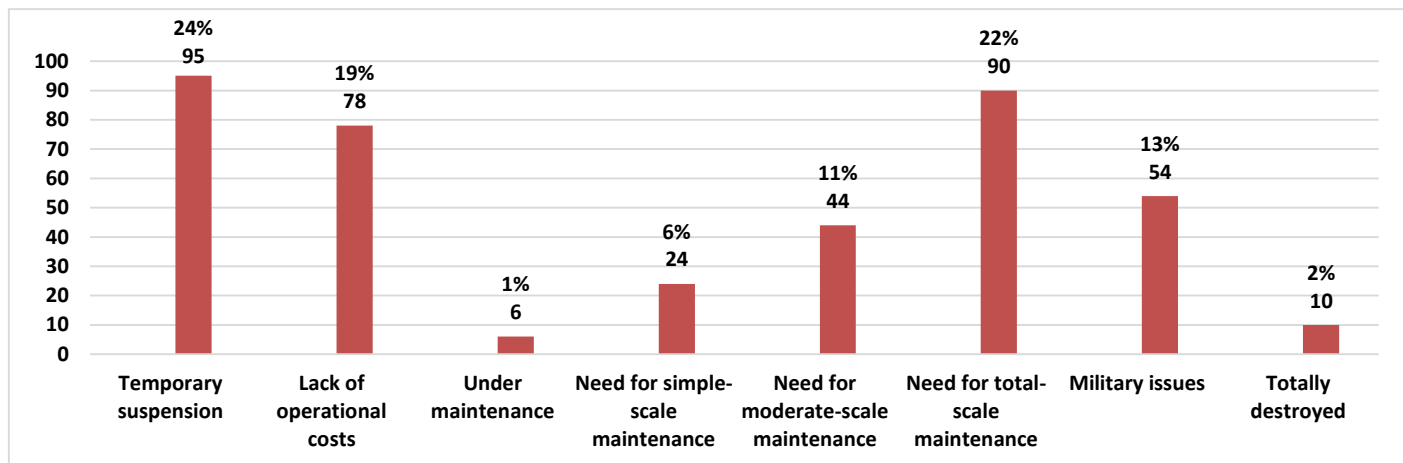


## Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	21	182	13	48	0	24	9
Idleb	11	261	32	21	3	33	1
Hama	0	8	0	0	0	0	0
Ar-raqqa	81	2	0	37	0	0	0
Deir-ez-Zor	0	12	0	48	0	0	0
Al-Hasakeh	358	2	0	64	0	0	1
<b>Total</b>	<b>471</b>	<b>467</b>	<b>45</b>	<b>218</b>	<b>3</b>	<b>57</b>	<b>11</b>

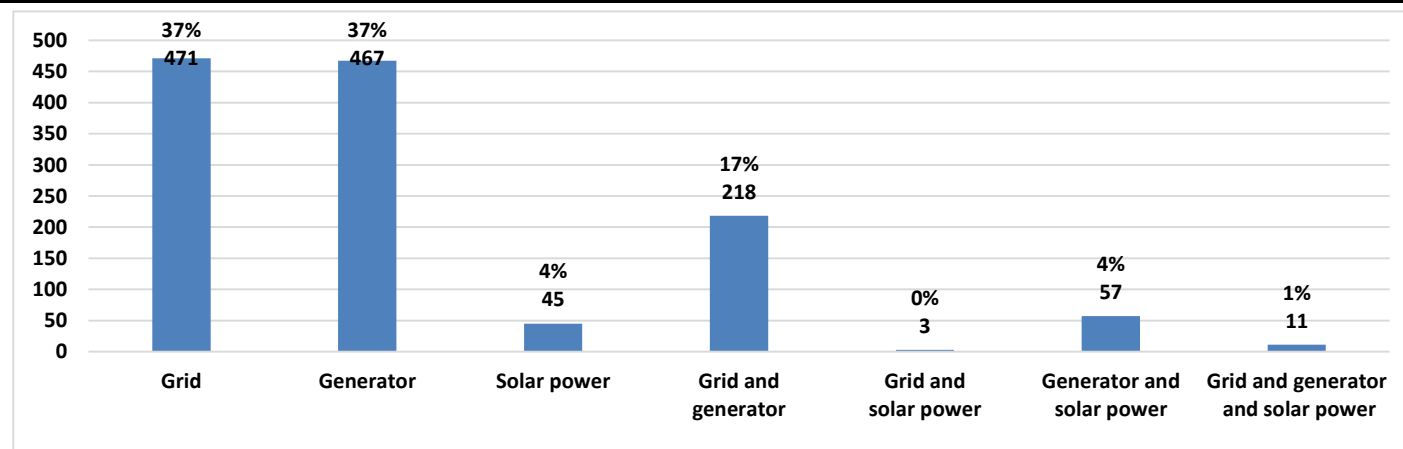


## Functioning Drinking Water Stations Chlorination Status

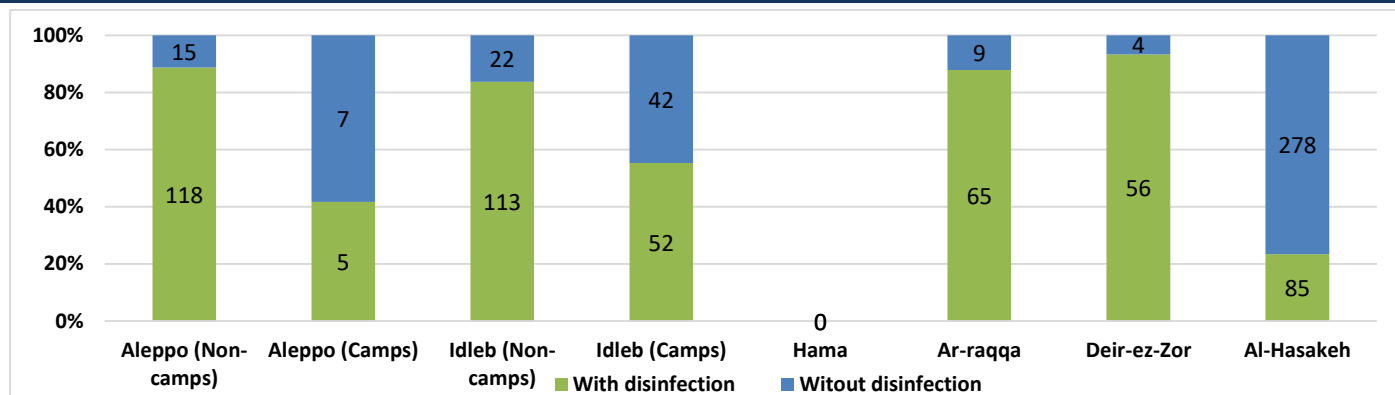

## The Reason for not Chlorination

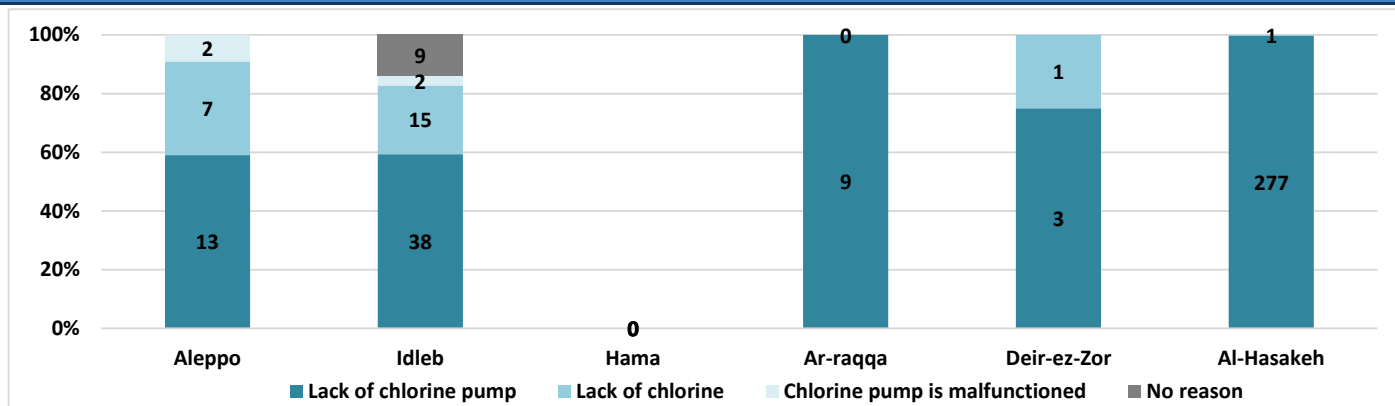

## Chlorination Status Over Weeks

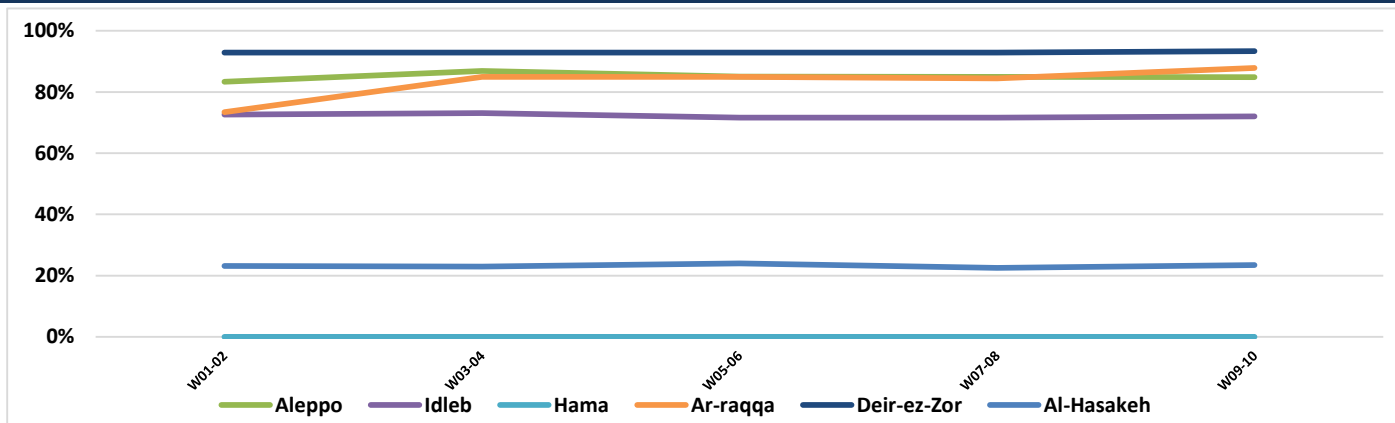


## Connection Method


Governorate	Functioning DWS	Method			
		Network	Tankering	Both	Manhal
Aleppo	145	125	3	12	5
Idleb	229	153	56	20	0
Hama	0	0	0	0	0
Ar-raqqa	74	72	2	0	0
Deir-ez-Zor	60	56	4	0	0
Al-Hasakeh	363	362	0	1	0
<b>Total</b>	<b>871</b>	<b>768</b>	<b>65</b>	<b>33</b>	<b>5</b>

### Connection Method


■ Network  
 ■ Tankering  
 ■ Both  
 ■ Manhal




## Drinking Water Stations Distribution in Aleppo (Non-camps Water Stations)

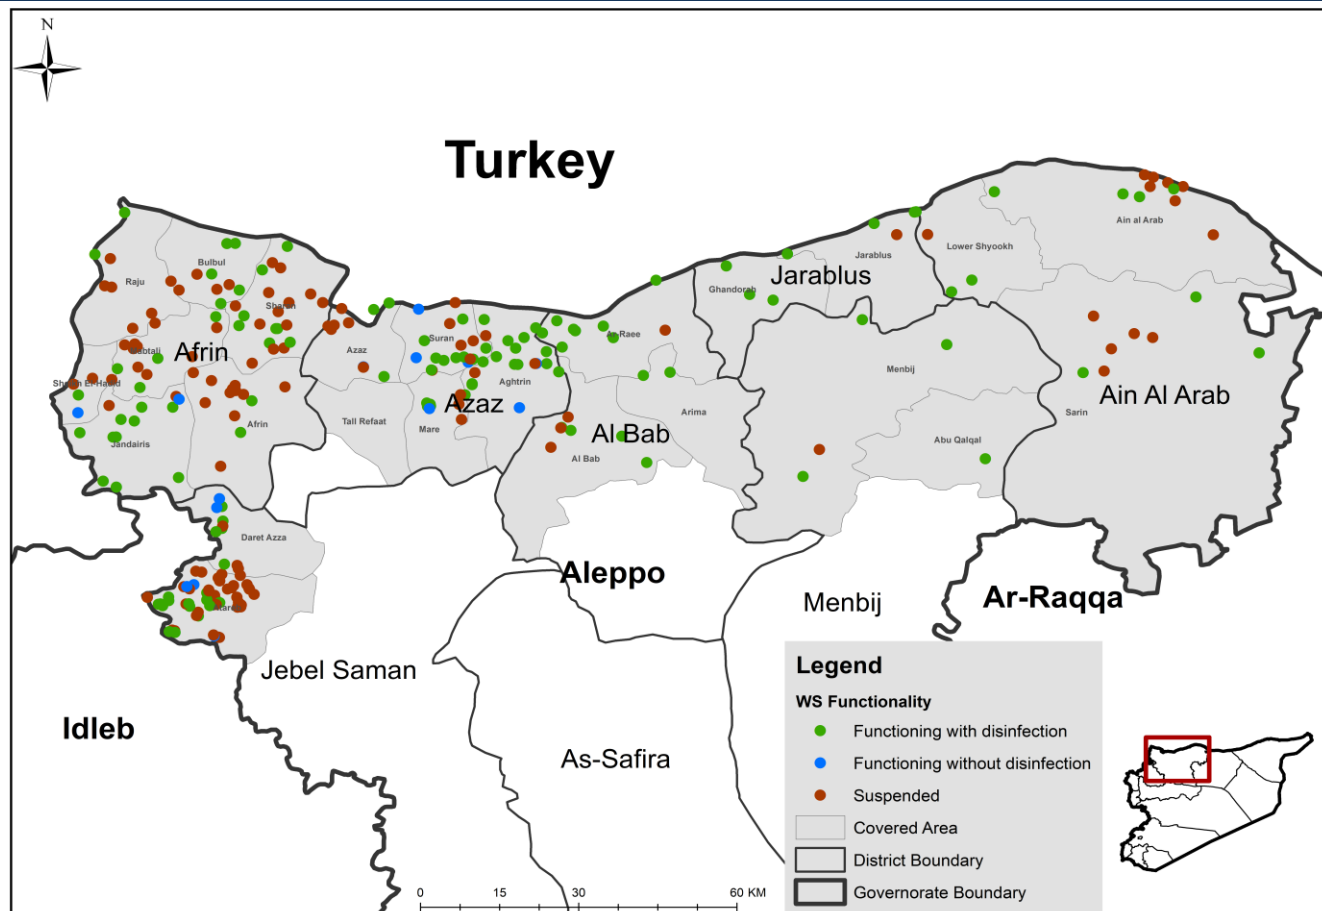


## Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

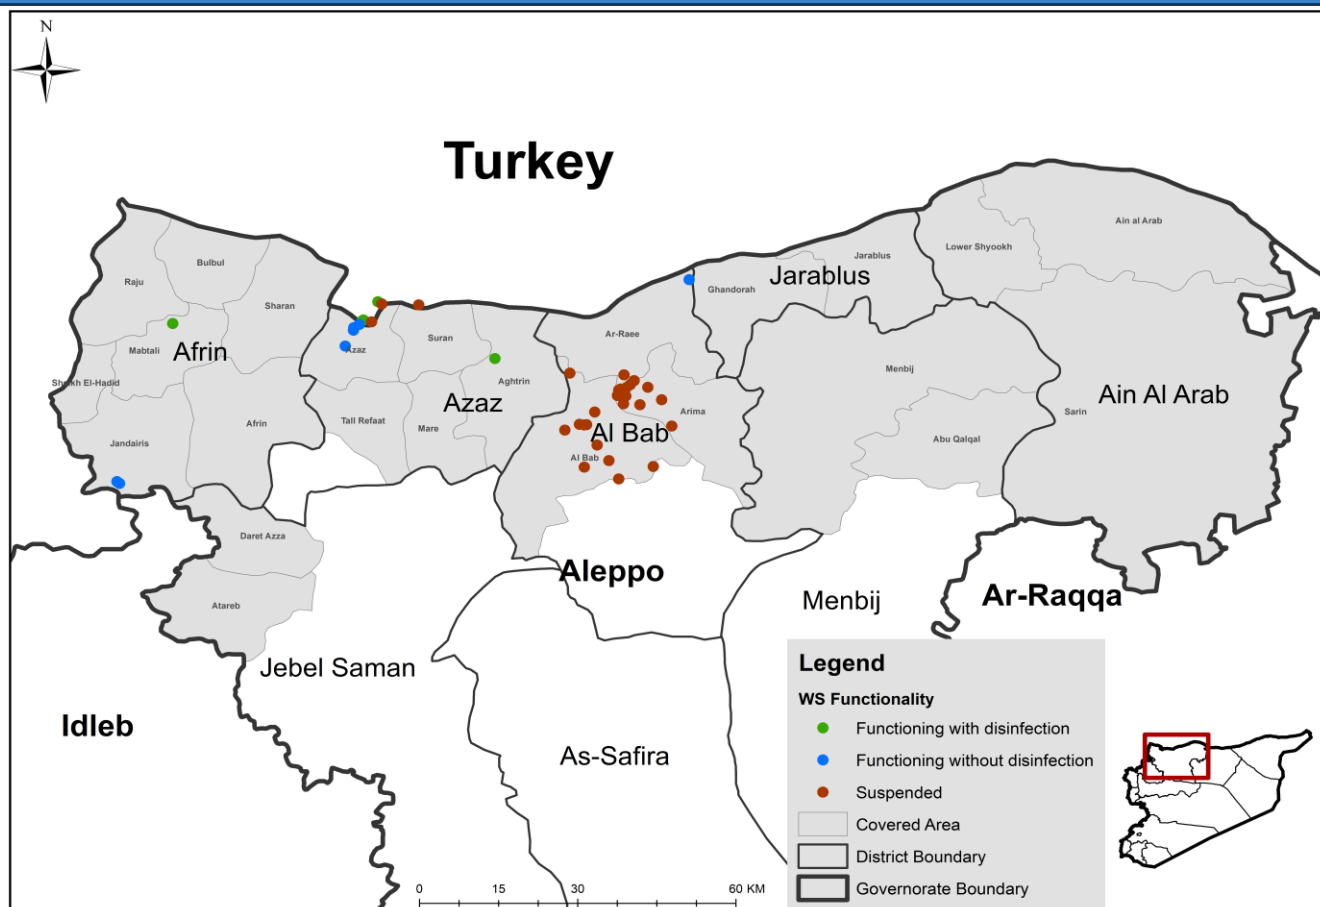


## Drinking Water Stations Distribution in Idleb (Non-camps Water Stations)

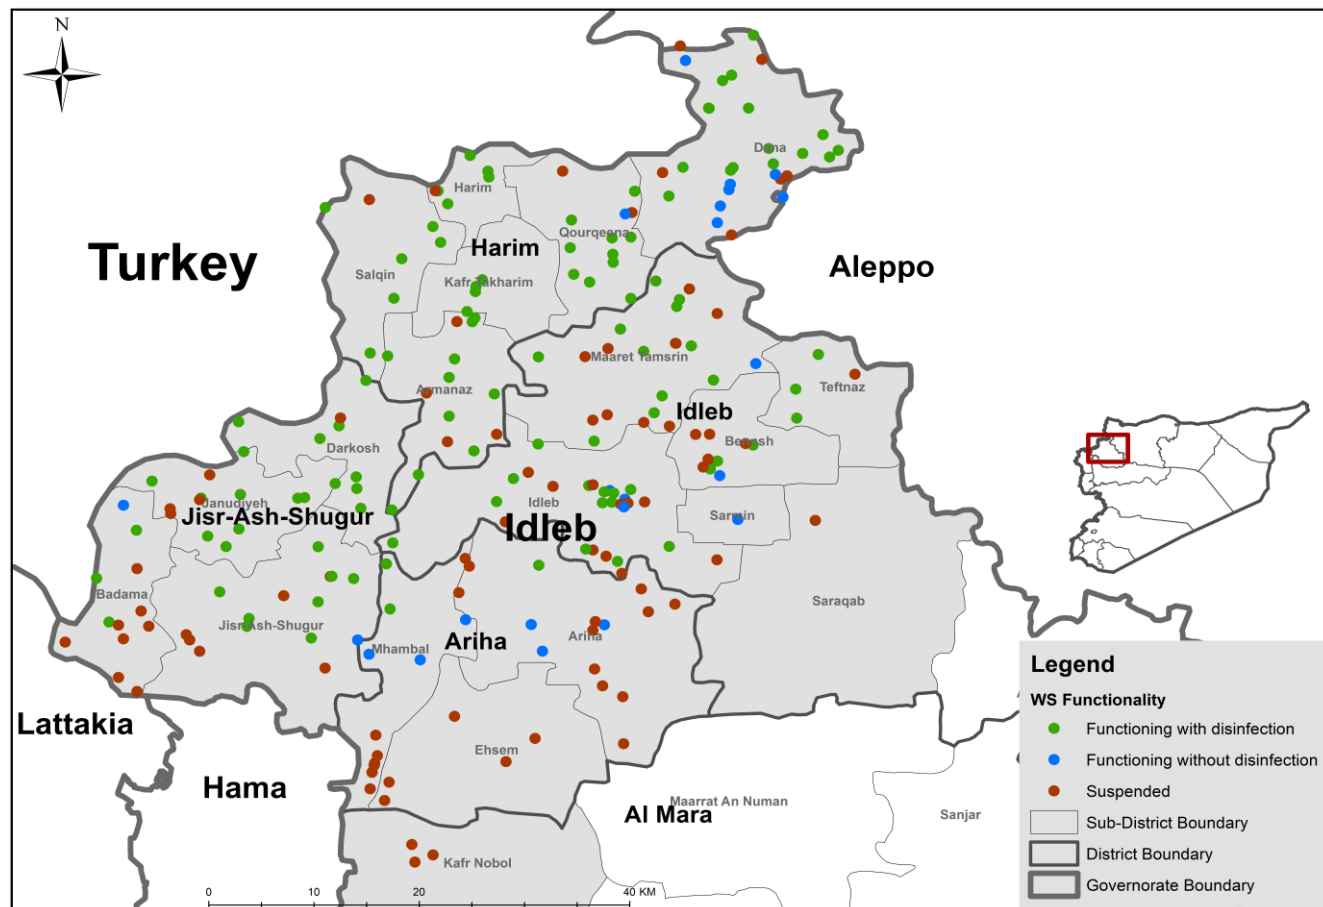


## Drinking Water Stations Distribution in Idleb (Camps Water Stations)

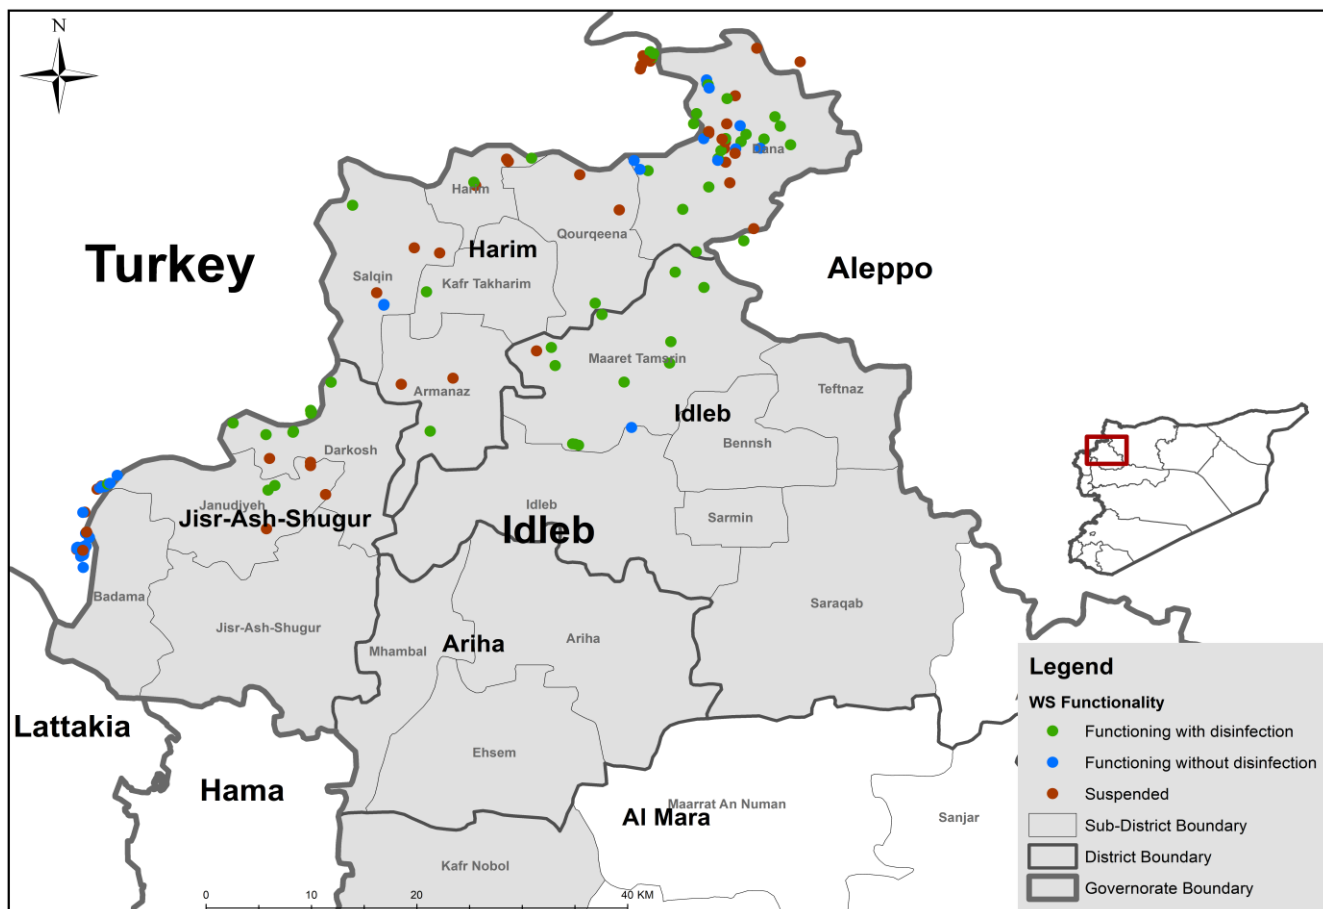


## Drinking Water Stations Distribution in Hama

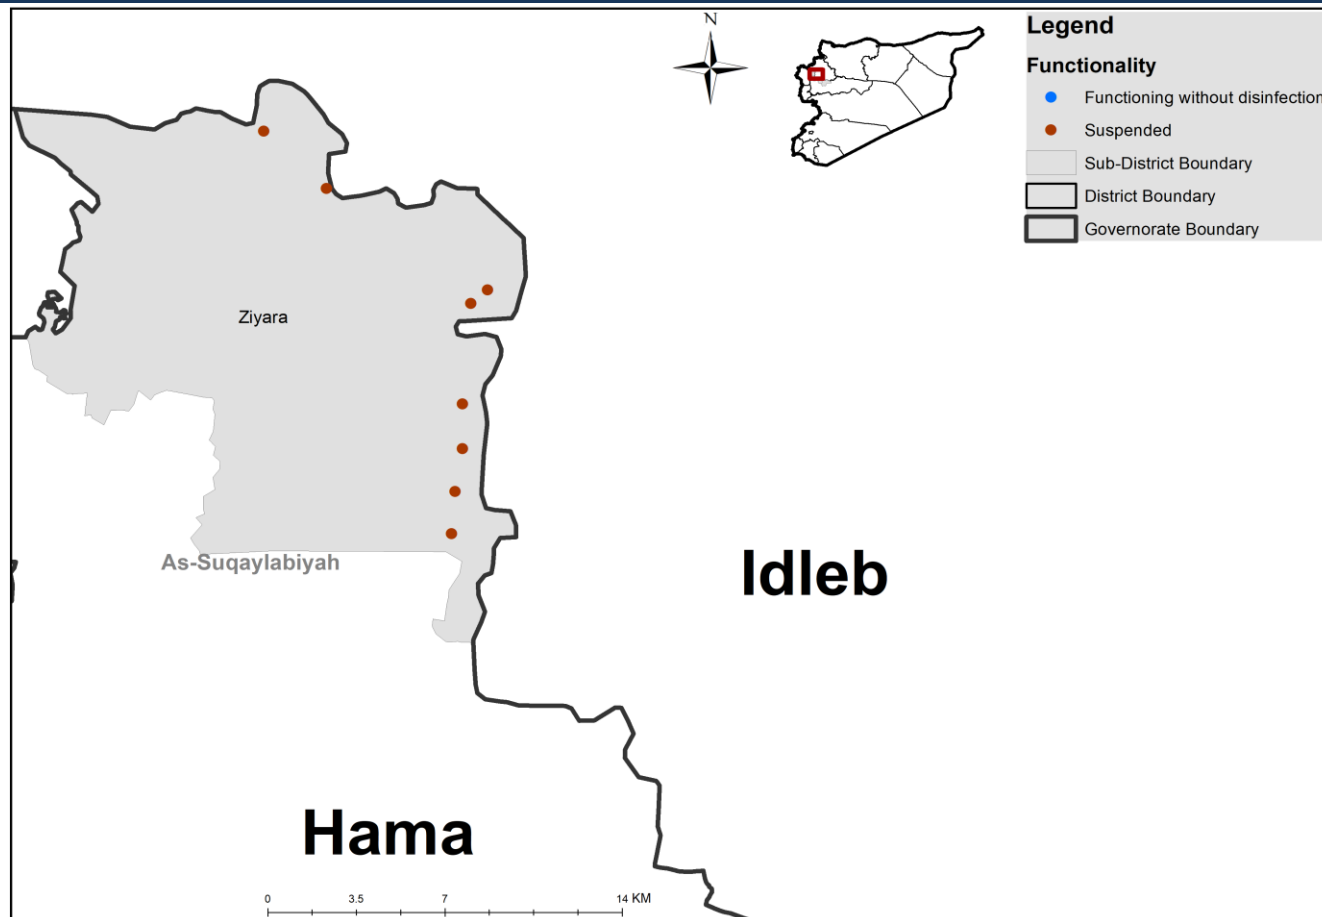

## Drinking Water Stations Distribution in Ar-raqqa

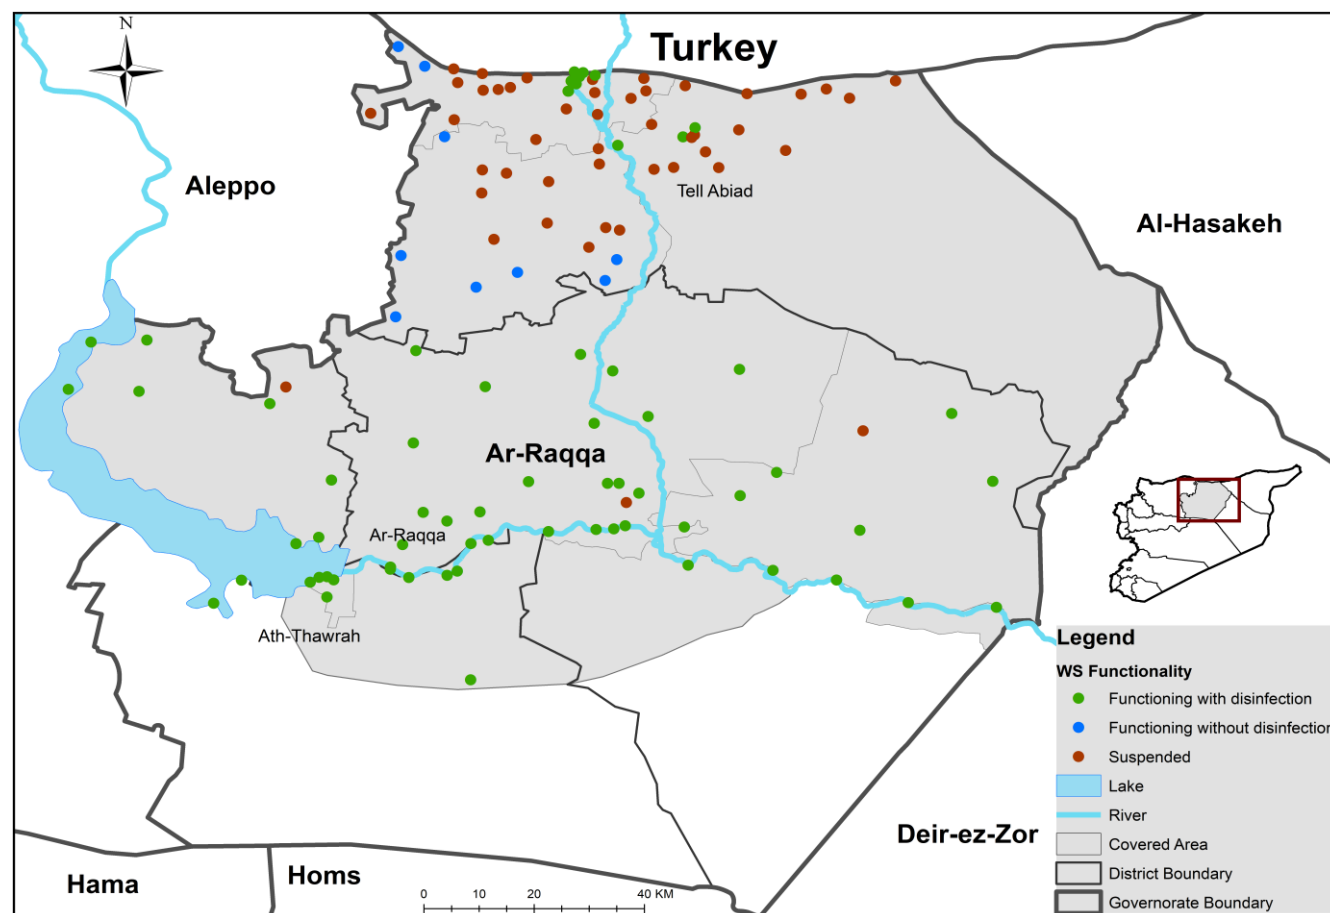

## Drinking Water Stations Distribution in Deir-ez-Zor

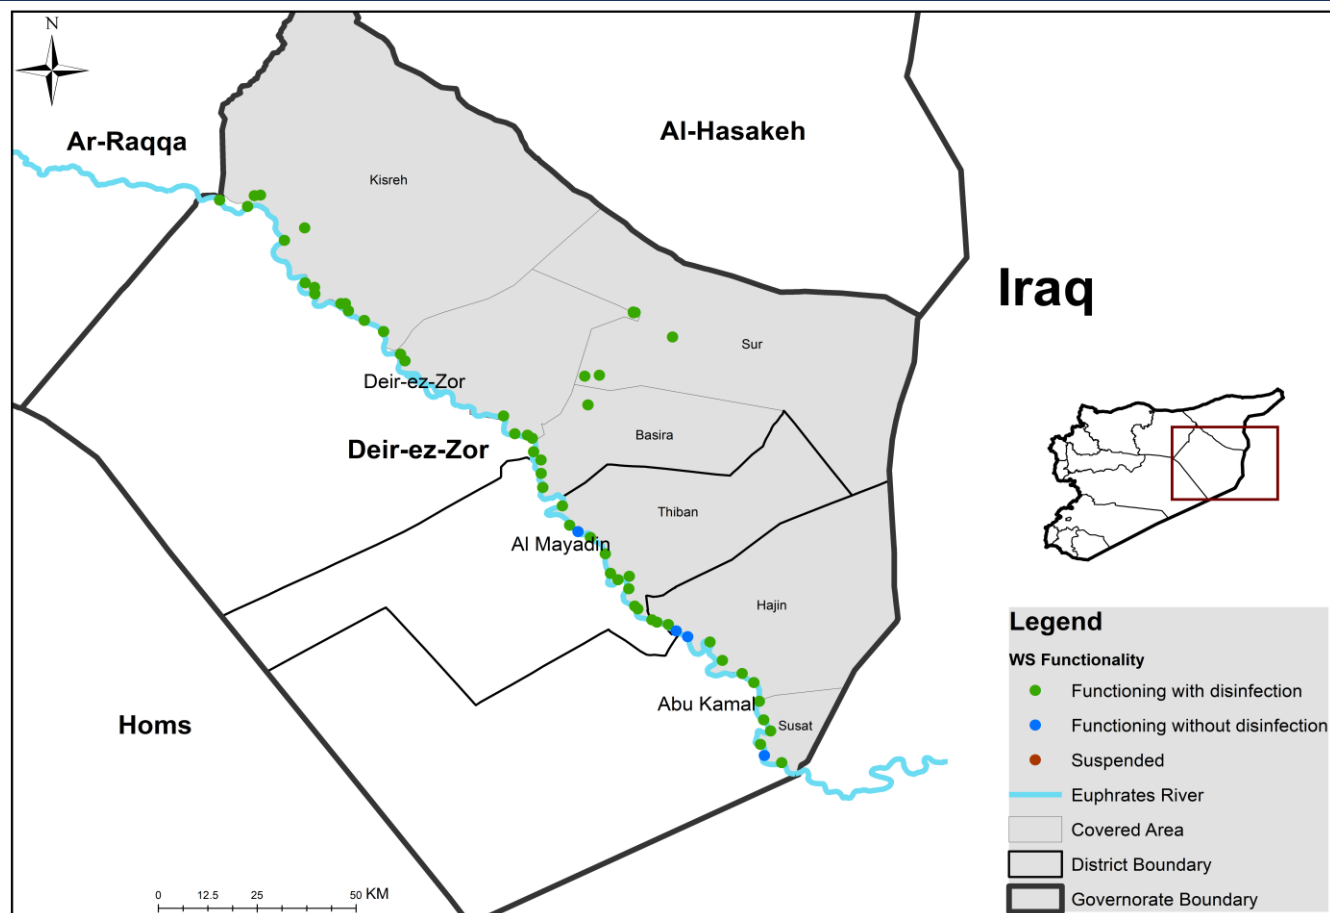

## Drinking Water Stations Distribution in Al-Hasakeh

