

## WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network


Date: 27 Mar - 9 Apr 2022

Week No. 13-14


### Highlights

- This report covers 1276 public drinking water stations monitored in 6 governorates, 1096 community-based, and 180 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 69% (877/1276) were functioning.
- The percentage of the suspended stations due to the lack of operational costs is 20%, and the percentage of the suspended stations due to the need for total-scale maintenance is 23%, of the total suspended water stations.
- Of the water stations, 37% depend on the grid and 37% depend on generators as a source of electric power.
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 57% (496/877).
- Of the functioning water stations, percentage of 88% (772/877) delivered water using a piping network, percentage of 07% (65/877) delivered water using tankering and percentage of 04% (35/877) delivered water using both, and 01% (5/877) delivered water using manhal.
- 17 water quality tests were conducted, 1 of them was biologically contaminated.

### EWARN Coverage

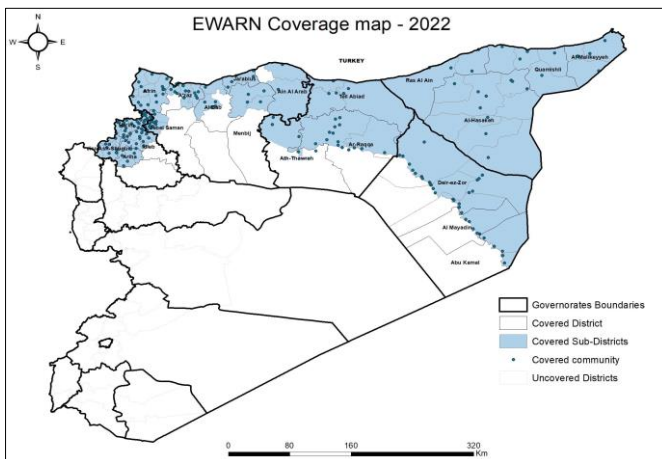


### WASH Coverage by EWARN

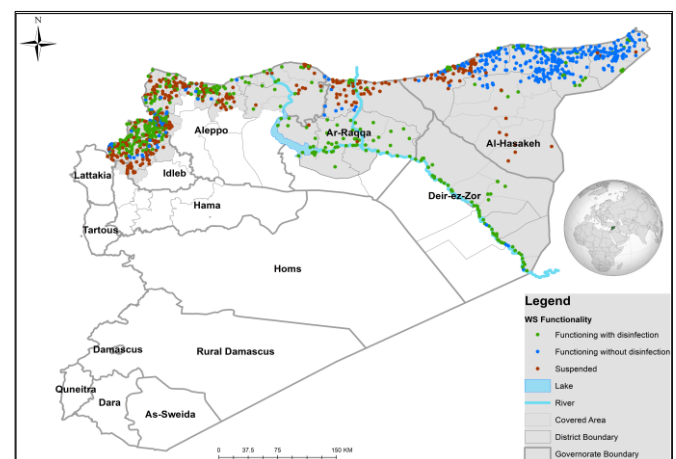

WASH covers **77** sub-districts, **23** districts in **6** governorates

### Completeness and Timeliness of Biweekly Reports

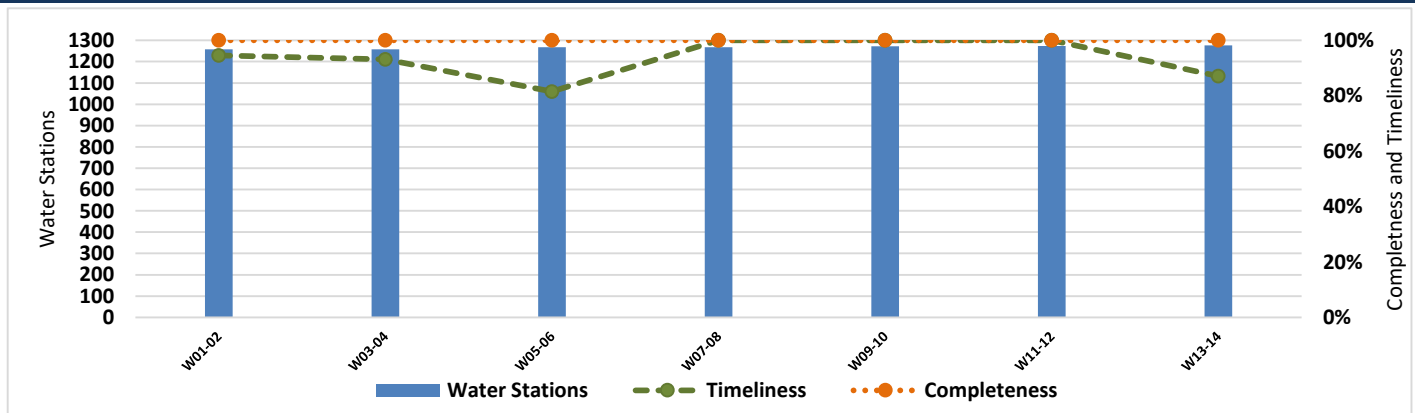


## Drinking Water Stations Status in Each Governorate

Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Non-camps)	257	135	53%
Aleppo (Camps)	41	12	29%
Idleb (Non-camps)	226	133	59%
Idleb (Camps)	139	95	68%
Hama	8	0	0%
Ar-raqqa	120	75	63%
Deir-ez-Zor	60	60	100%
Al-Hasakeh	425	367	86%
<b>Total</b>	<b>1276</b>	<b>877</b>	<b>69%</b>


Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Non-camps)	135	120	89%
Aleppo (Camps)	12	5	42%
Idleb (Non-camps)	133	111	83%
Idleb (Camps)	95	53	56%
Hama	0	0	0%
Ar-raqqa	75	66	88%
Deir-ez-Zor	60	56	93%
Al-Hasakeh	367	85	23%
<b>Total</b>	<b>877</b>	<b>496</b>	<b>57%</b>

## Drinking Water Stations Status


Drinking Water Stations Status

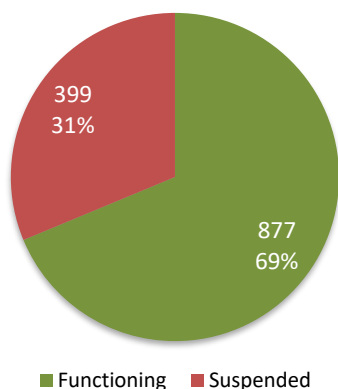

Functioning DWS Chlorination Status

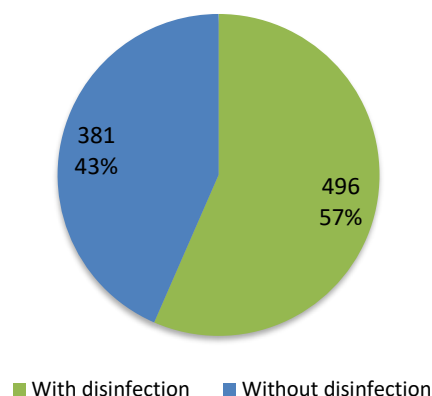


## Drinking Water Stations Status in Governorates

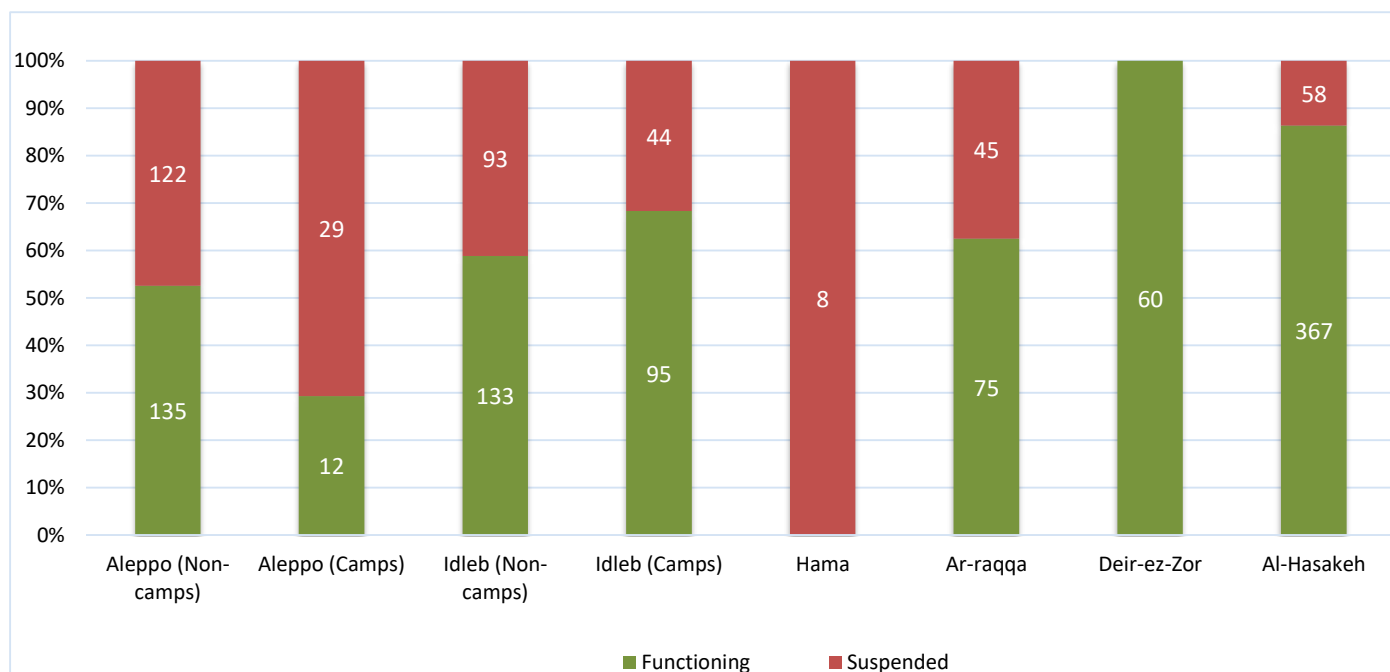


## The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	30	35	3	8	23	39	8	5
Idleb	13	46	0	11	14	39	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	27	0	0	2	6	2	8	0
Deir-ez-Zor	0	0	0	0	0	0	0	0
Al-Hasakeh	19	0	2	1	3	10	21	2
<b>Total</b>	<b>89</b>	<b>81</b>	<b>5</b>	<b>22</b>	<b>46</b>	<b>90</b>	<b>56</b>	<b>10</b>

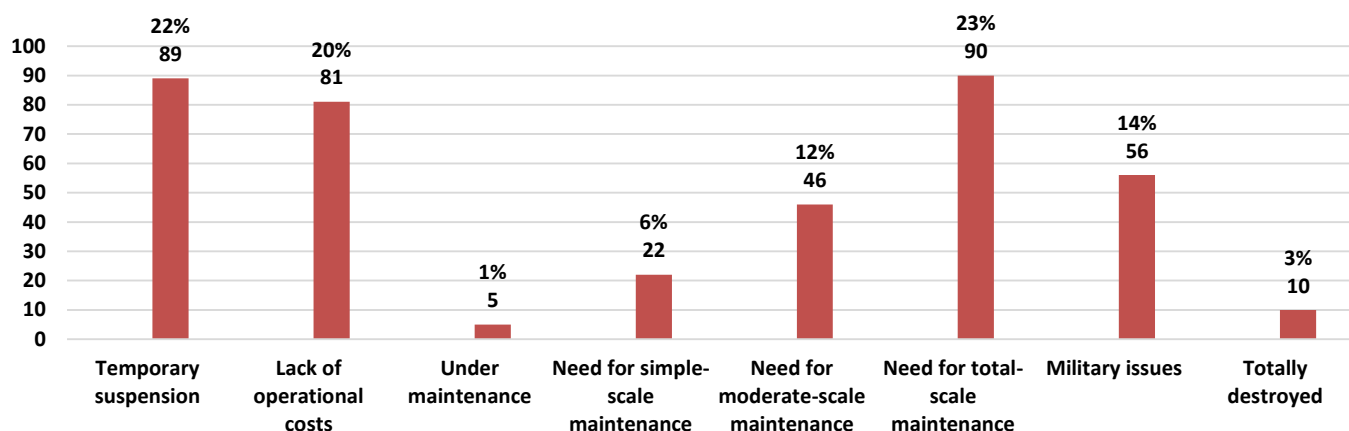


## Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	22	180	13	50	0	24	9
Idleb	12	262	33	20	4	33	1
Hama	0	8	0	0	0	0	0
Ar-raqqa	81	2	0	37	0	0	0
Deir-ez-Zor	0	12	0	48	0	0	0
Al-Hasakeh	358	2	0	64	0	0	1
<b>Total</b>	<b>473</b>	<b>466</b>	<b>46</b>	<b>219</b>	<b>4</b>	<b>57</b>	<b>11</b>

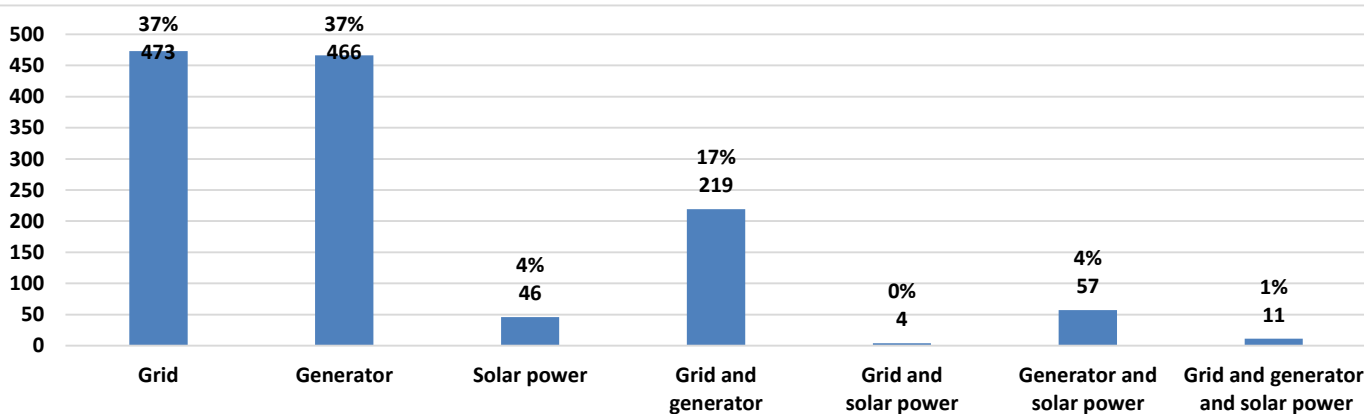


## Functioning Drinking Water Stations Chlorination Status

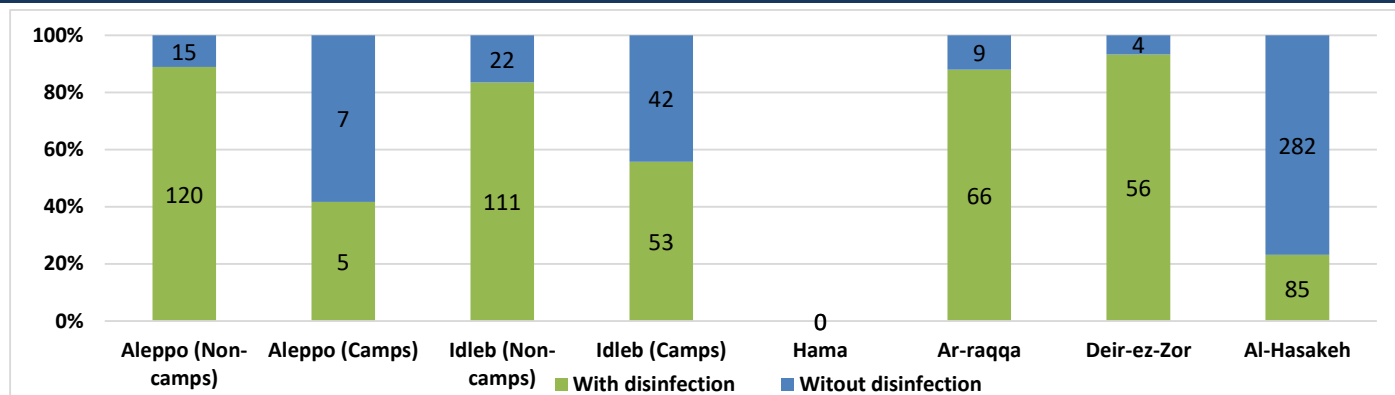

## The Reason for not Chlorination

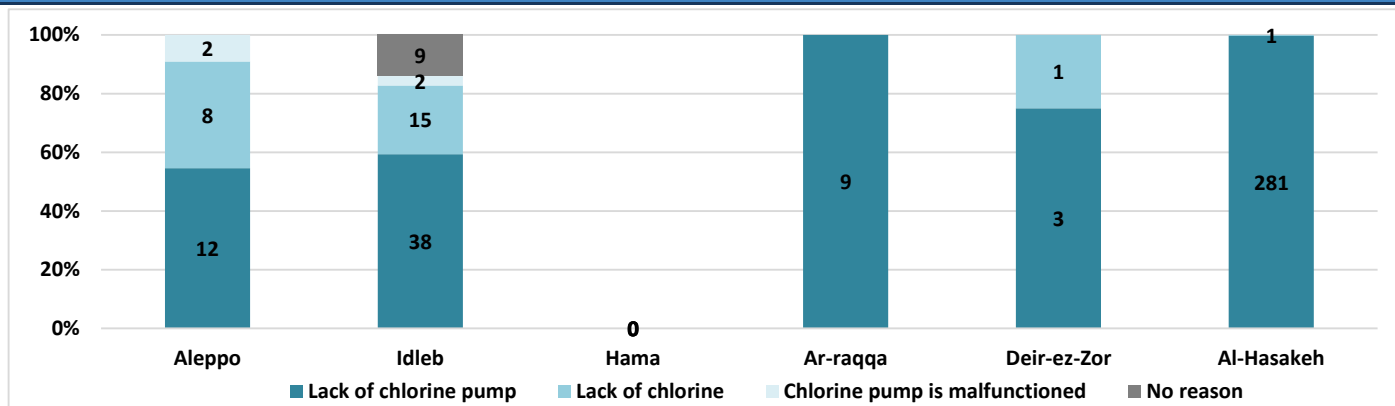


## Chlorination Status Over Weeks

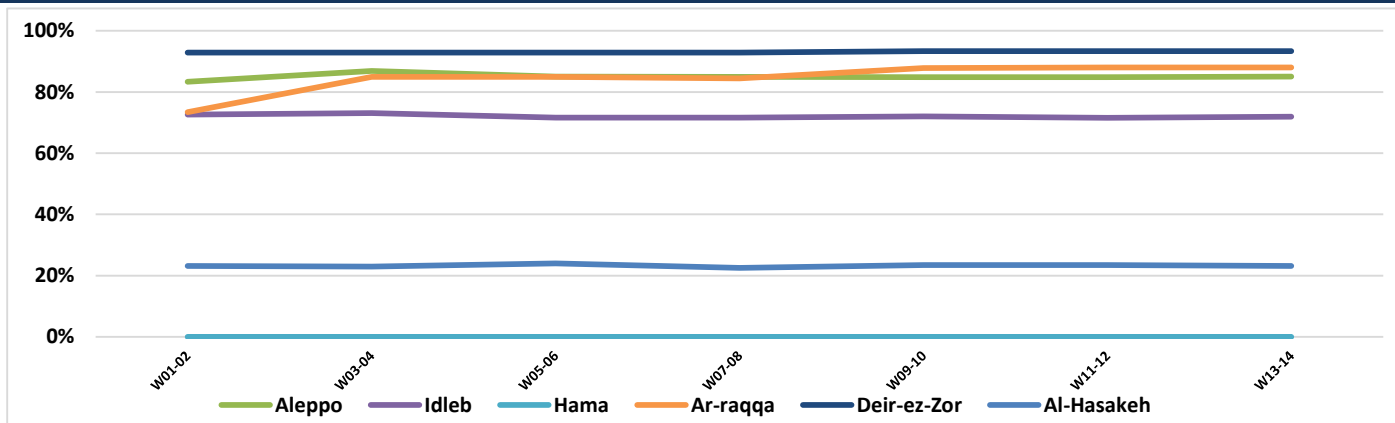


## Connection Method

Governorate	Functioning DWS	Method			
		Network	Tankering	Both	Manhal
Aleppo	147	126	3	13	5
Idleb	228	152	56	20	0
Hama	0	0	0	0	0
Ar-raqqa	75	72	2	1	0
Deir-ez-Zor	60	56	4	0	0
Al-Hasakeh	367	366	0	1	0
<b>Total</b>	<b>877</b>	<b>772</b>	<b>65</b>	<b>35</b>	<b>5</b>


### Connection Method

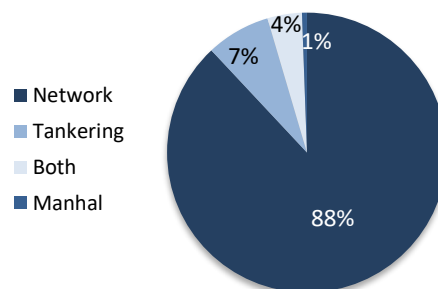


## Drinking Water Stations Distribution in Aleppo (Non-camps Water Stations)

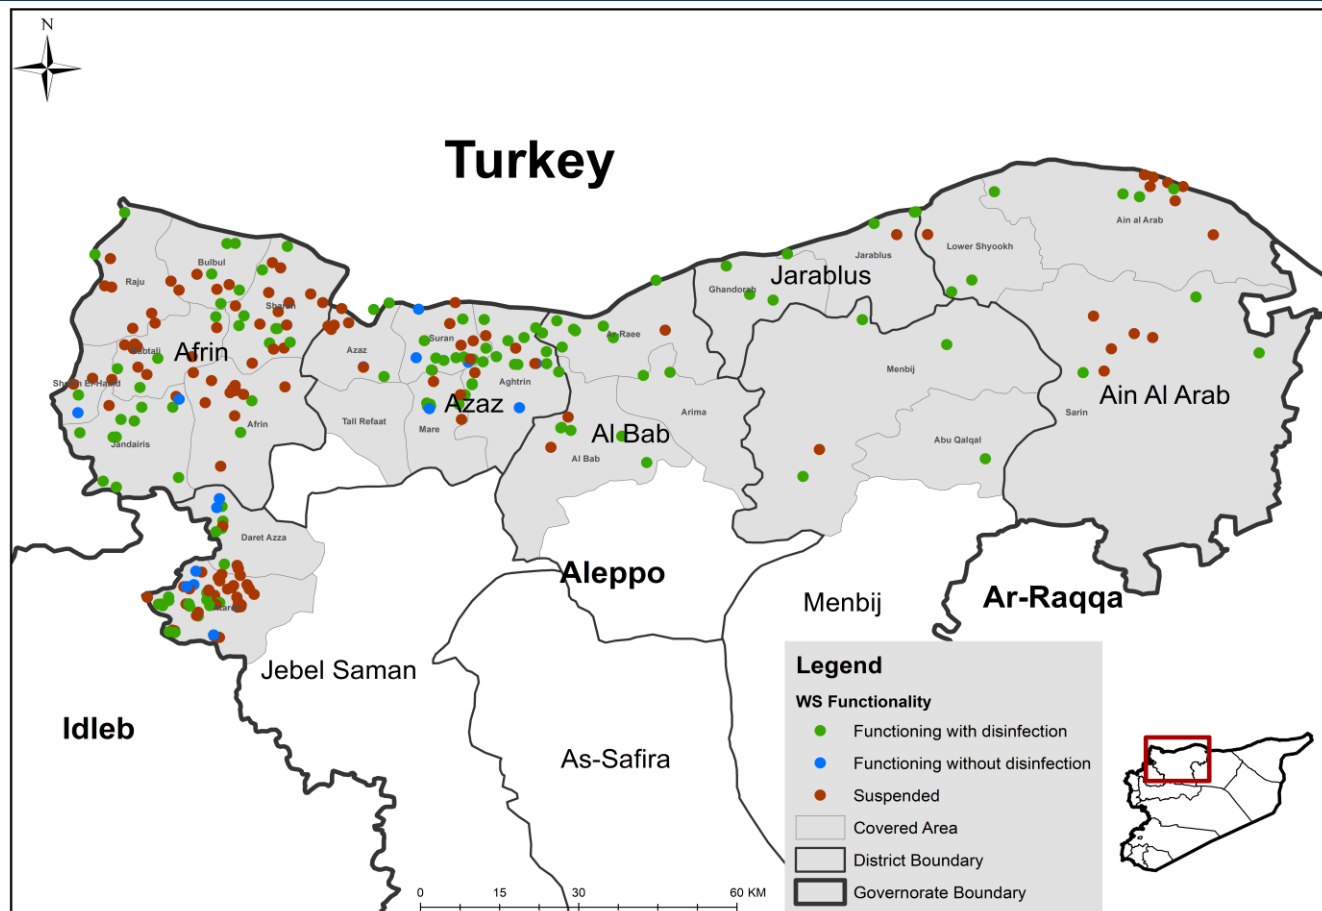


## Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

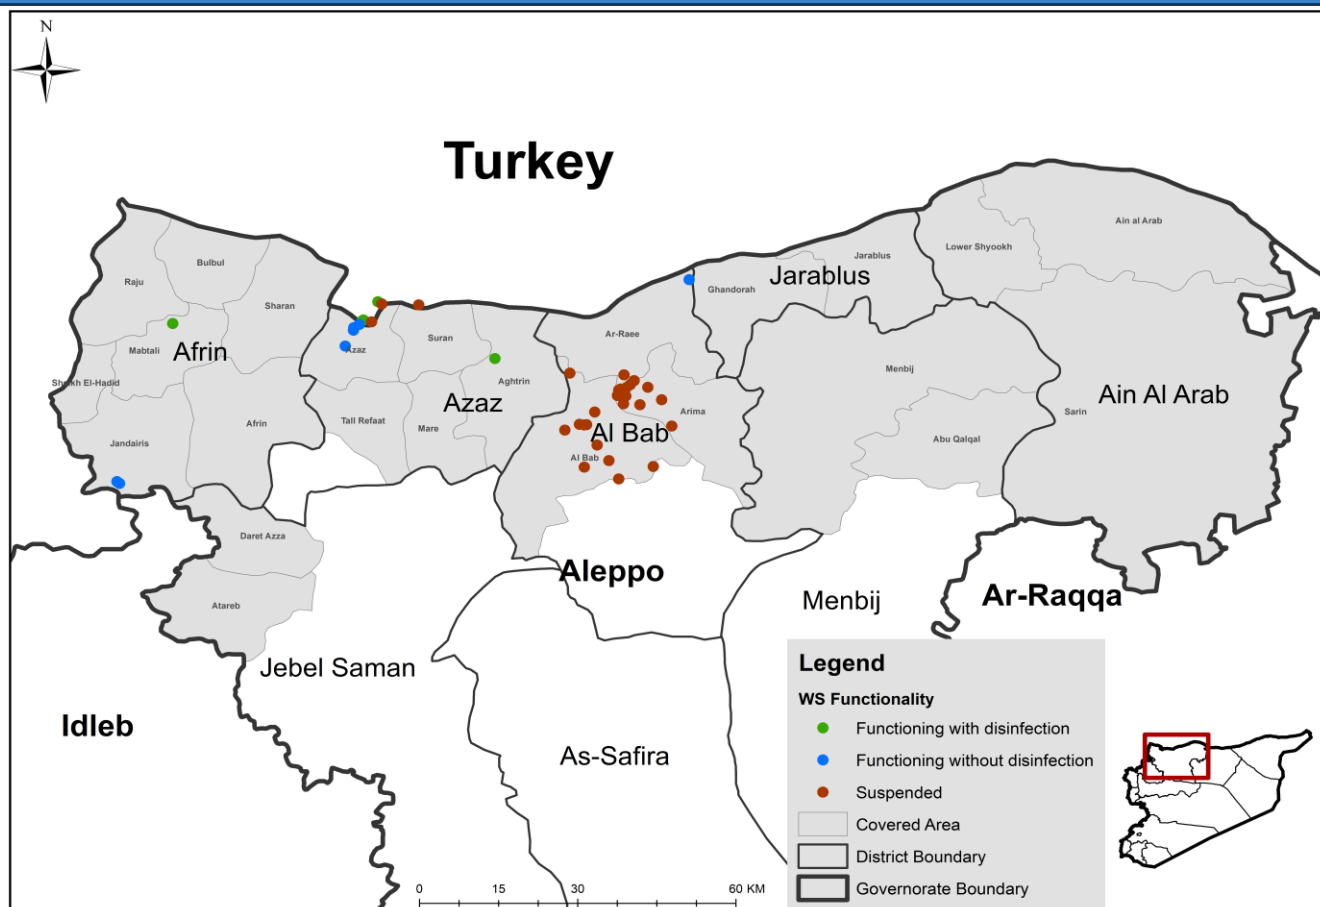


## Drinking Water Stations Distribution in Idleb (Non-camps Water Stations)

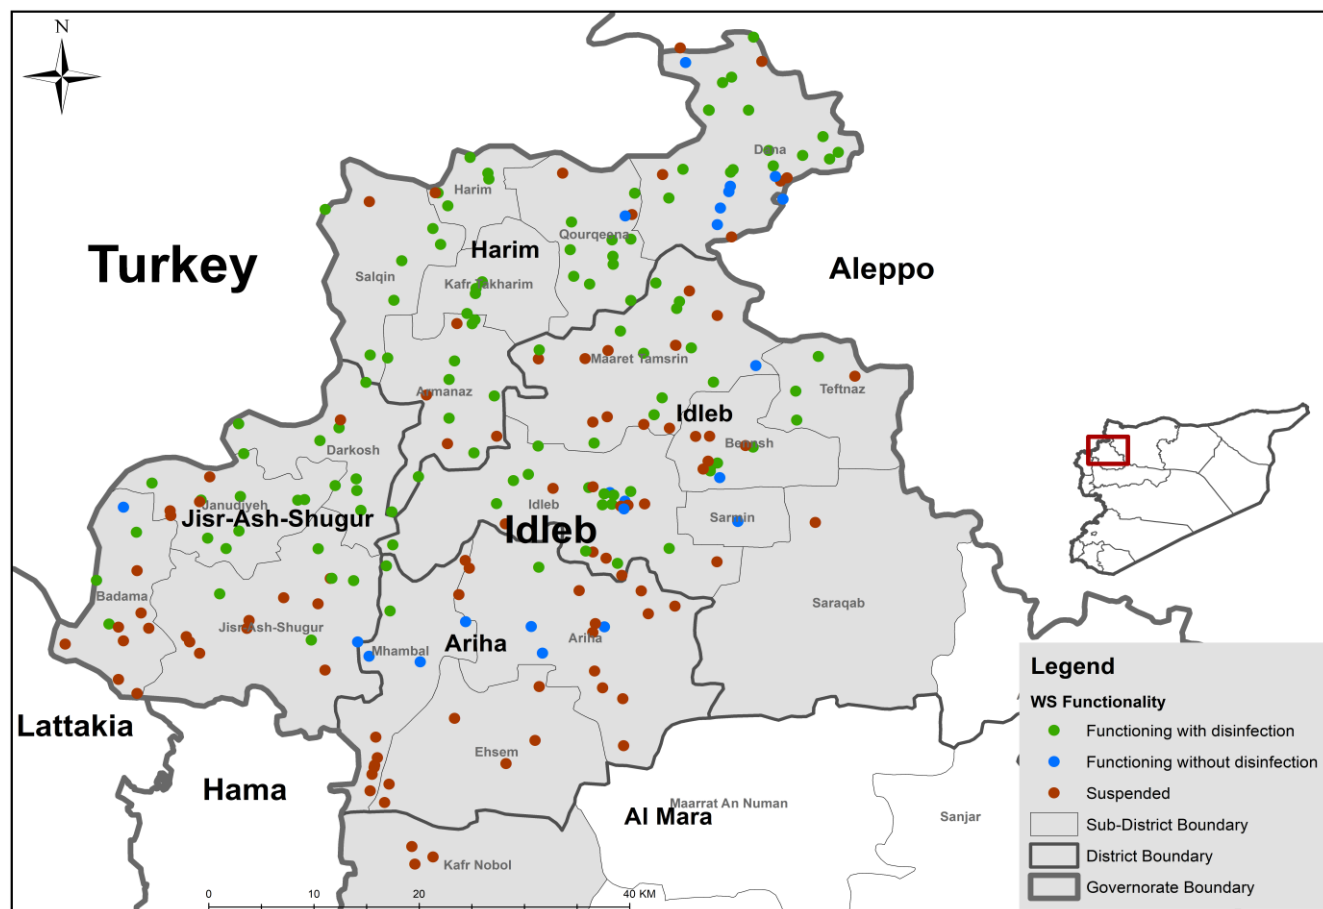


## Drinking Water Stations Distribution in Idleb (Camps Water Stations)

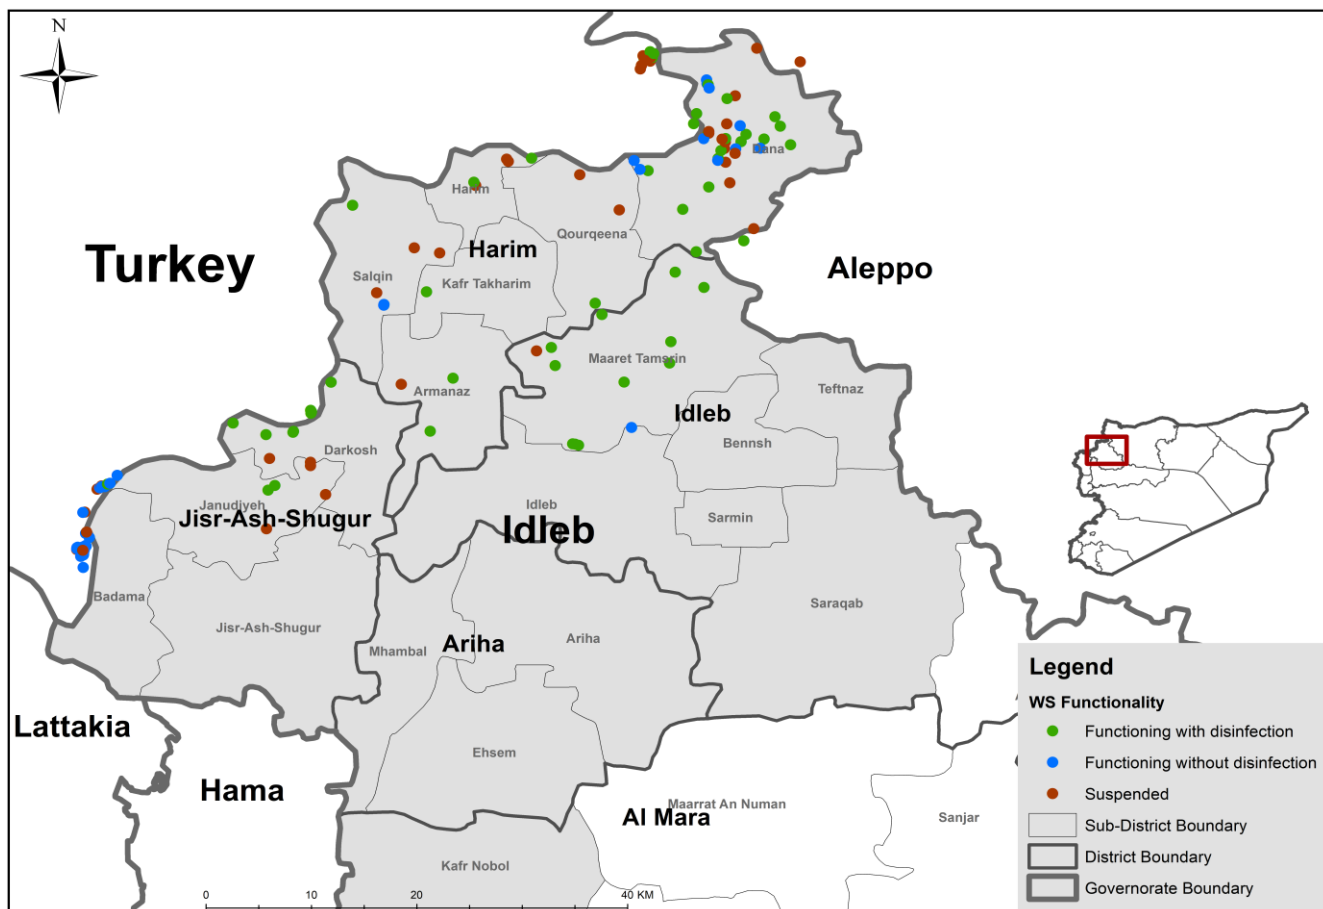


## Drinking Water Stations Distribution in Hama

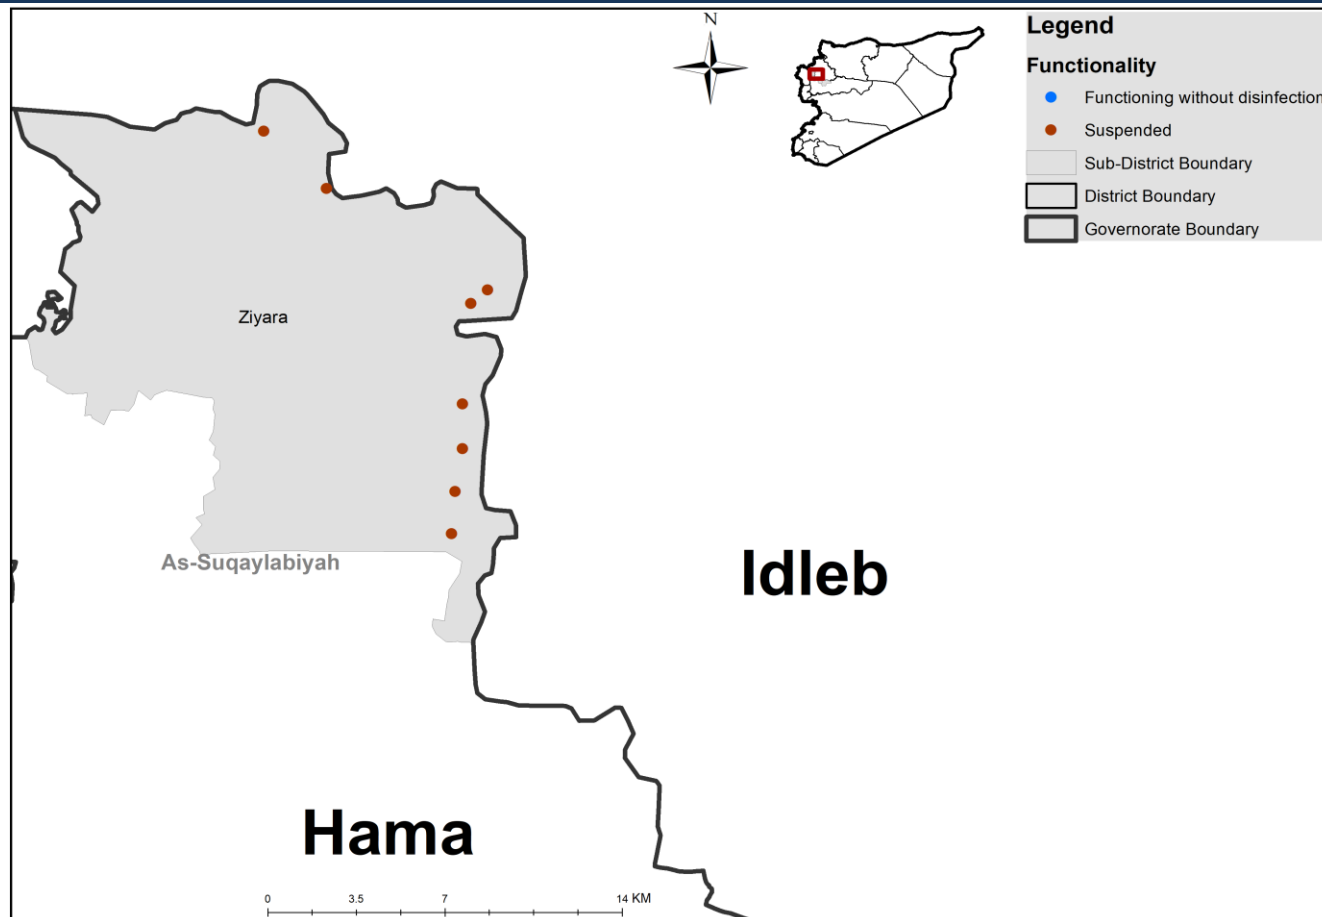

## Drinking Water Stations Distribution in Ar-raqqa

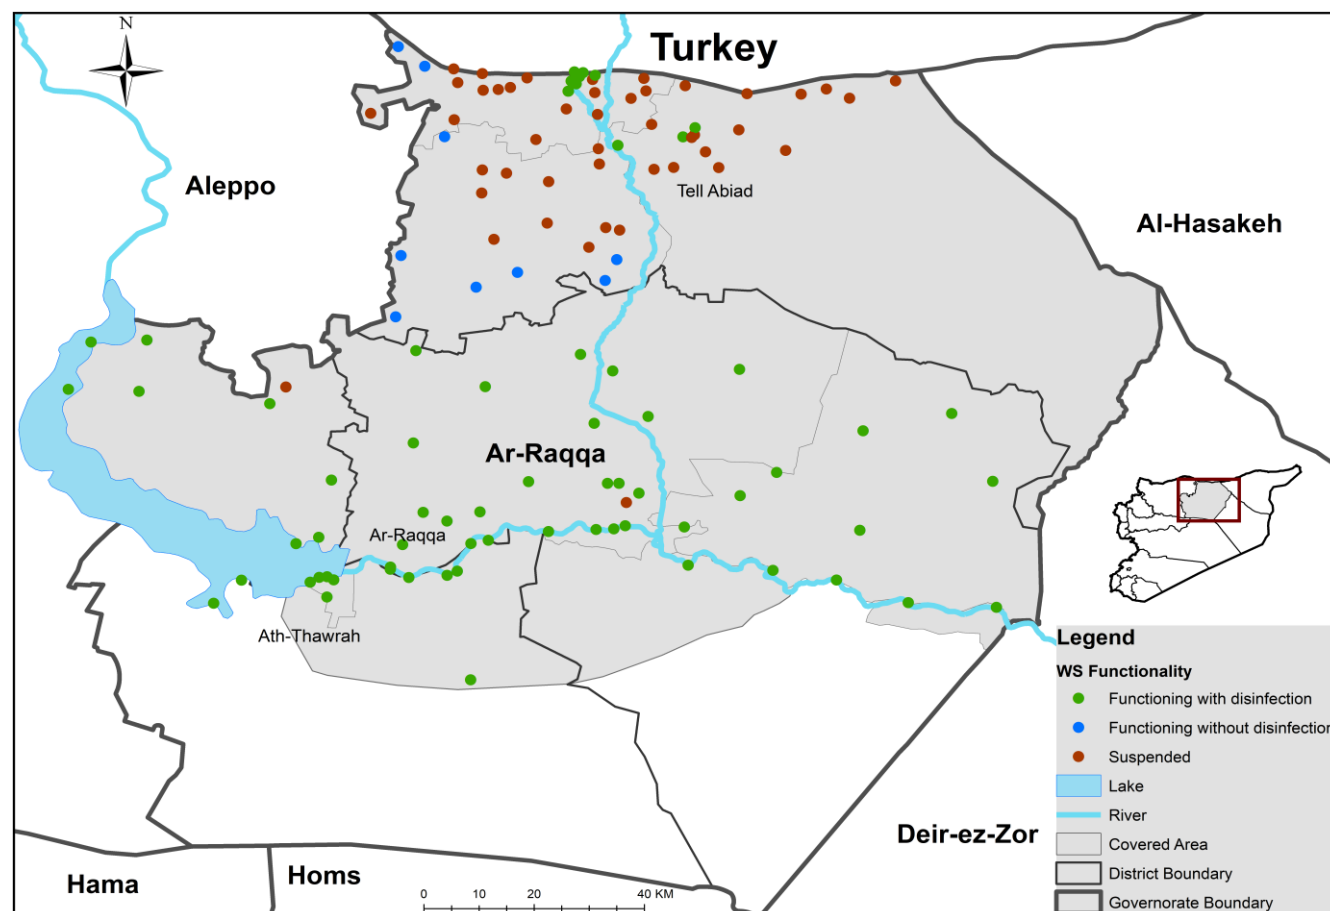

## Drinking Water Stations Distribution in Deir-ez-Zor

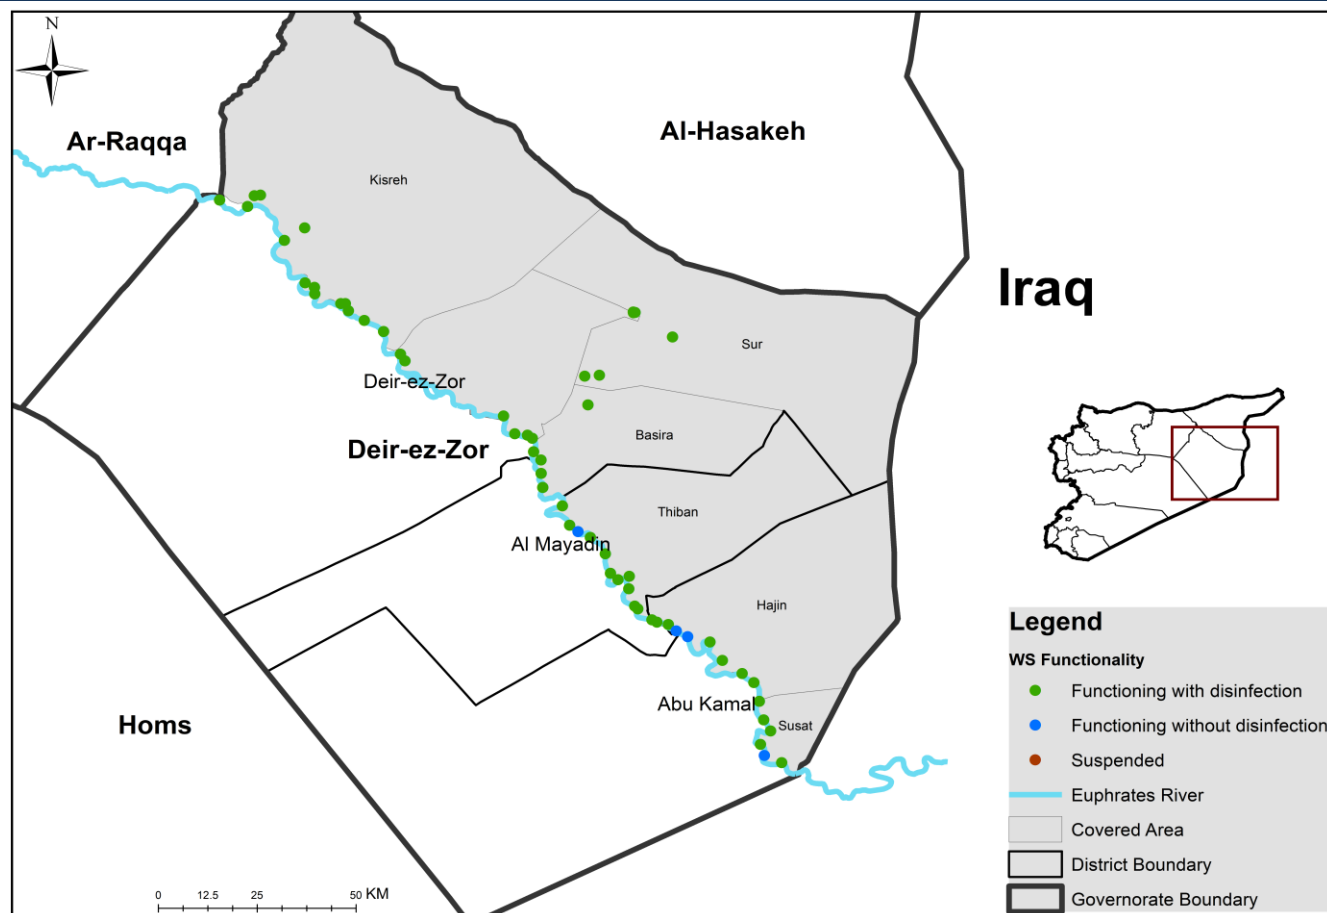

## Drinking Water Stations Distribution in Al-Hasakeh

