

WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network


Date: 22 May - 4 Jun 2022

Week No. 21-22


Highlights

- This report covers 1279 public drinking water stations monitored in 6 governorates, 1096 community-based, and 183 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 67% (862/1279) were functioning.
- The percentage of the suspended stations due to the lack of operational costs is 21%, and the percentage of the suspended stations due to the need for total-scale maintenance is 21%, of the total suspended water stations.
- Of the water stations, 37% depend on the grid and 37% depend on generators as a source of electric power.
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 55% (478/862).
- Of the functioning water stations, percentage of 88% (758/862) delivered water using a piping network, percentage of 07% (65/862) delivered water using tankering and percentage of 04% (34/862) delivered water using both, and 01% (5/862) delivered water using manhal.
- 12 water quality tests were conducted, 3 of them were contaminated.

EWARN Coverage

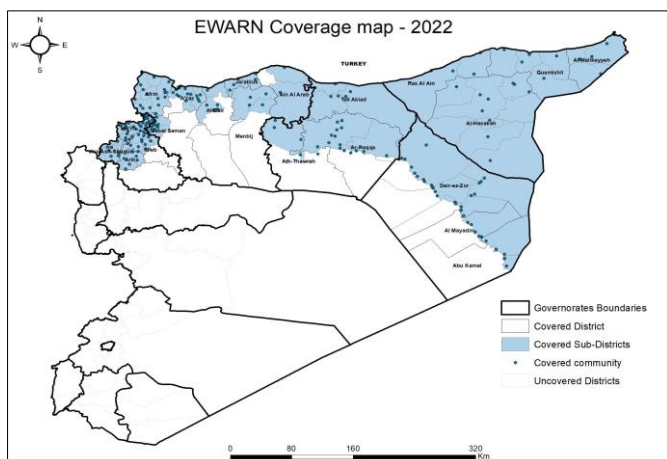


WASH Coverage by EWARN

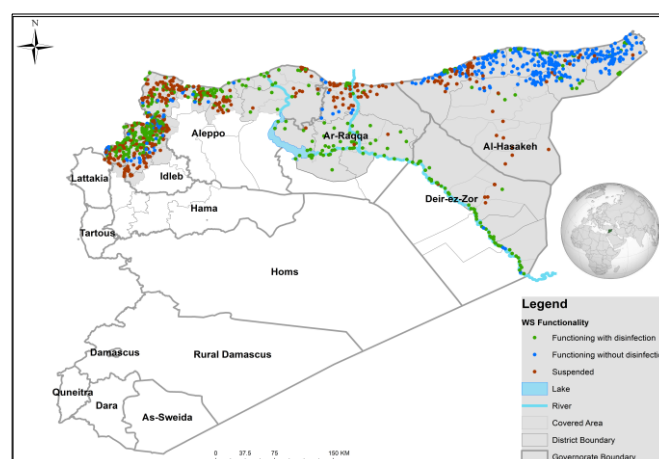

WASH covers 77 sub-districts, 23 districts in 6 governorates

Completeness and Timeliness of Biweekly Reports

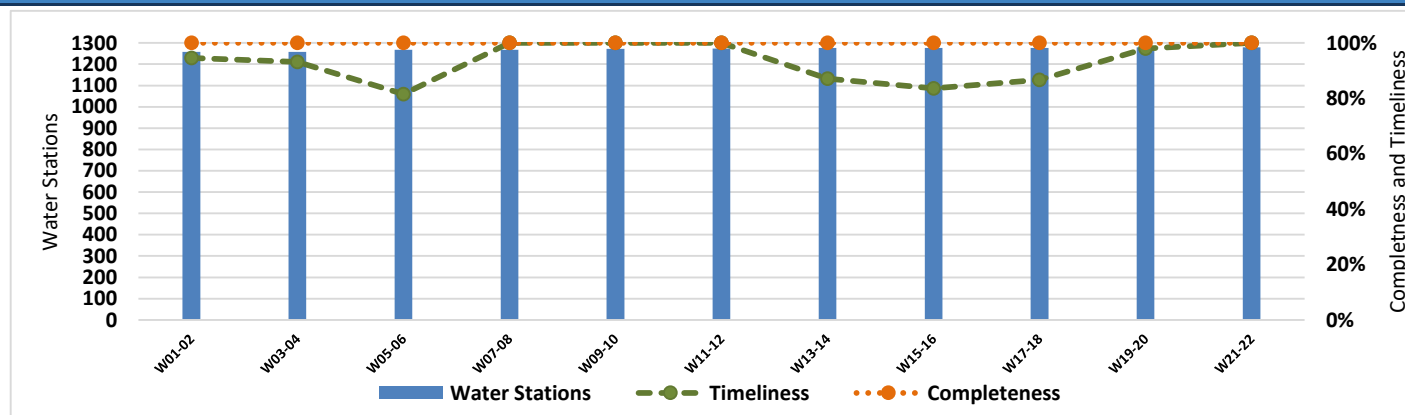


Drinking Water Stations Status in Each Governorate

Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Non-camps)	257	124	48%
Aleppo (Camps)	44	14	32%
Idleb (Non-camps)	226	138	61%
Idleb (Camps)	139	95	68%
Hama	8	0	0%
Ar-raqqa	120	74	62%
Deir-ez-Zor	60	52	87%
Al-Hasakeh	425	365	86%
Total	1279	862	67%


Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Non-camps)	124	109	88%
Aleppo (Camps)	14	5	36%
Idleb (Non-camps)	138	113	82%
Idleb (Camps)	95	53	56%
Hama	0	0	0%
Ar-raqqa	74	65	88%
Deir-ez-Zor	52	48	92%
Al-Hasakeh	365	85	23%
Total	862	478	55%

Drinking Water Stations Status


Drinking Water Stations Status

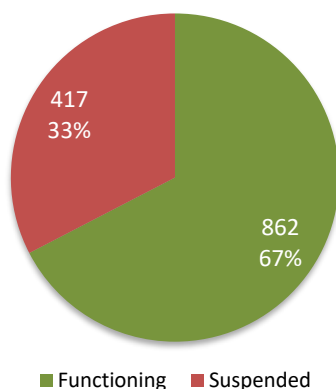

Functioning DWS Chlorination Status

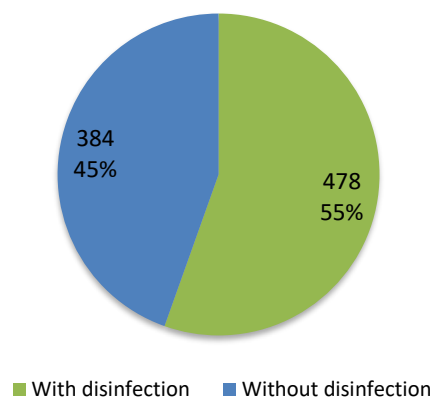


Drinking Water Stations Status in Governorates

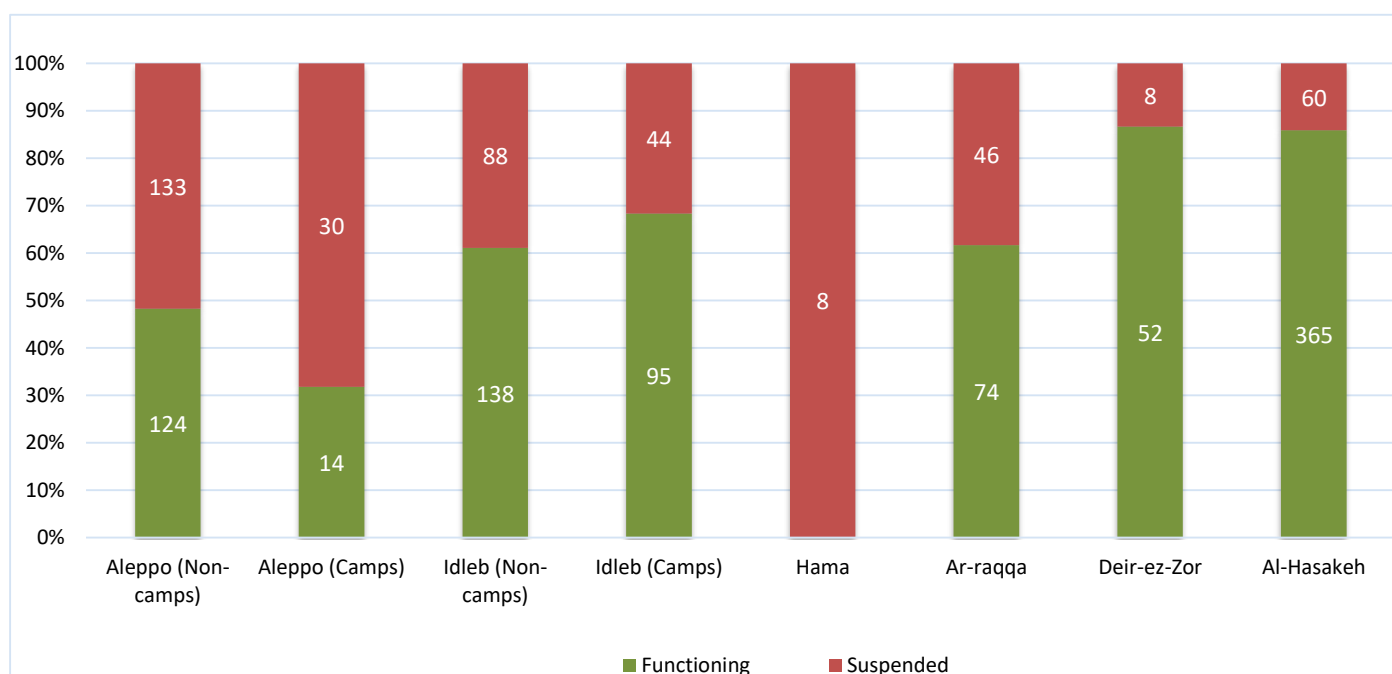


The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	35	41	2	9	24	39	8	5
Idleb	14	44	1	11	12	36	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	28	0	0	2	6	2	8	0
Deir-ez-Zor	8	0	0	0	0	0	0	0
Al-Hasakeh	14	4	1	4	3	10	22	2
Total	99	89	4	26	45	87	57	10

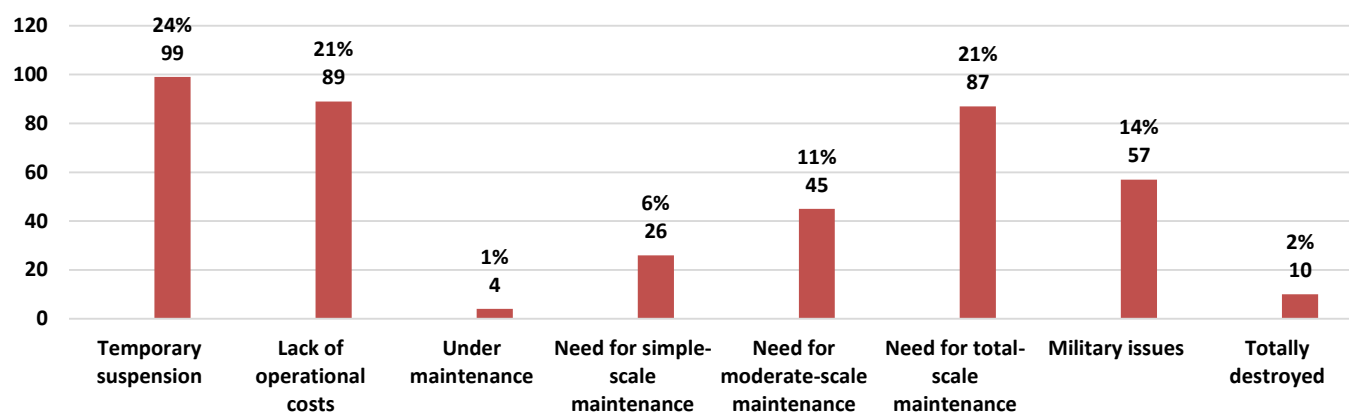


Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	22	183	13	48	0	25	10
Idleb	12	260	33	20	4	35	1
Hama	0	8	0	0	0	0	0
Ar-raqqa	81	2	0	37	0	0	0
Deir-ez-Zor	0	12	0	48	0	0	0
Al-Hasakeh	357	2	0	65	0	0	1
Total	472	467	46	218	4	60	12

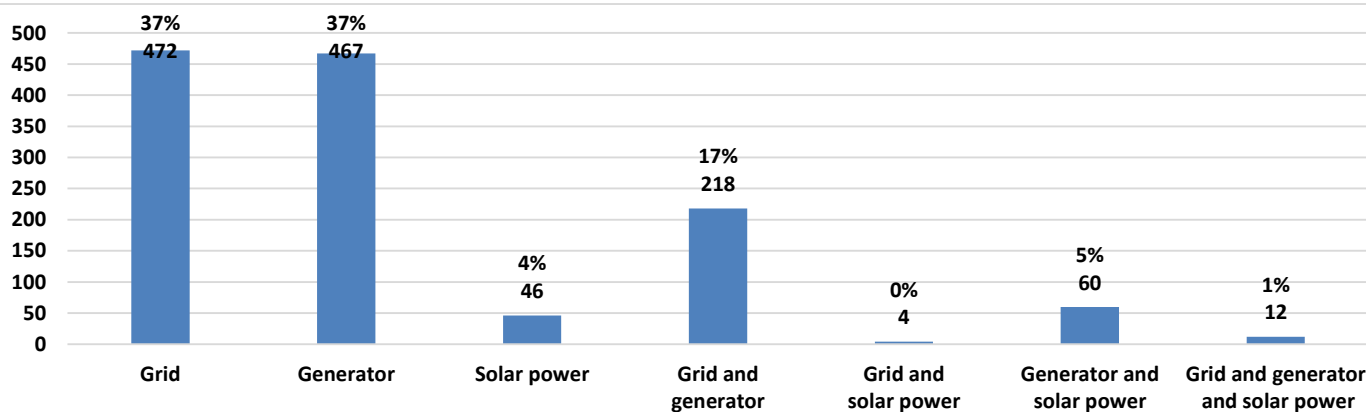


Functioning Drinking Water Stations Chlorination Status

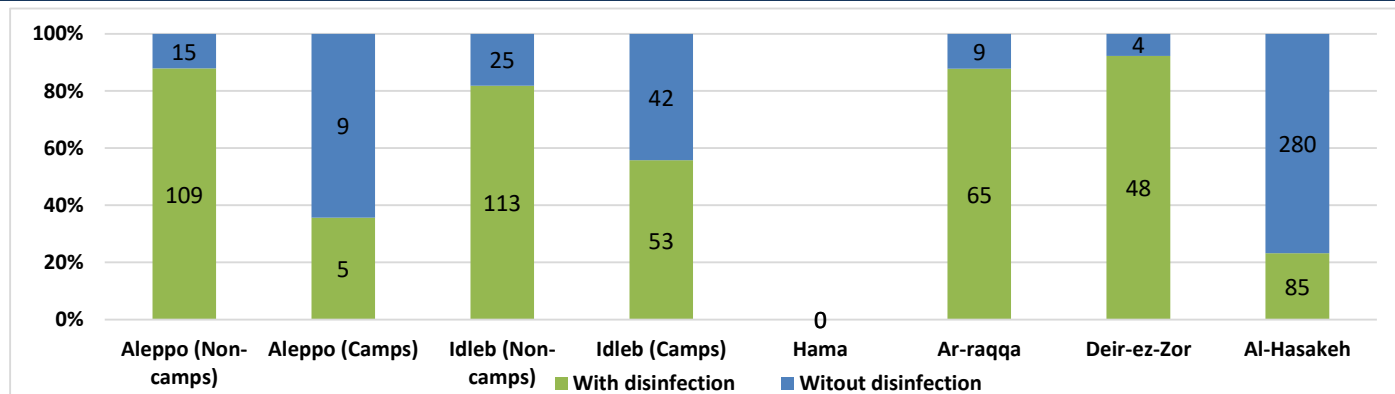

The Reason for not Chlorination

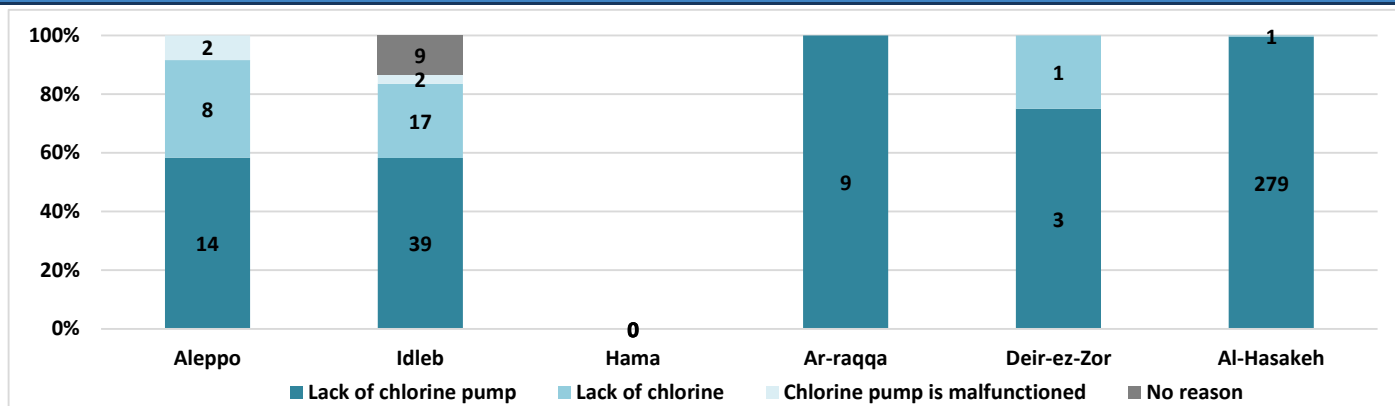


Chlorination Status Over Weeks

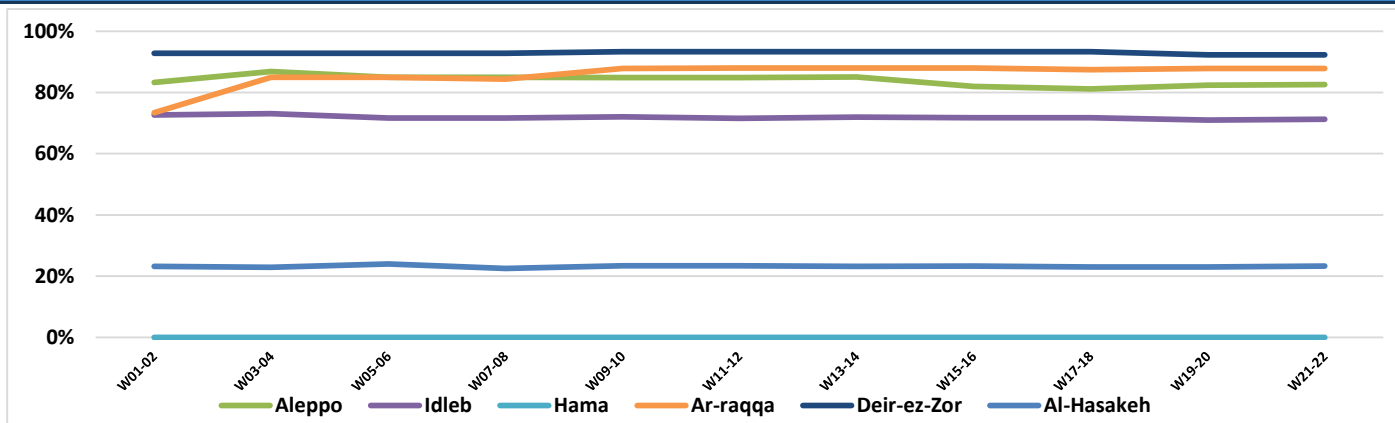


Connection Method

Governorate	Functioning DWS	Method			
		Network	Tankering	Both	Manhal
Aleppo	138	116	5	12	5
Idleb	233	154	58	21	0
Hama	0	0	0	0	0
Ar-raqqa	74	72	2	0	0
Deir-ez-Zor	52	52	0	0	0
Al-Hasakeh	365	364	0	1	0
Total	862	758	65	34	5


Connection Method

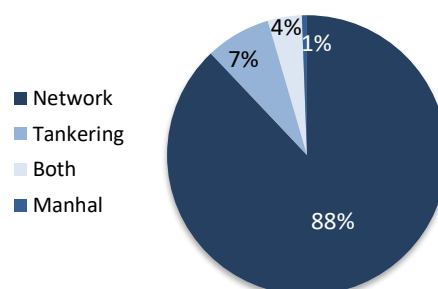


Drinking Water Stations Distribution in Aleppo (Non-camps Water Stations)

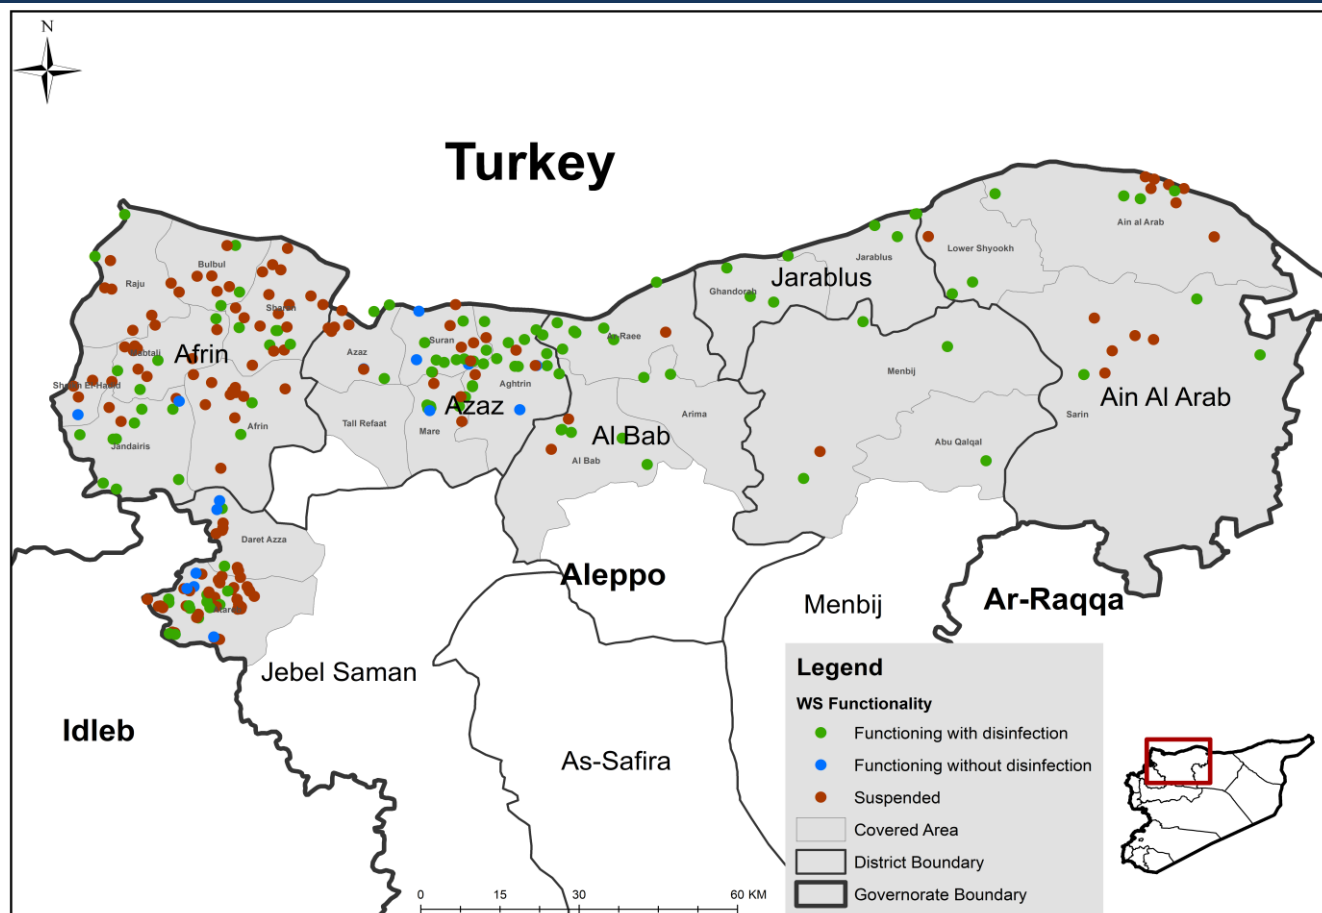


Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

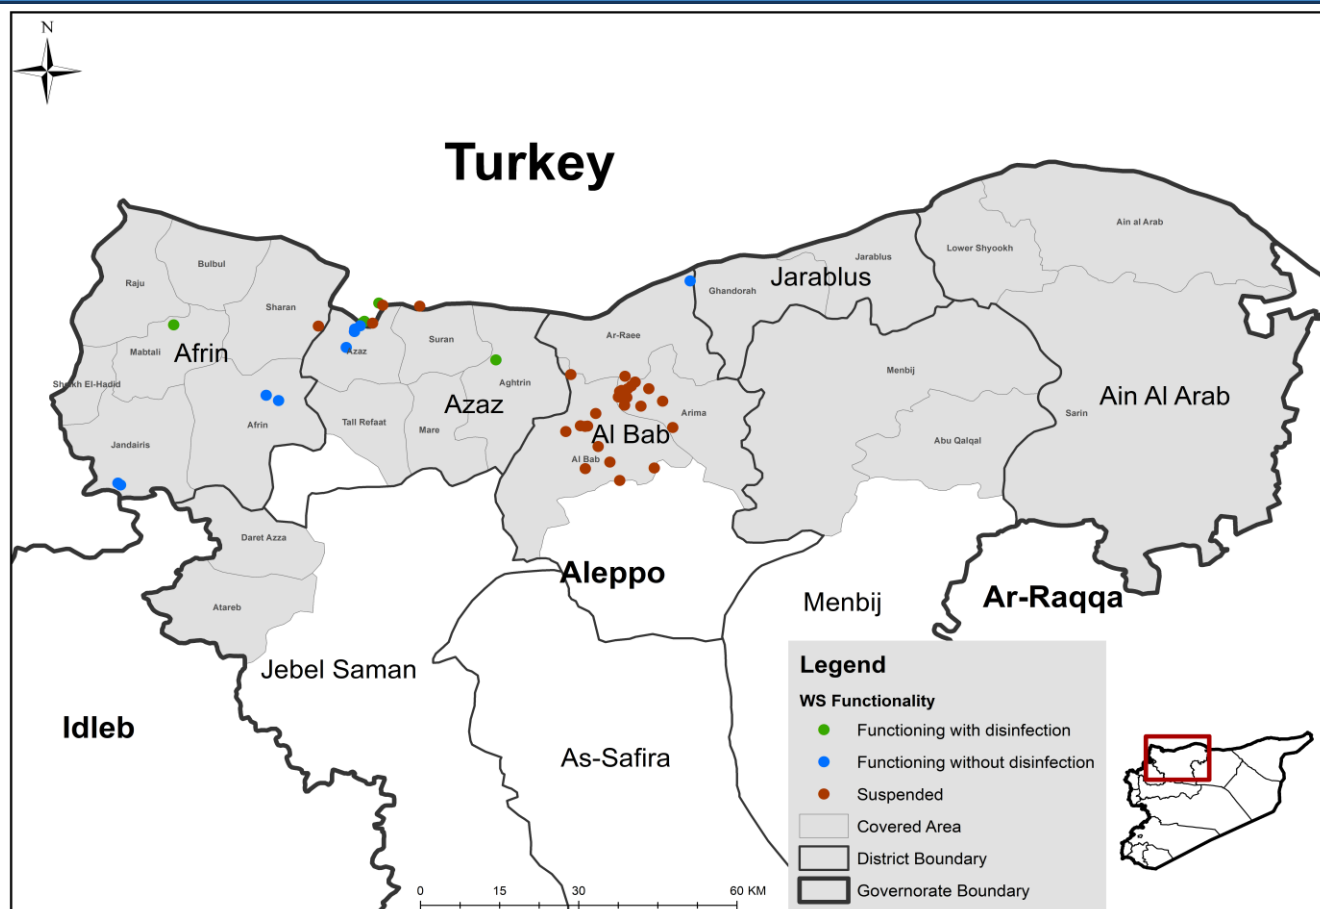


Drinking Water Stations Distribution in Idleb (Non-camps Water Stations)

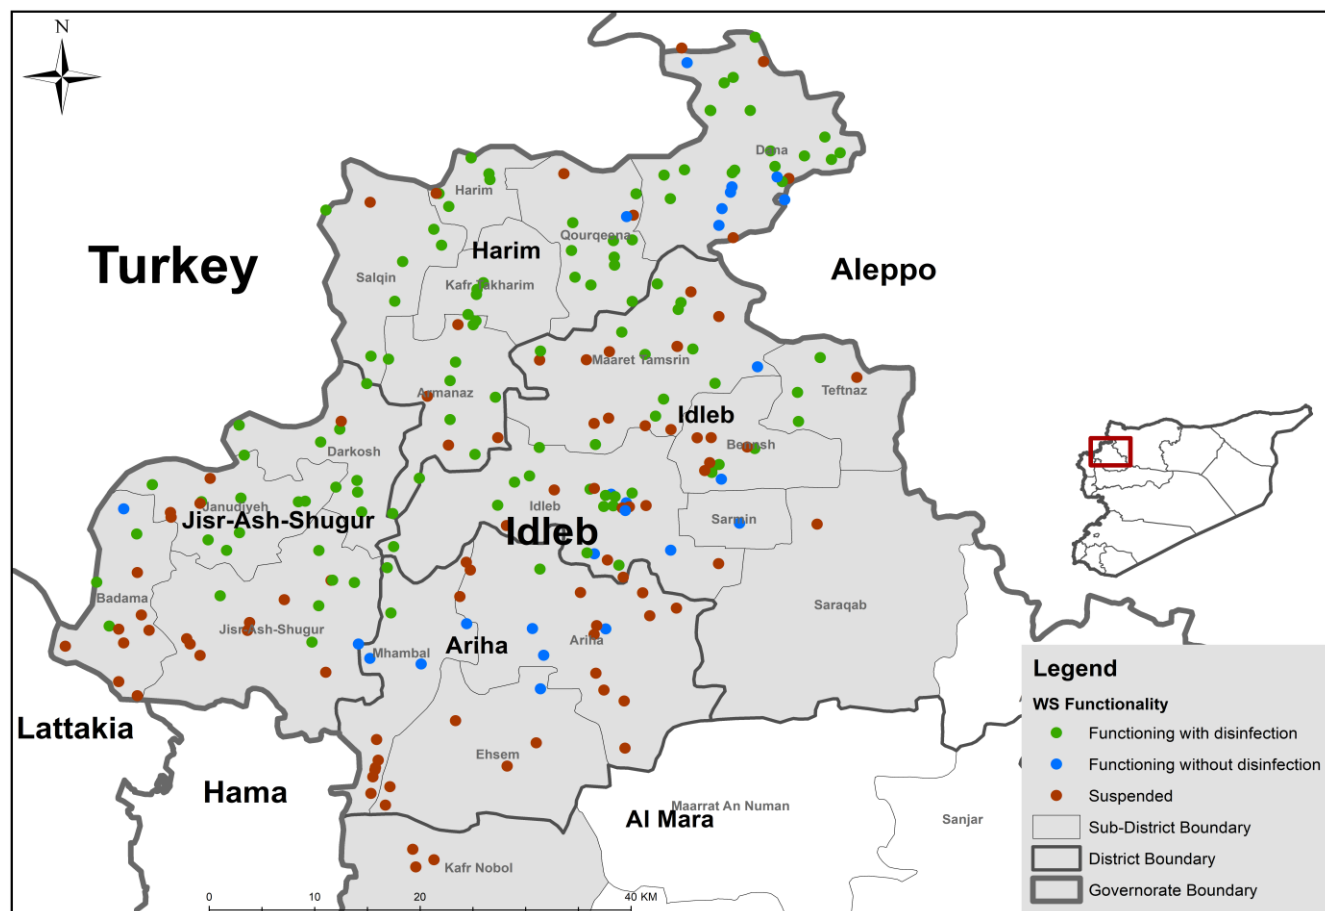


Drinking Water Stations Distribution in Idleb (Camps Water Stations)

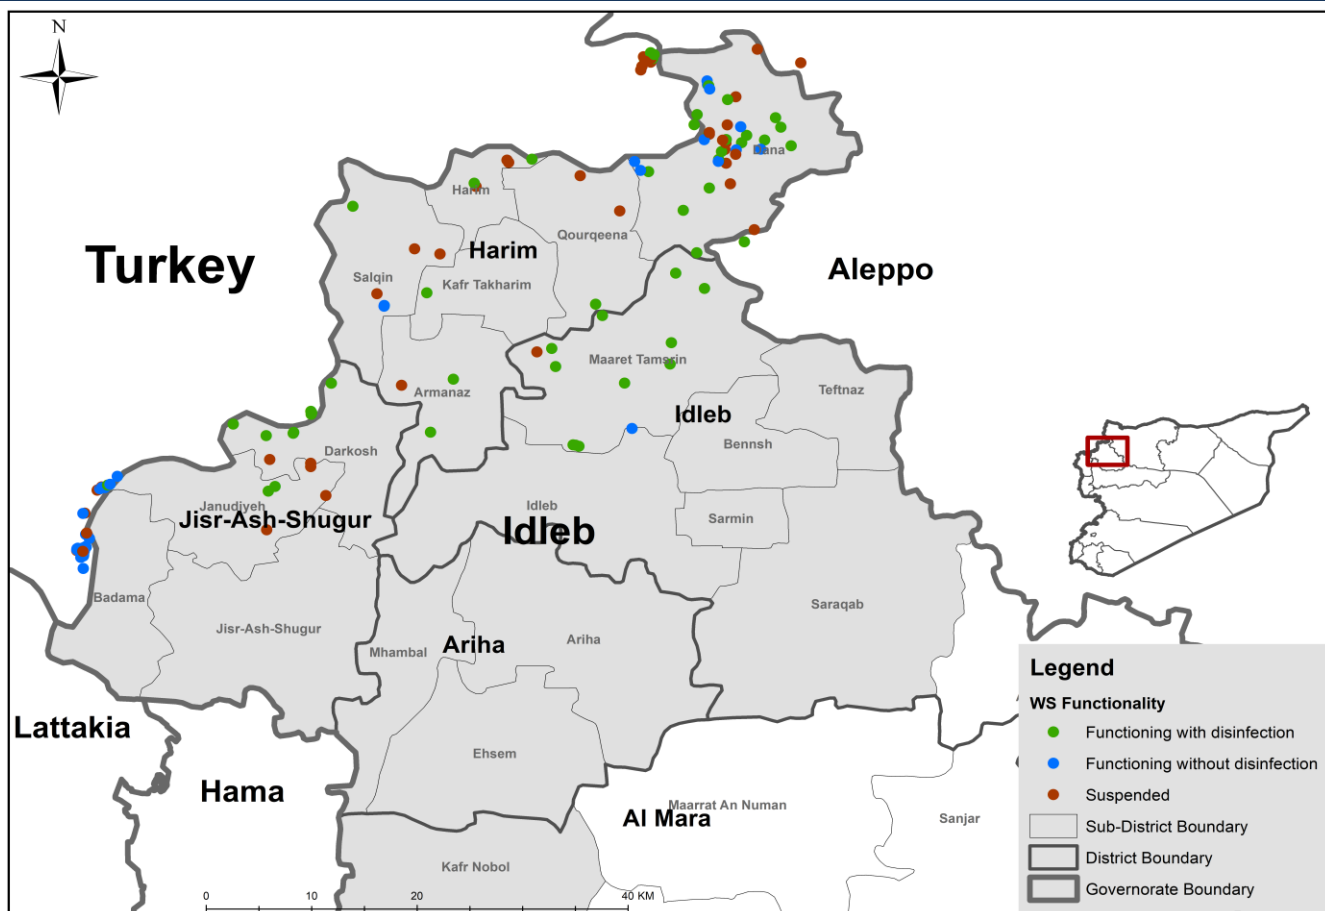


Drinking Water Stations Distribution in Hama

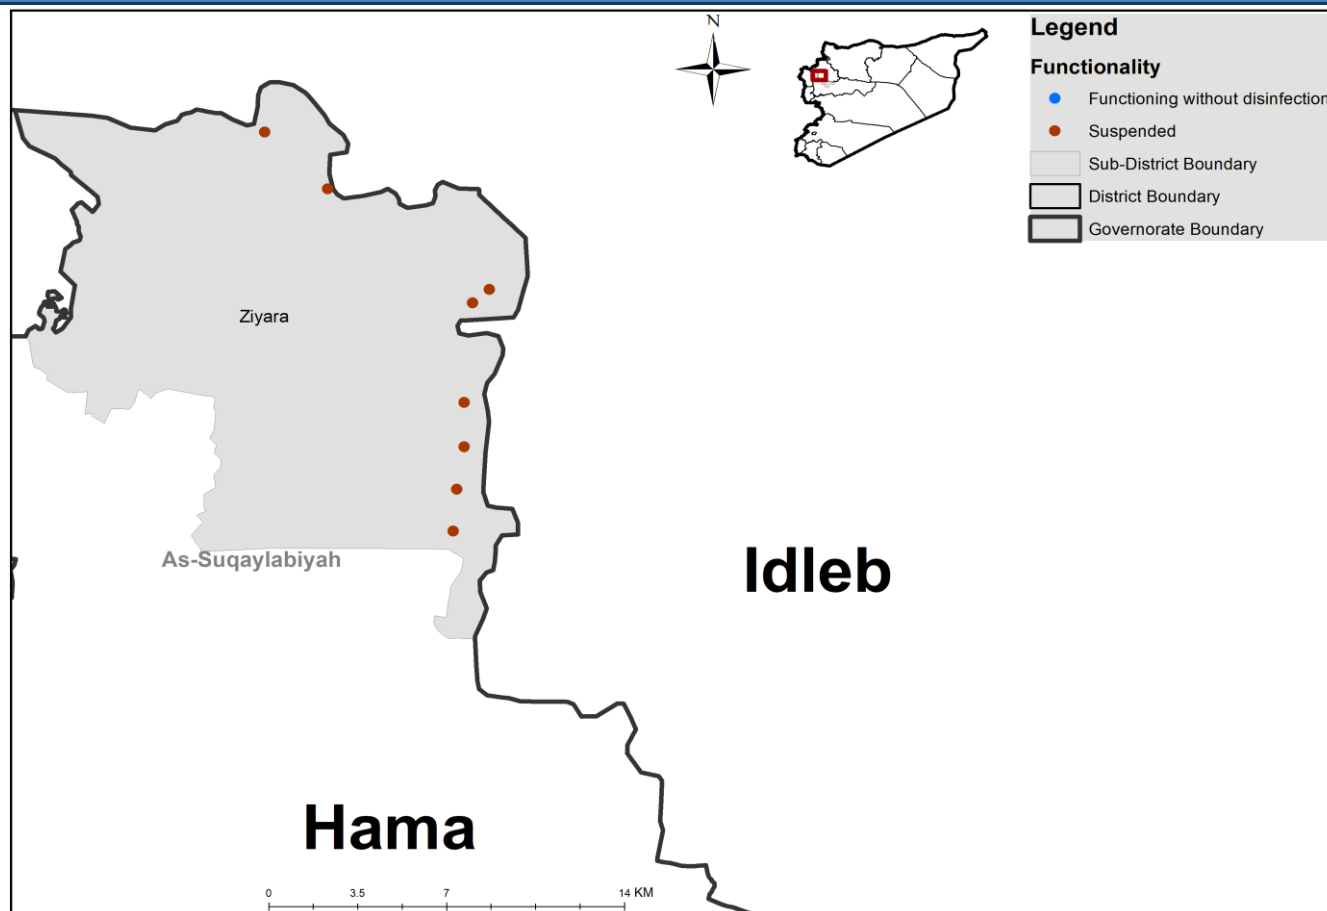

Drinking Water Stations Distribution in Ar-raqqa

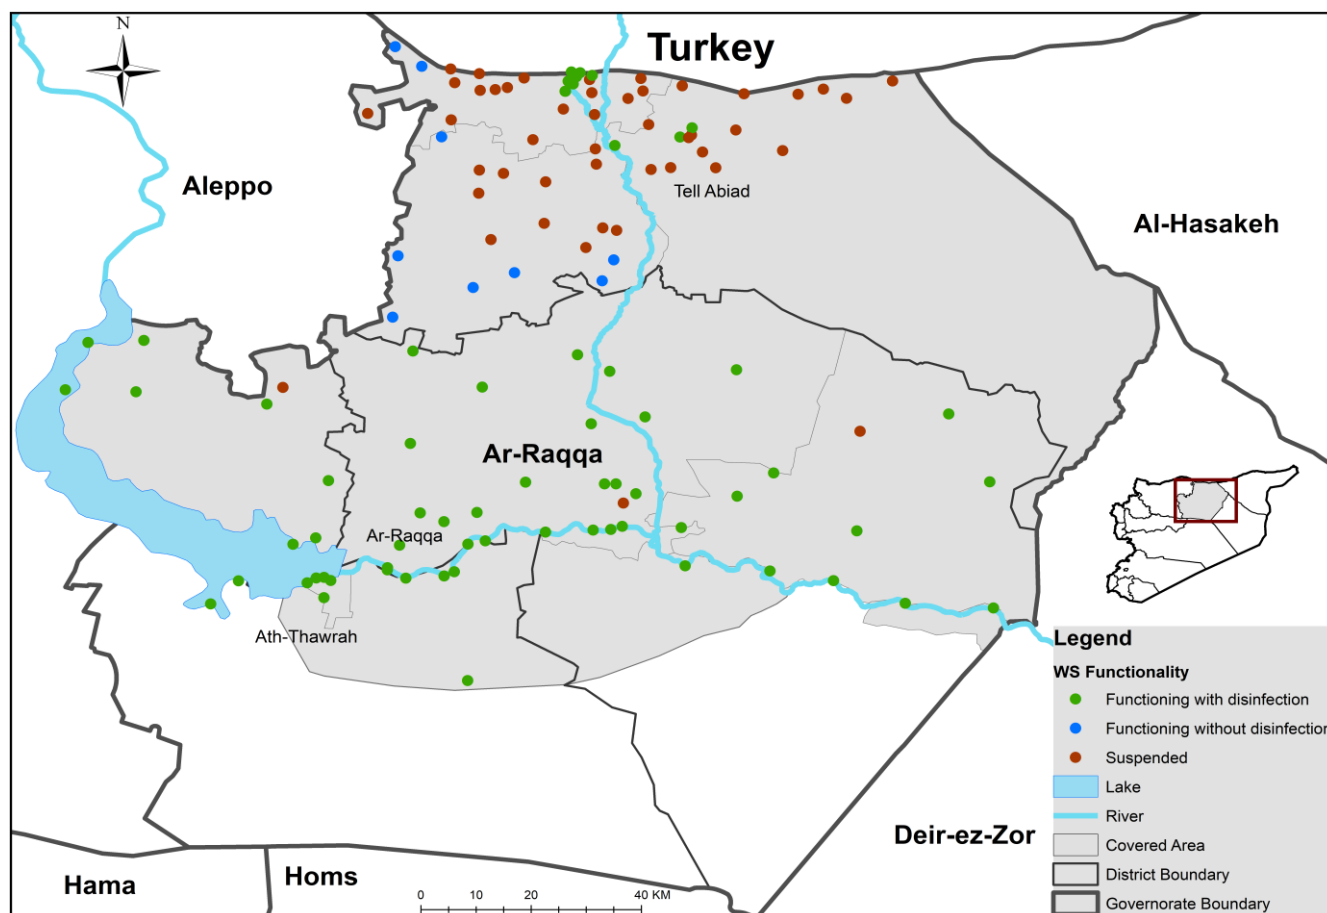

Drinking Water Stations Distribution in Deir-ez-Zor

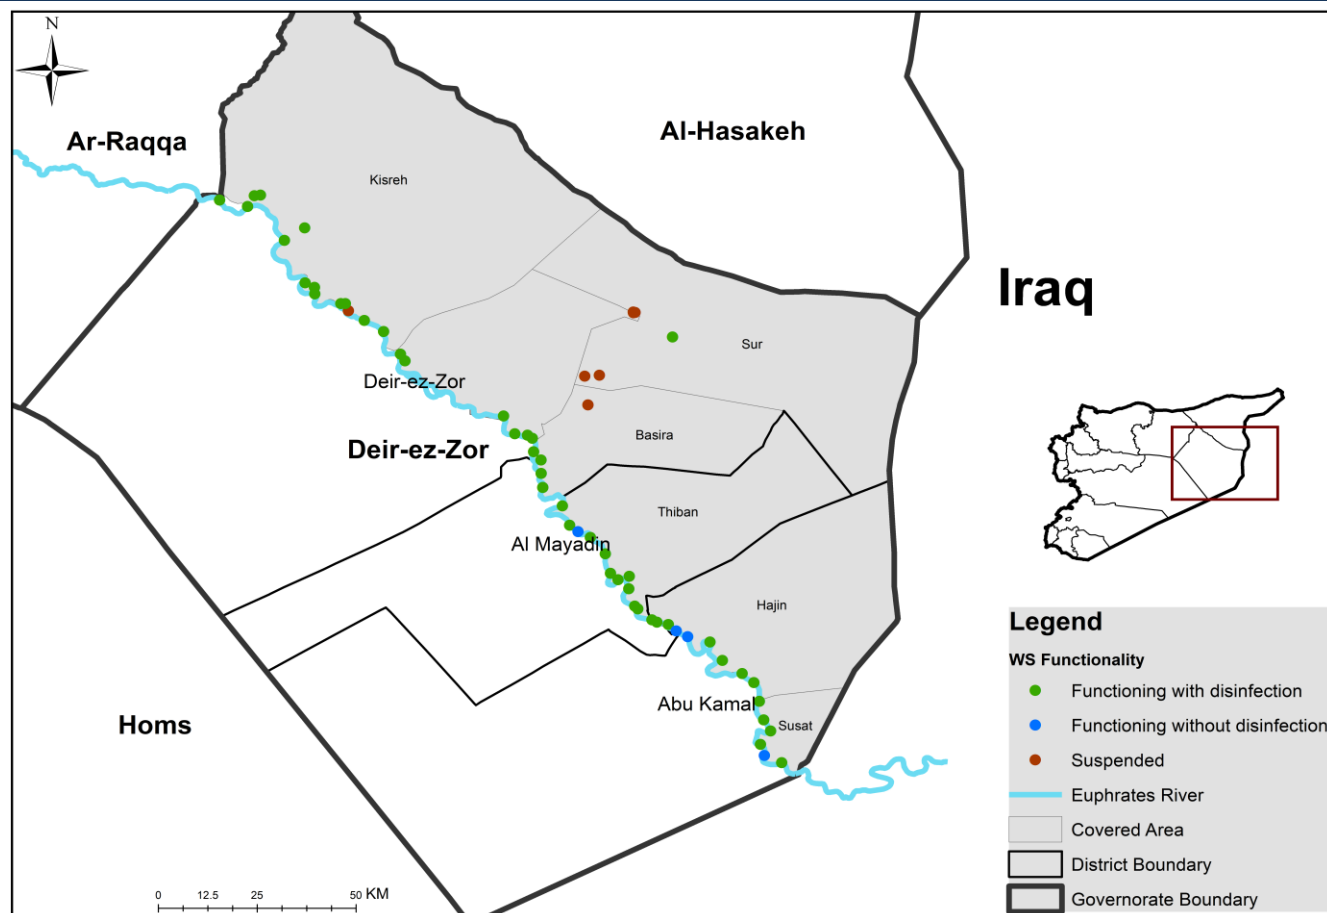

Drinking Water Stations Distribution in Al-Hasakeh

