

## WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network


Date: 25 Sep - 8 Oct 2022

Week No. 39-40


### Highlights

- This report covers 1285 public drinking water stations monitored in 6 governorates, 1099 community-based, and 186 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 70% (894/1285) were functioning.
- The percentage of the suspended stations due to the lack of operational costs is 21%, and the percentage of the suspended stations due to the need for total-scale maintenance is 21%, of the total suspended water stations.
- Of the water stations, 36% depend on the grid and 35% depend on generators as a source of electric power.
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 57% (509/894).
- Of the functioning water stations, percentage of 88% (781/894) delivered water using a piping network, percentage of 08% (65/894) delivered water using tankering and percentage of 04% (43/894) delivered water using both, and 00% (5/894) delivered water using manhal.
- 73 water quality tests were conducted, 13 of them were contaminated.


### EWARN Coverage

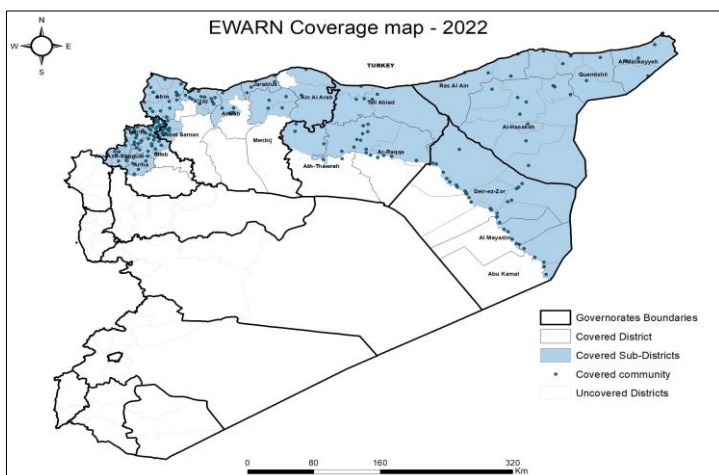

### WASH Coverage by EWARN

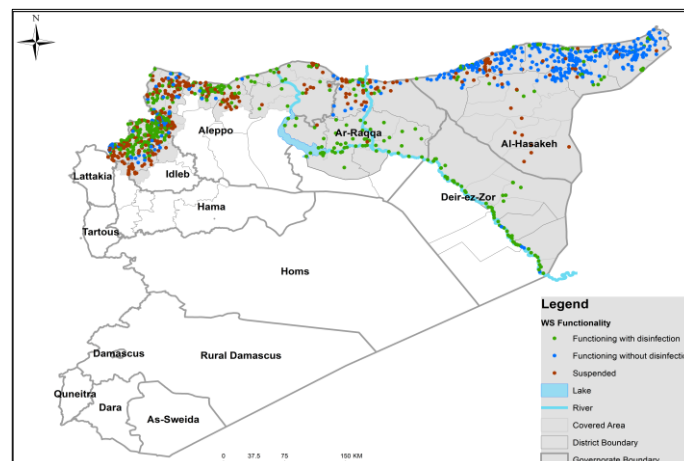

### Completeness and Timeliness of Biweekly Reports


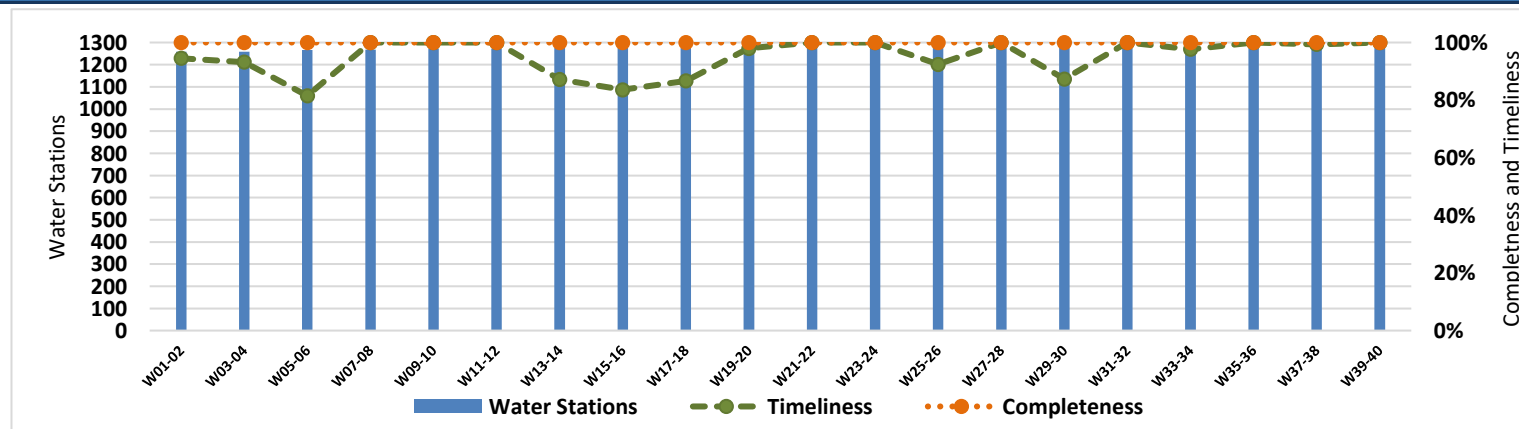


## Drinking Water Stations Status in Each Governorate


Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Non-camps)	257	135	53%
Aleppo (Camps)	45	12	27%
Idleb (Non-camps)	226	149	66%
Idleb (Camps)	141	97	69%
Hama	8	0	0%
Ar-raqqa	121	89	74%
Deir-ez-Zor	61	60	98%
Al-Hasakeh	426	352	83%
<b>Total</b>	<b>1285</b>	<b>894</b>	<b>70%</b>

Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Non-camps)	135	111	82%
Aleppo (Camps)	12	3	25%
Idleb (Non-camps)	149	127	85%
Idleb (Camps)	97	55	57%
Hama	0	0	0%
Ar-raqqa	89	69	78%
Deir-ez-Zor	60	56	93%
Al-Hasakeh	352	88	25%
<b>Total</b>	<b>894</b>	<b>509</b>	<b>57%</b>

## Drinking Water Stations Status

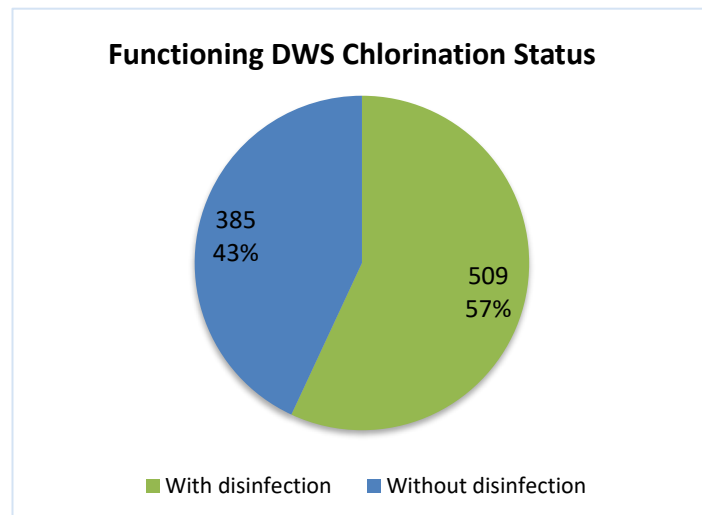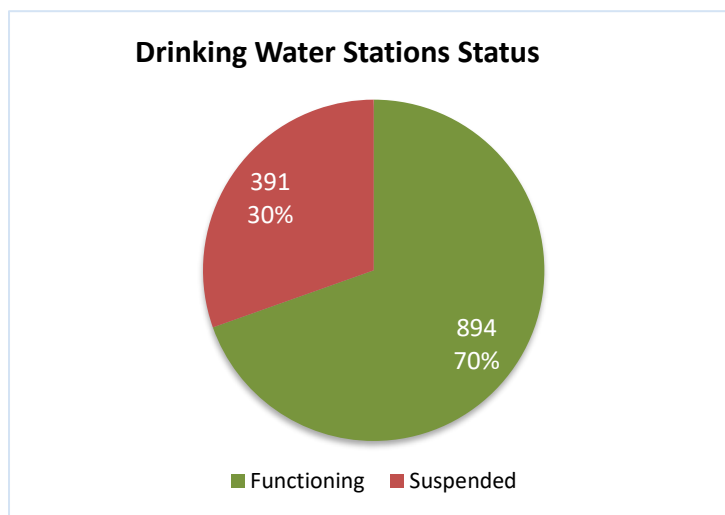


## Drinking Water Stations Status in Governorates

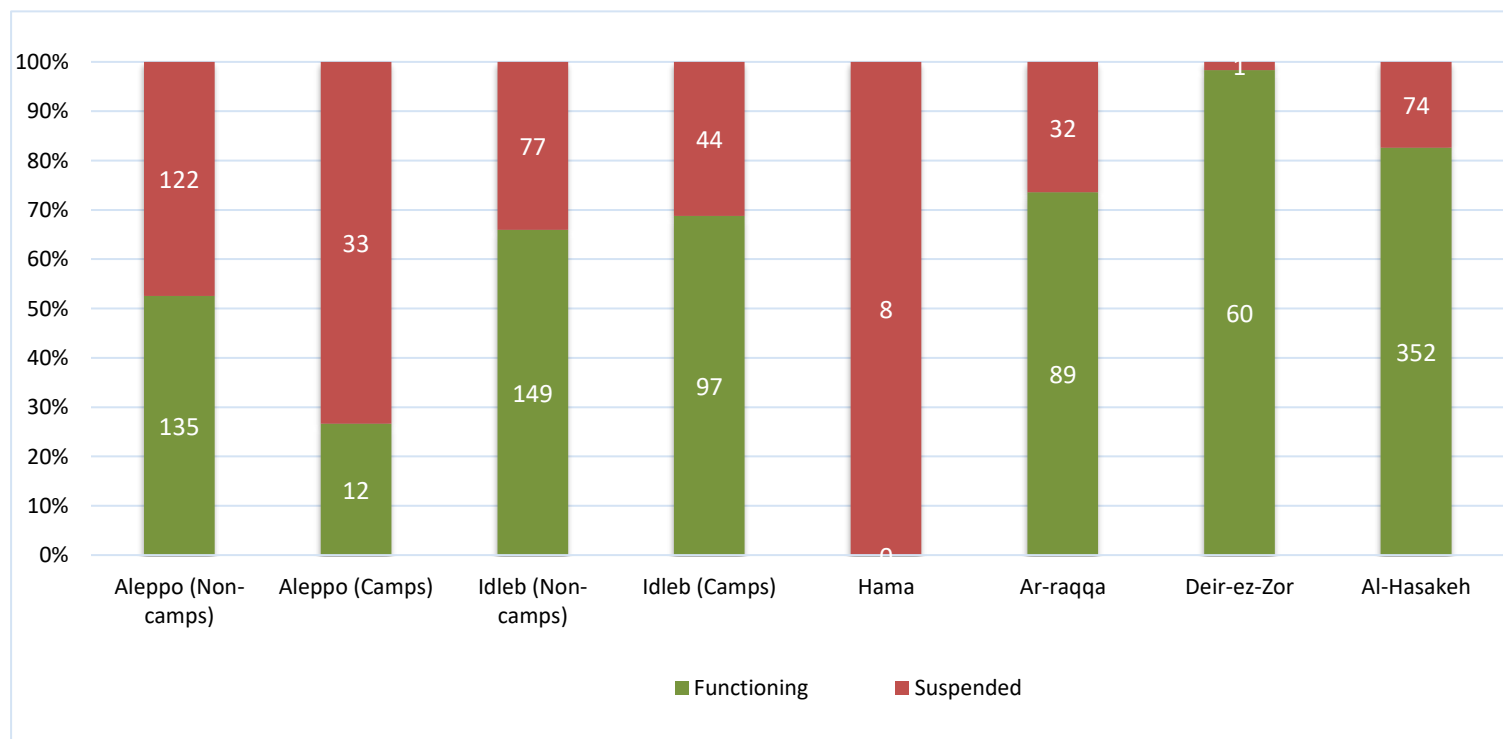


## The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	27	43	2	7	23	40	8	5
Idleb	12	38	1	10	11	35	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	15	0	1	1	5	2	8	0
Deir-ez-Zor	0	0	0	0	0	1	0	0
Al-Hasakeh	39	1	2	0	2	6	22	2
<b>Total</b>	<b>93</b>	<b>82</b>	<b>6</b>	<b>18</b>	<b>41</b>	<b>84</b>	<b>57</b>	<b>10</b>

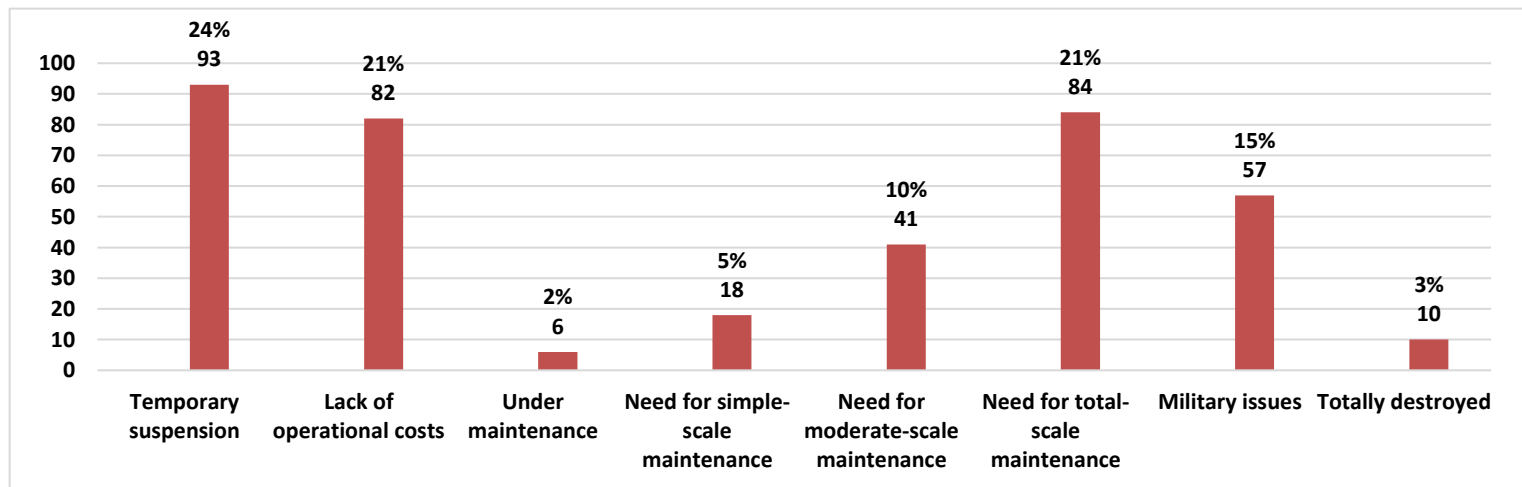


## Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	20	178	14	47	1	29	13
Idleb	14	243	32	32	6	38	2
Hama	0	8	0	0	0	0	0
Ar-raqqa	78	3	3	37	0	0	0
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	352	3	0	70	0	0	1
<b>Total</b>	<b>464</b>	<b>447</b>	<b>49</b>	<b>235</b>	<b>7</b>	<b>67</b>	<b>16</b>

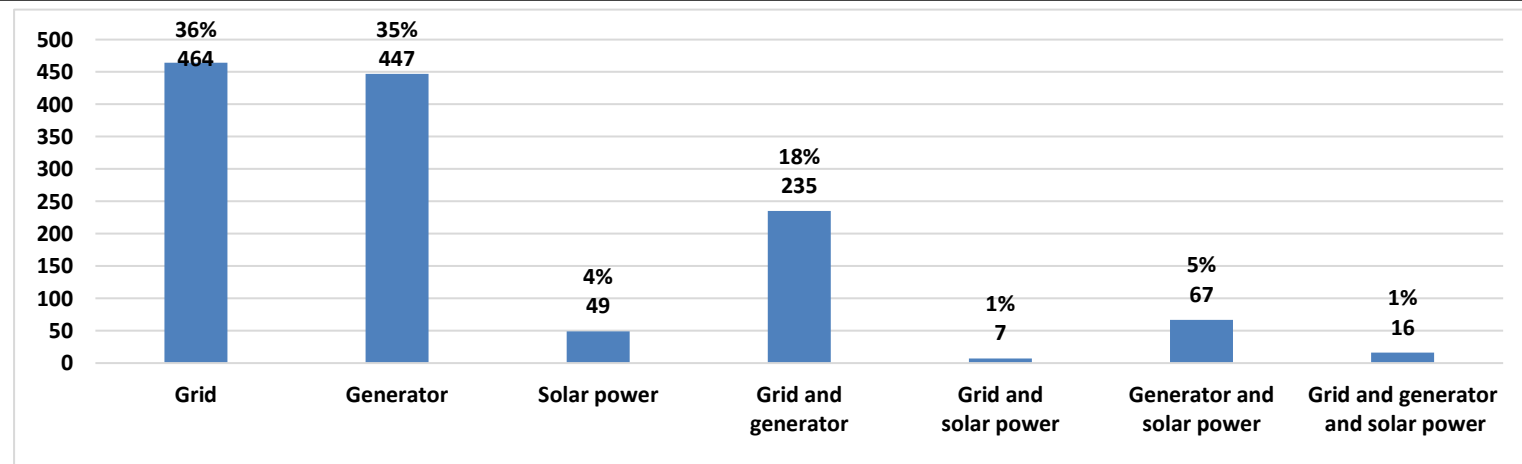


## Functioning Drinking Water Stations Chlorination Status

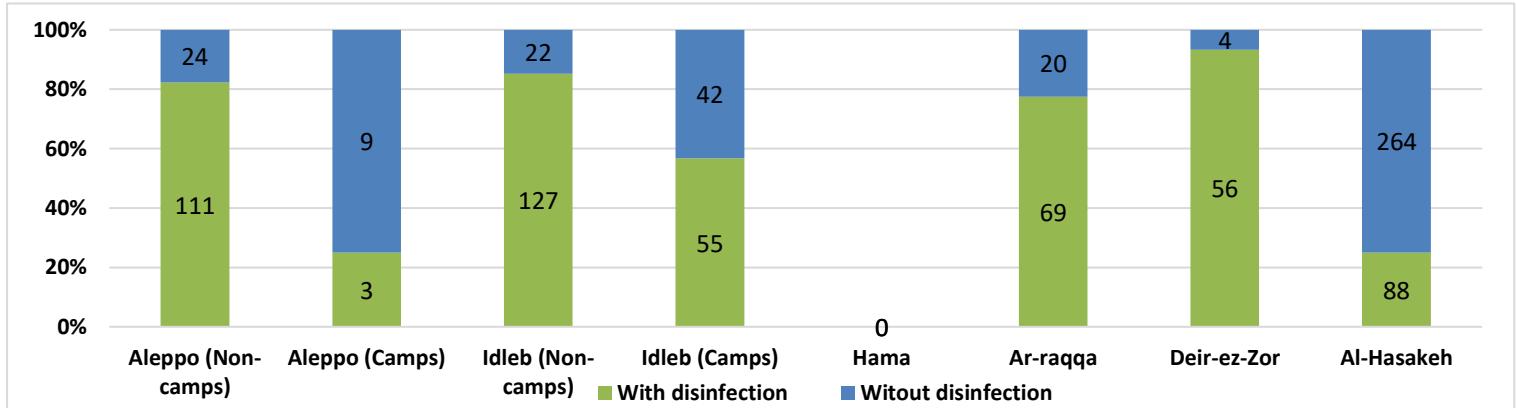

## The Reason for not Chlorination

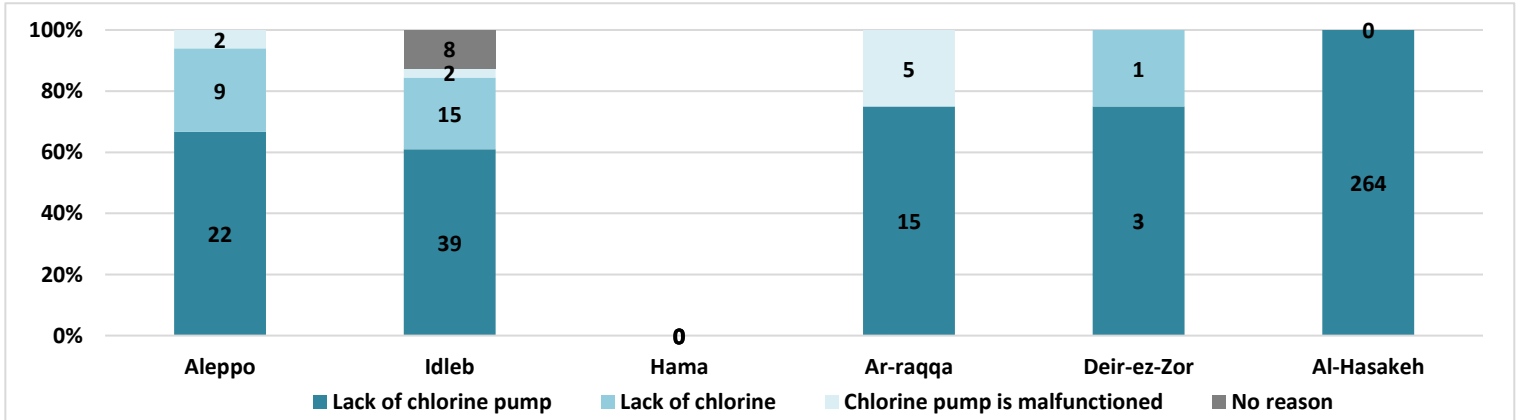


## Chlorination Status Over Weeks

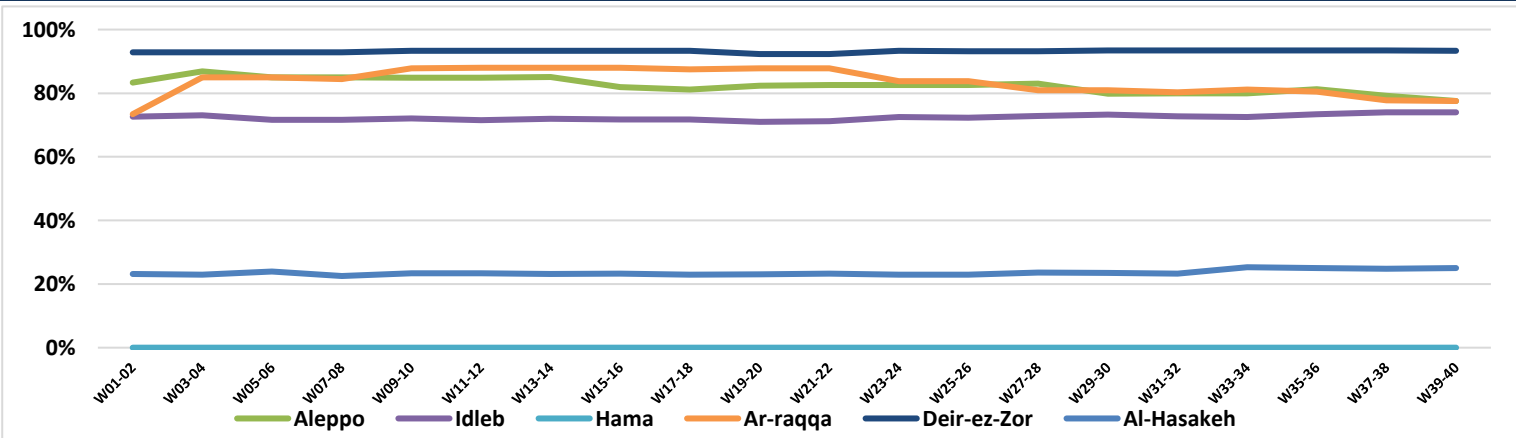


## Connection Method


Governorate	Functioning DWS	Method			
		Network	Tankering	Both	Manhal
Aleppo	147	124	4	14	5
Idleb	246	165	54	27	0
Hama	0	0	0	0	0
Ar-raqqqa	89	86	2	1	0
Deir-ez-Zor	60	56	4	0	0
Al-Hasakeh	352	350	1	1	0
<b>Total</b>	<b>894</b>	<b>781</b>	<b>65</b>	<b>43</b>	<b>5</b>

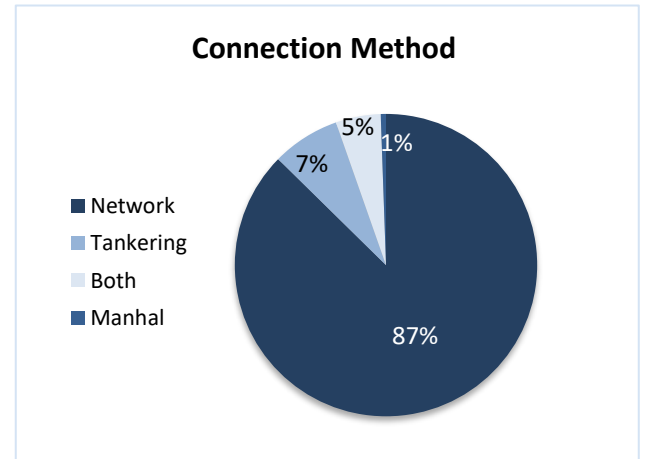


## Drinking Water Stations Distribution in Aleppo (Non-camps Water Stations)

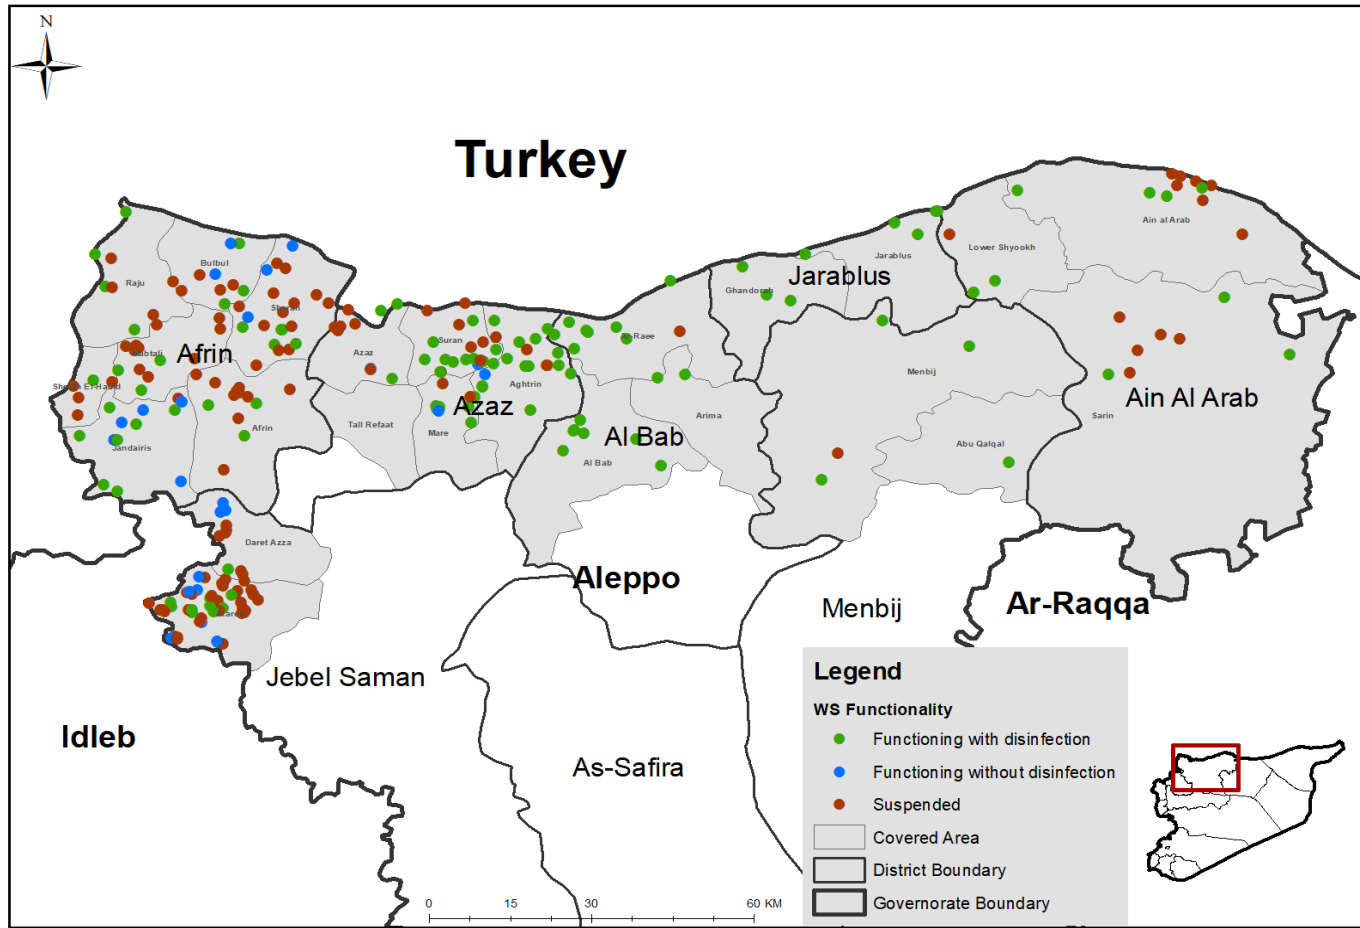


## Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

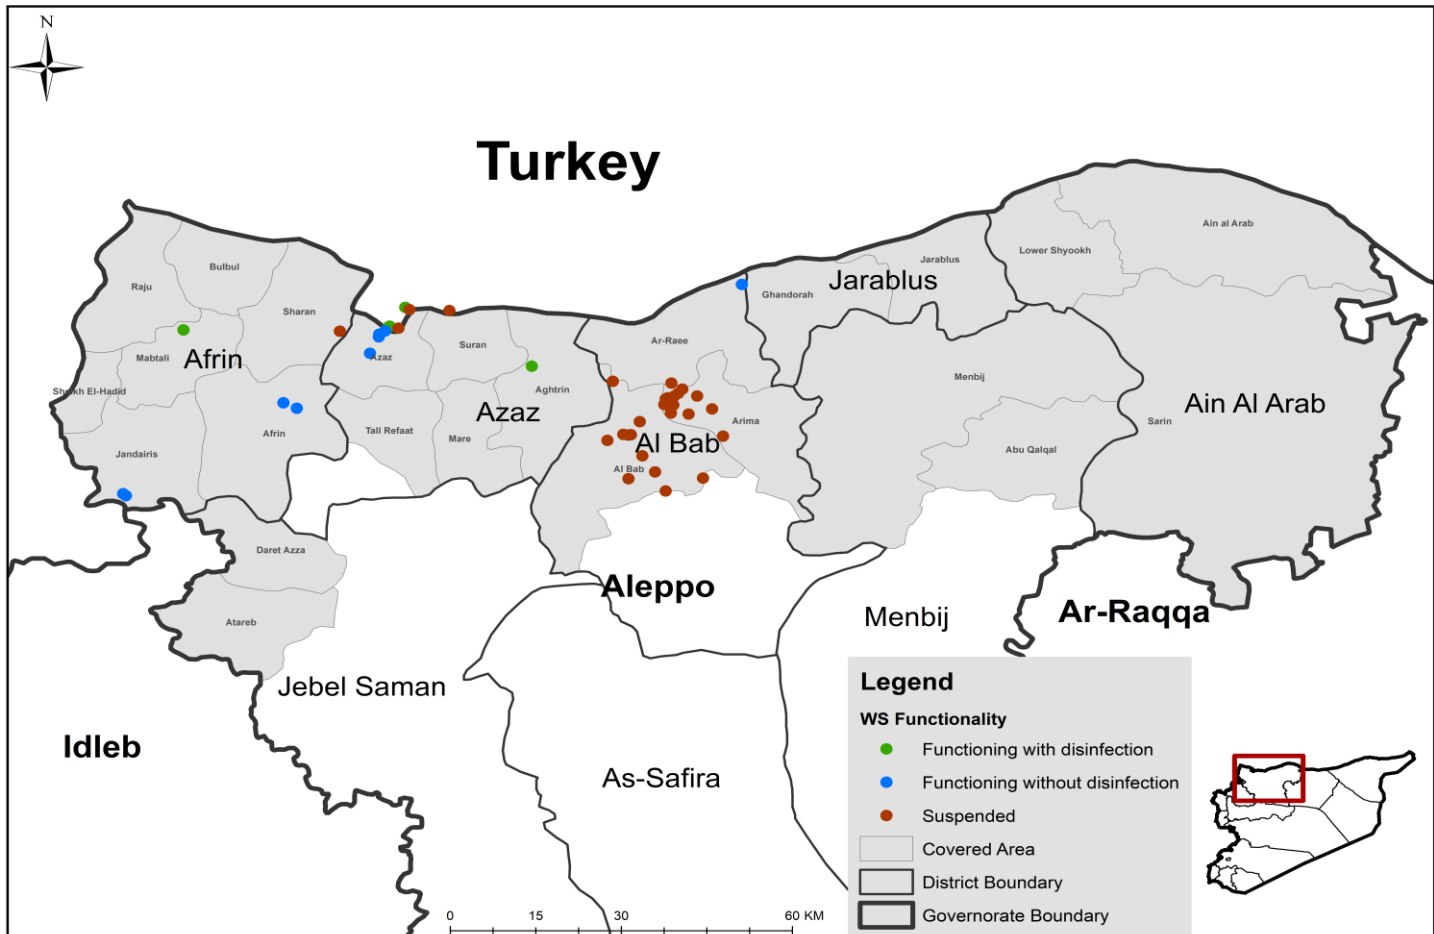


## Drinking Water Stations Distribution in Idleb (Non-camps Water Stations)

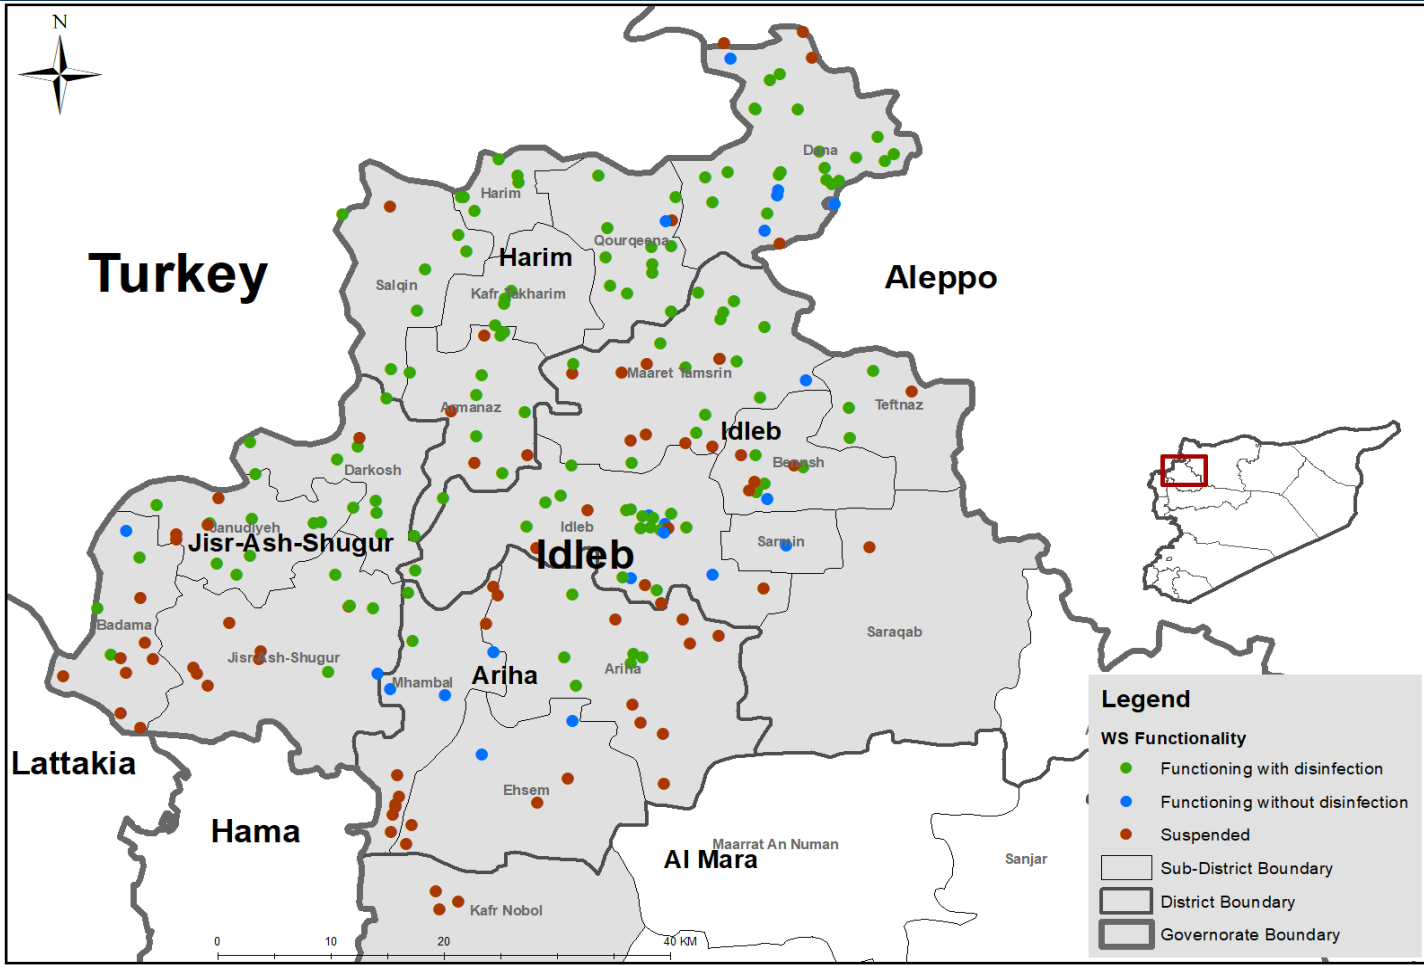


## Drinking Water Stations Distribution in Idleb (Camps Water Stations)

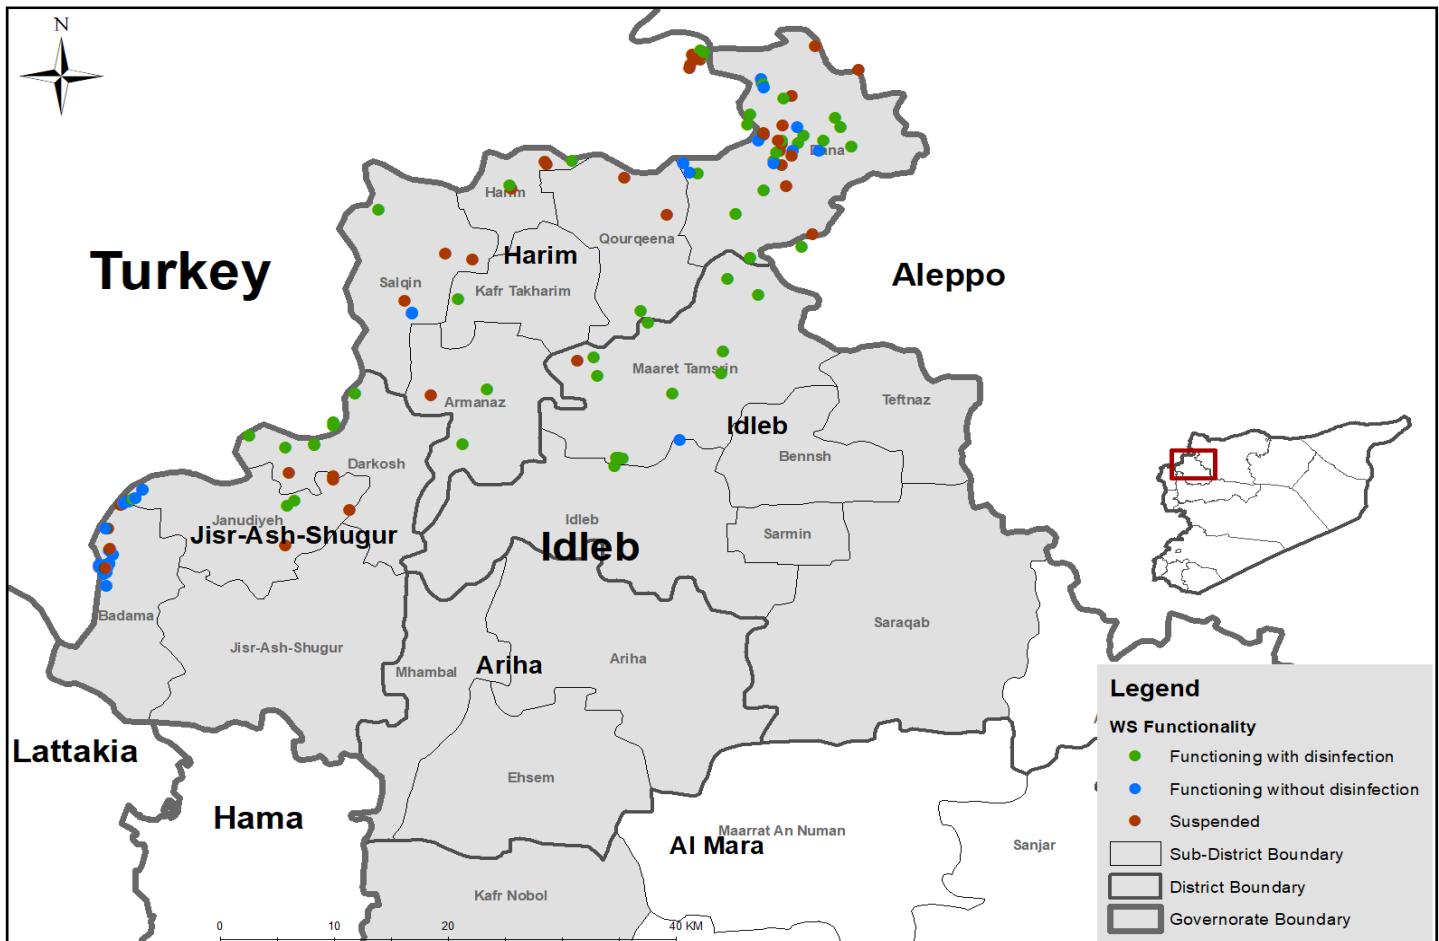

## Drinking Water Stations Distribution in Hama

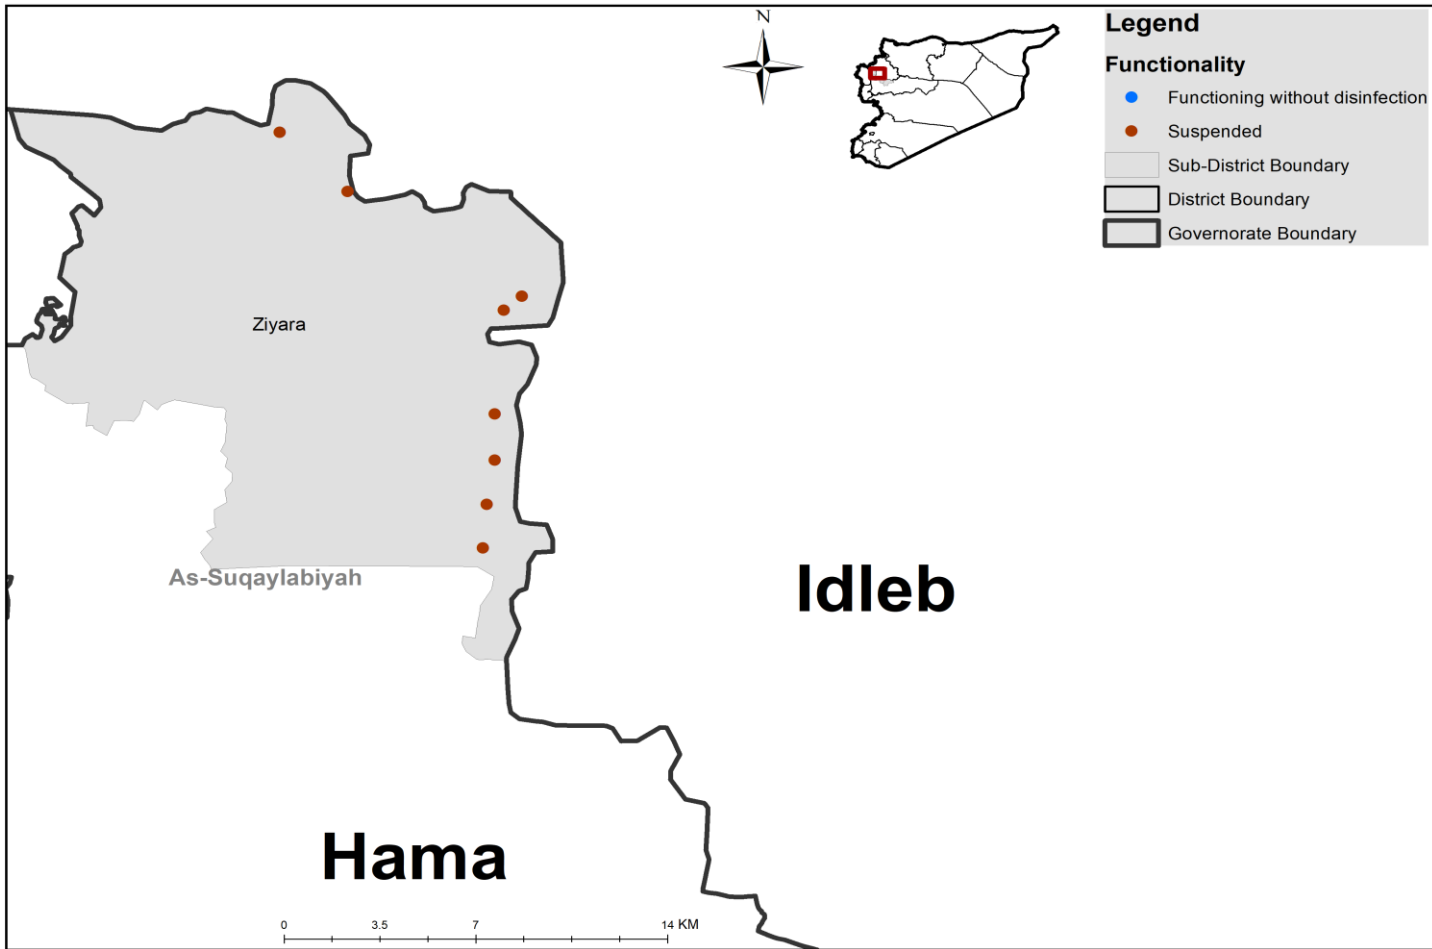


## Drinking Water Stations Distribution in Ar-raqqa

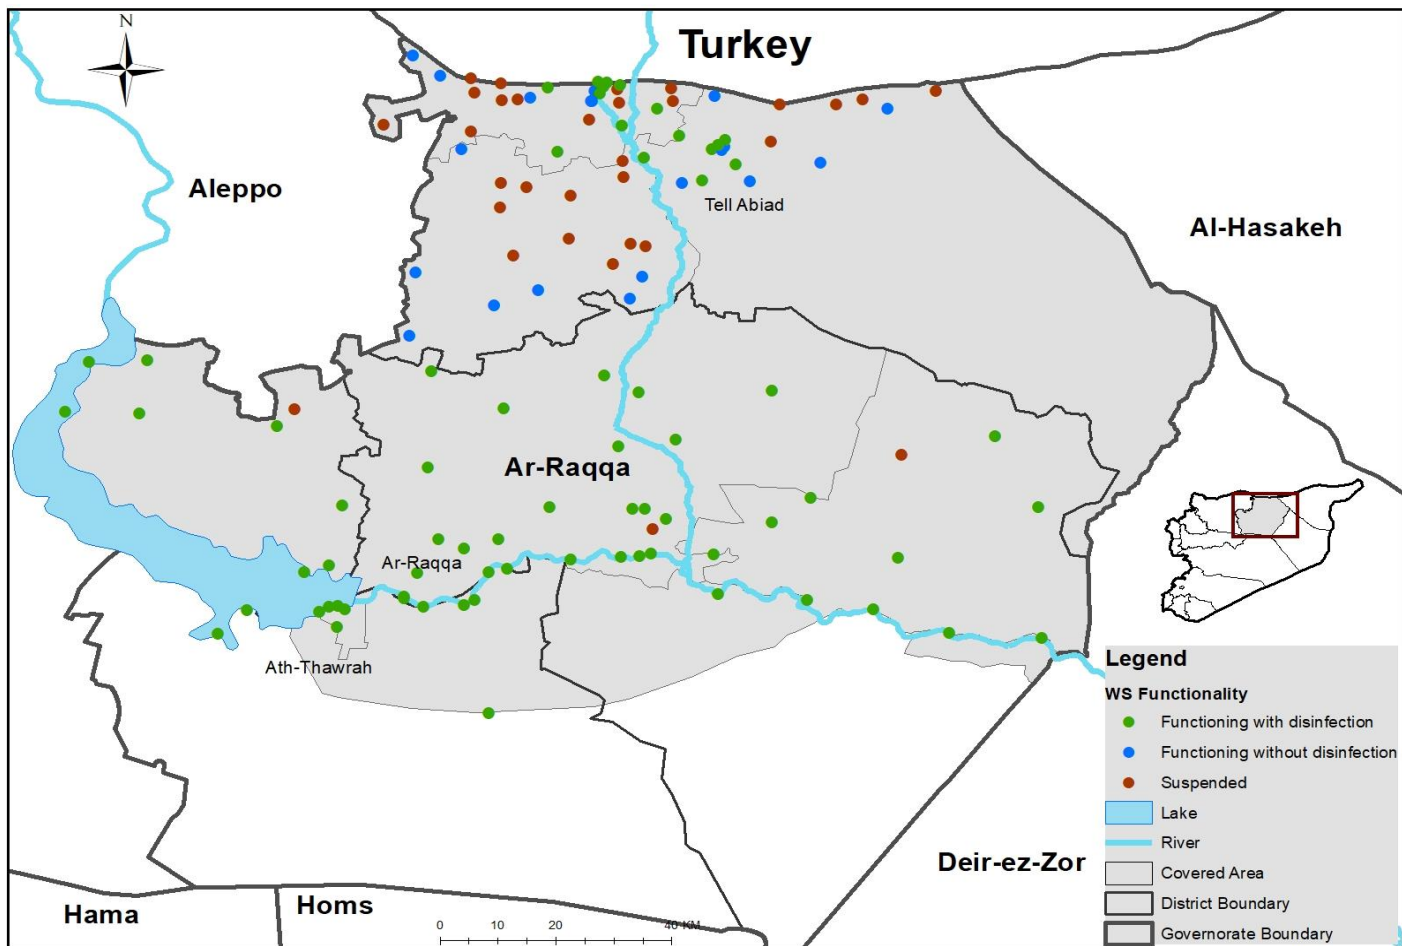



## Drinking Water Stations Distribution in Deir-ez-Zor

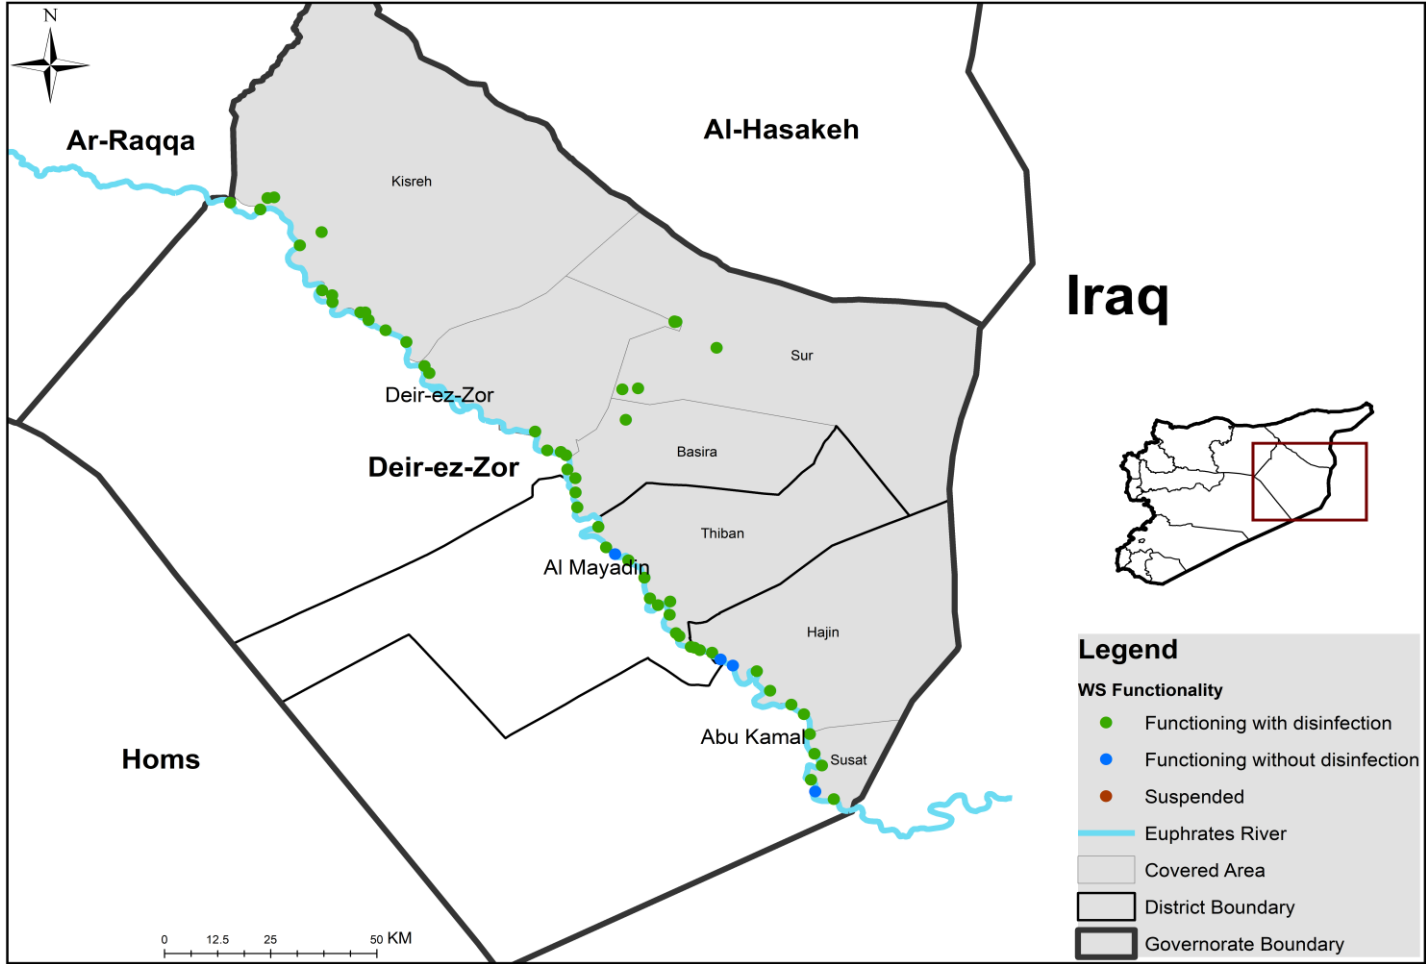

## Drinking Water Stations Distribution in Al-Hasakeh

