

WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network


Date: 27 Aug - 9 Sep 2023

Week No. 35-36


Highlights

- This report covers 1323 public drinking water stations monitored in 6 governorates, 1107 community-based, and 216 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 70% (926/1323) were functioning, while 30% (397/1323) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 20%, and the percentage of the suspended stations due to the need for total-scale maintenance is 22%, of the total suspended water stations.
- Of the water stations, 34% depend on the grid and 32% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 61% (565/926).
- Of the functioning water stations, percentage of 88% (807/926) delivered water using a piping network, percentage of 08% (56/926) delivered water using water trucking and percentage of 04% (58/926) delivered water using both, and 01% (5/926) delivered water using manhal.
- 36 water quality tests were conducted, 06 of them were contaminated.


EWARN Coverage

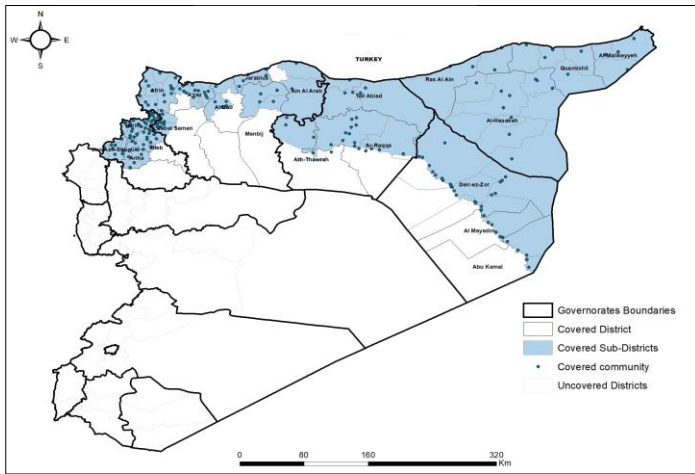

WASH Coverage by EWARN

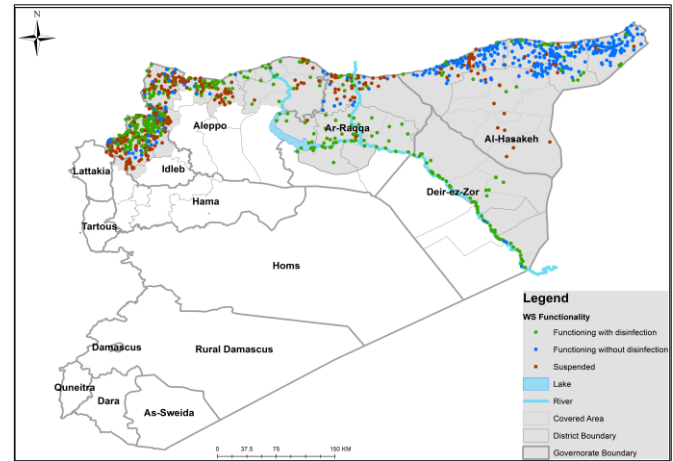

Completeness and Timeliness of Biweekly Reports


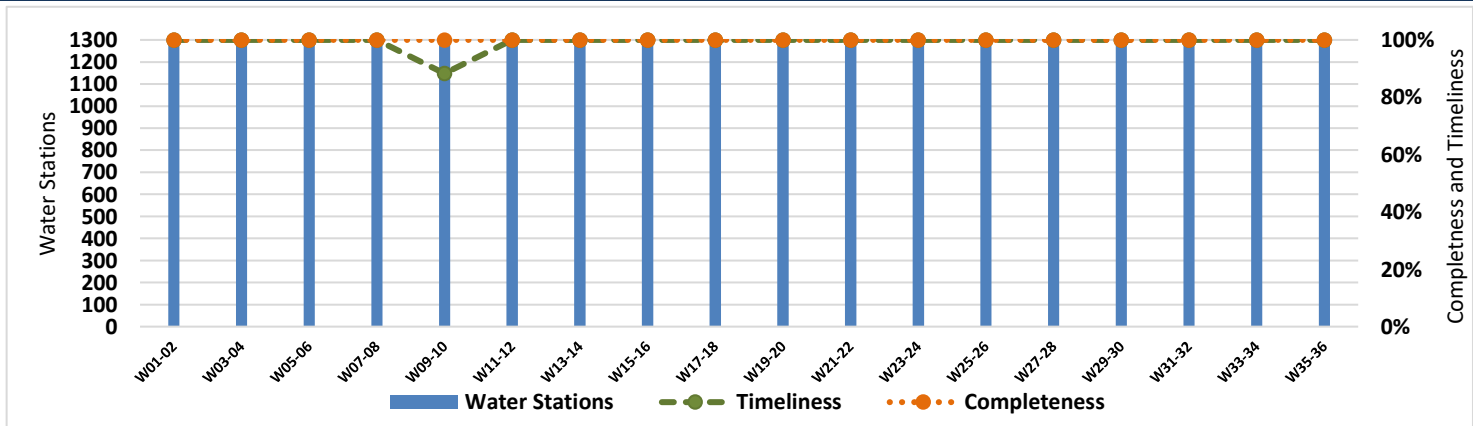


Drinking Water Stations Status in Each Governorate


Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Communities)	259	149	58%
Aleppo (Camps)	50	21	42%
Idleb (Communities)	230	147	64%
Idleb (Camps)	166	116	70%
Hama	8	0	0%
Ar-raqqa	122	92	75%
Deir-ez-Zor	61	27	44%
Al-Hasakeh	427	374	88%
Total	1323	926	70%

Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Communities)	149	131	88%
Aleppo (Camps)	21	16	76%
Idleb (Communities)	147	129	88%
Idleb (Camps)	116	81	70%
Hama	0	0	0%
Ar-raqqa	92	68	74%
Deir-ez-Zor	27	27	100%
Al-Hasakeh	374	113	30%
Total	926	565	61%

Drinking Water Stations Status

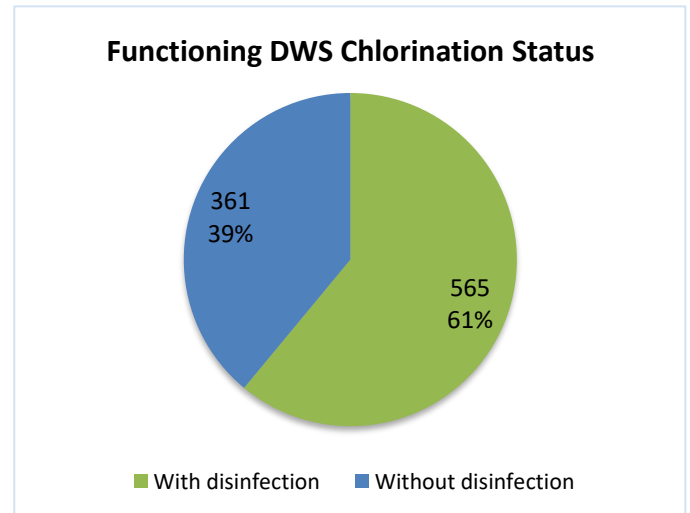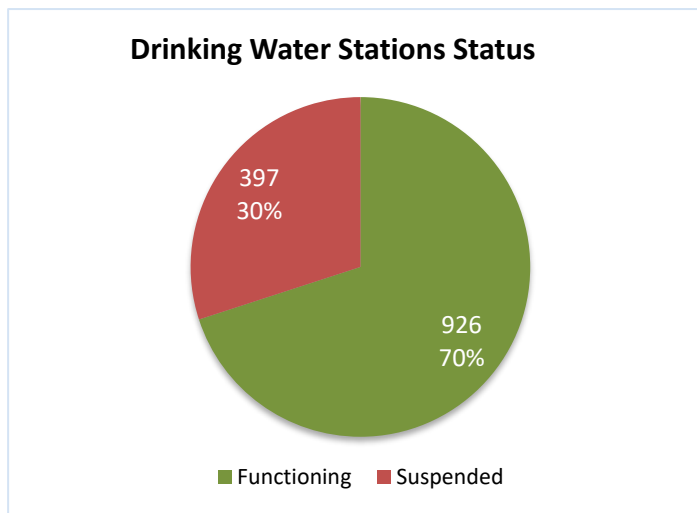


Drinking Water Stations Status in Governorates

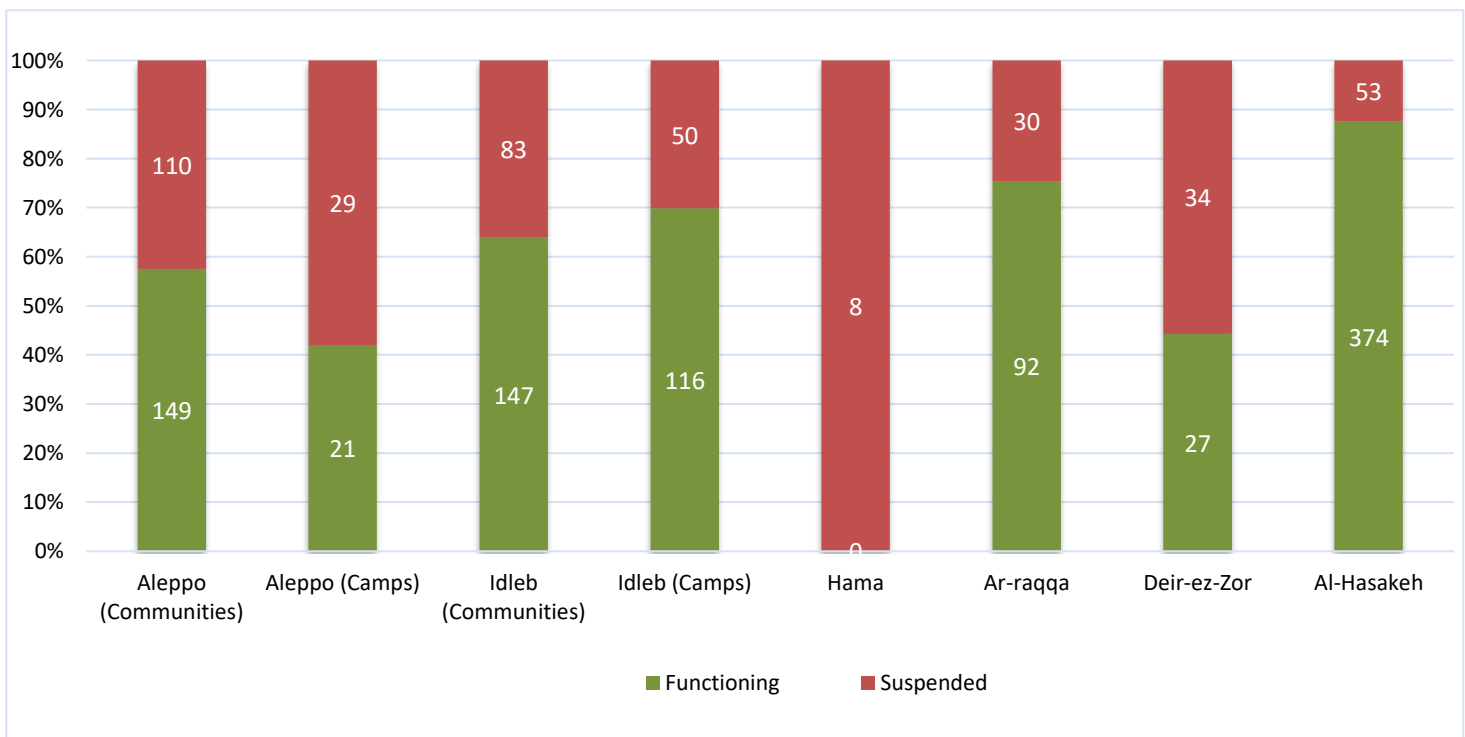


The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	24	29	4	5	22	41	9	5
Idleb	9	43	4	14	10	39	10	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqqa	2	6	0	4	5	4	9	0
Deir-ez-Zor	32	0	2	0	0	0	0	0
Al-Hasakeh	18	3	0	2	1	5	22	2
Total	85	81	10	25	38	89	58	10

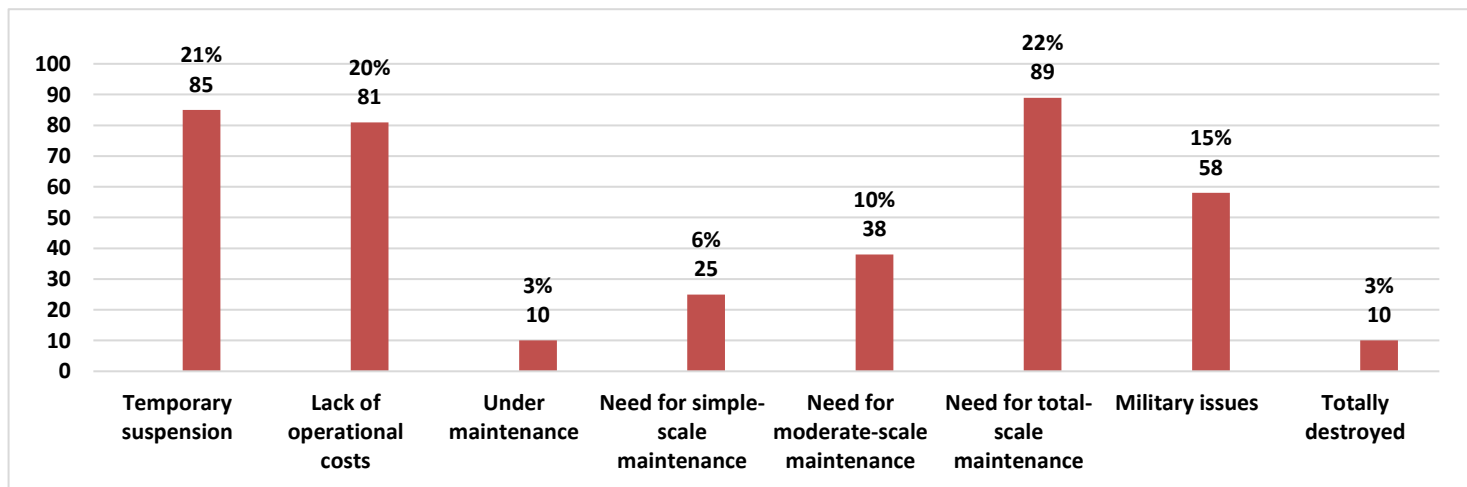


Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	21	163	15	44	4	41	21
Idleb	10	240	35	36	5	65	5
Hama	0	8	0	0	0	0	0
Ar-raqqqa	77	3	4	36	0	1	1
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	338	3	0	66	11	0	9
Total	446	429	54	231	20	107	36

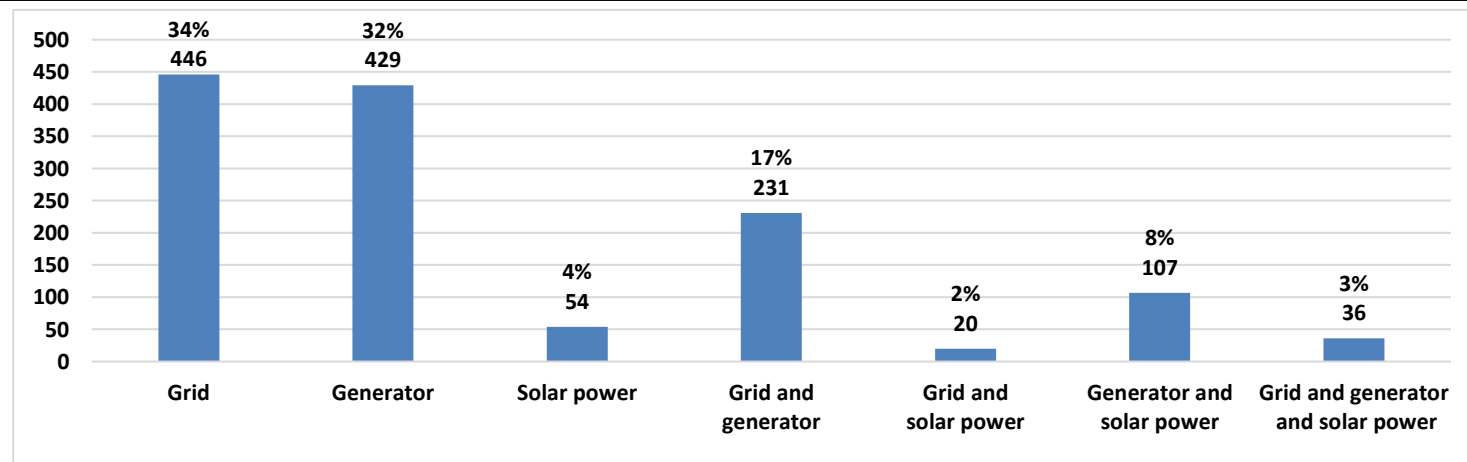


Functioning Drinking Water Stations Chlorination Status

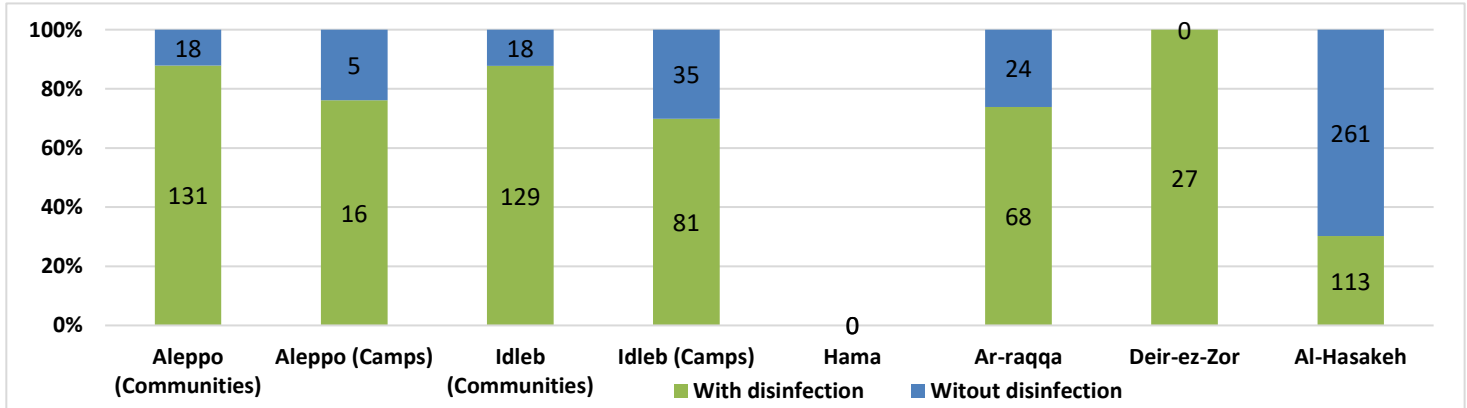

The Reason for not Chlorination

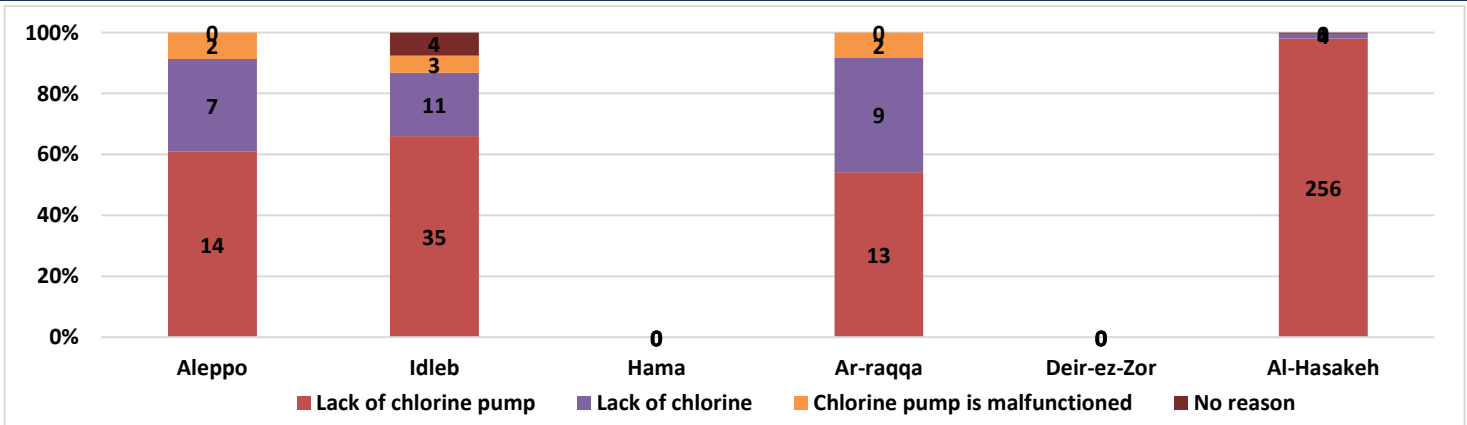


Chlorination Status Over Weeks

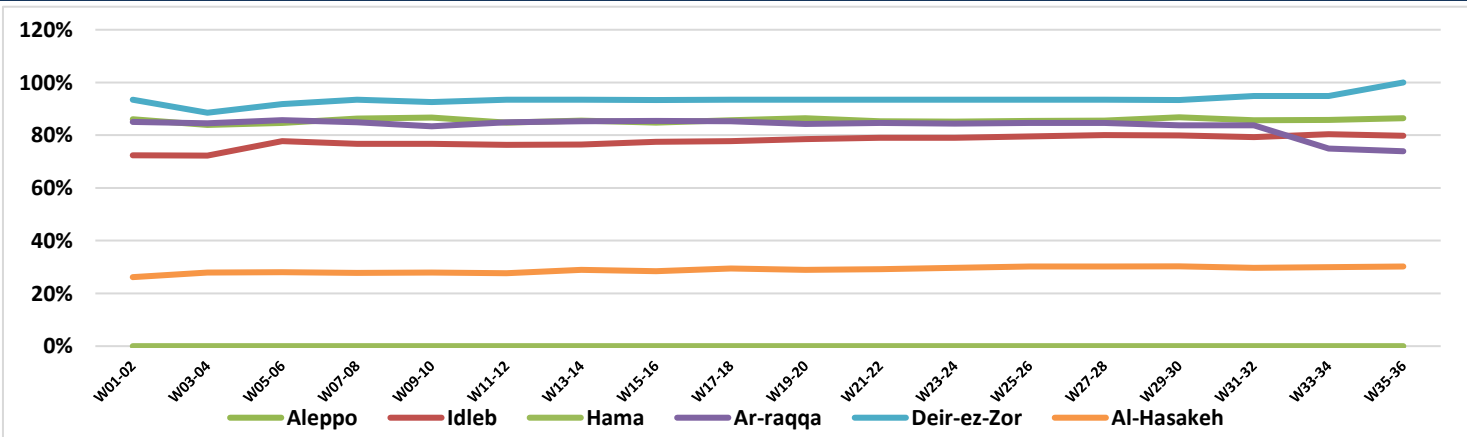


Connection Method


Governorate	Functioning DWS	Method			
		Network	Water Trucking	Both	Manhal
Aleppo	170	149	2	14	5
Idleb	263	170	51	42	0
Hama	0	0	0	0	0
Ar-raqqa	92	89	2	1	0
Deir-ez-Zor	27	27	0	0	0
Al-Hasakeh	374	372	1	1	0
Total	926	807	56	58	5

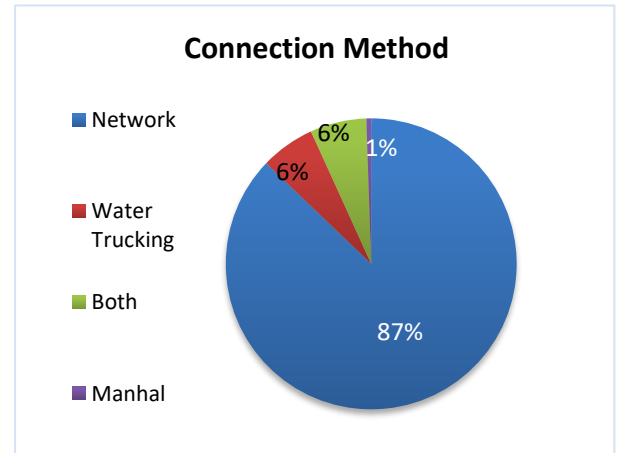


Drinking Water Stations Distribution in Aleppo (Communities Water Stations)

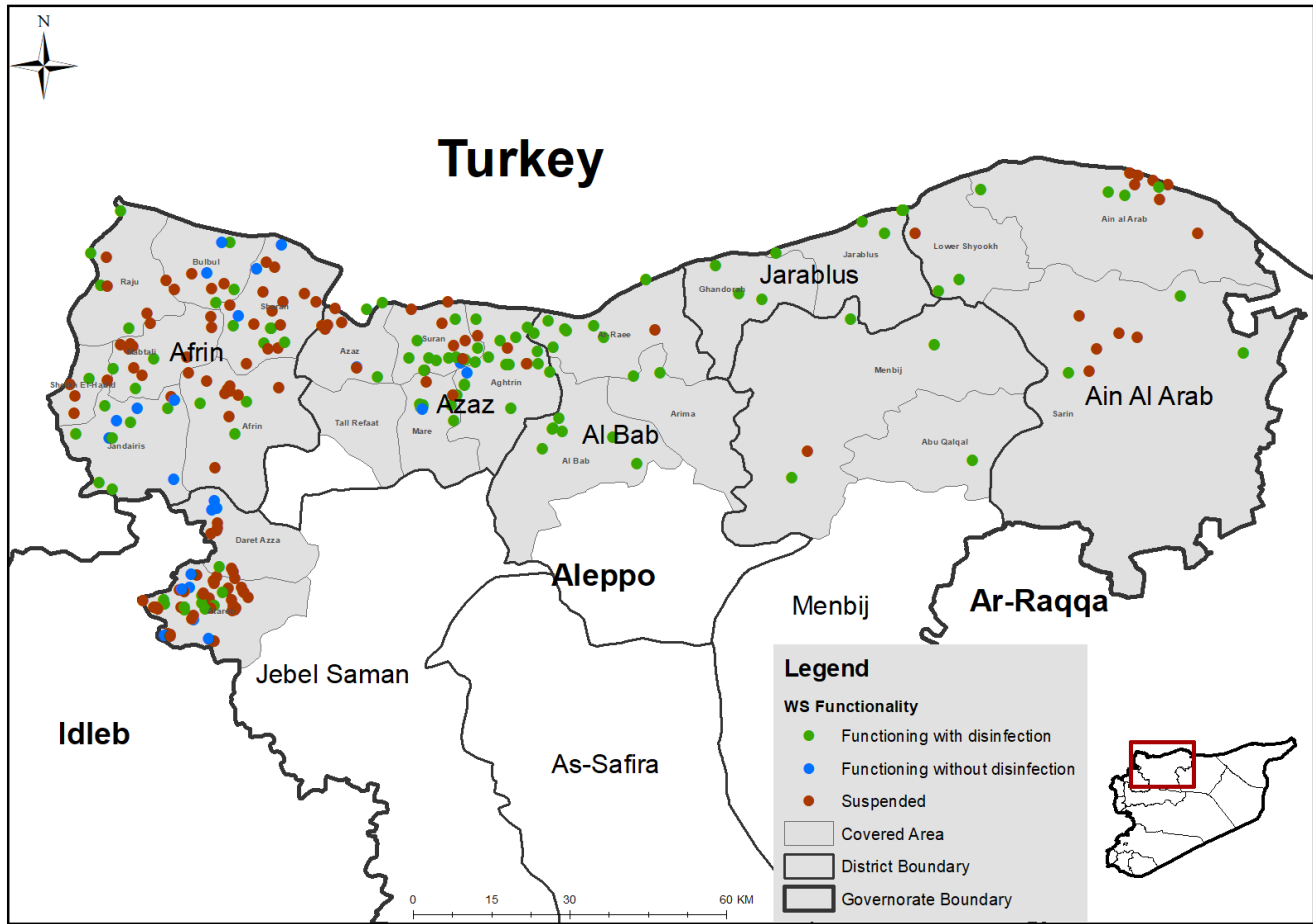


Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

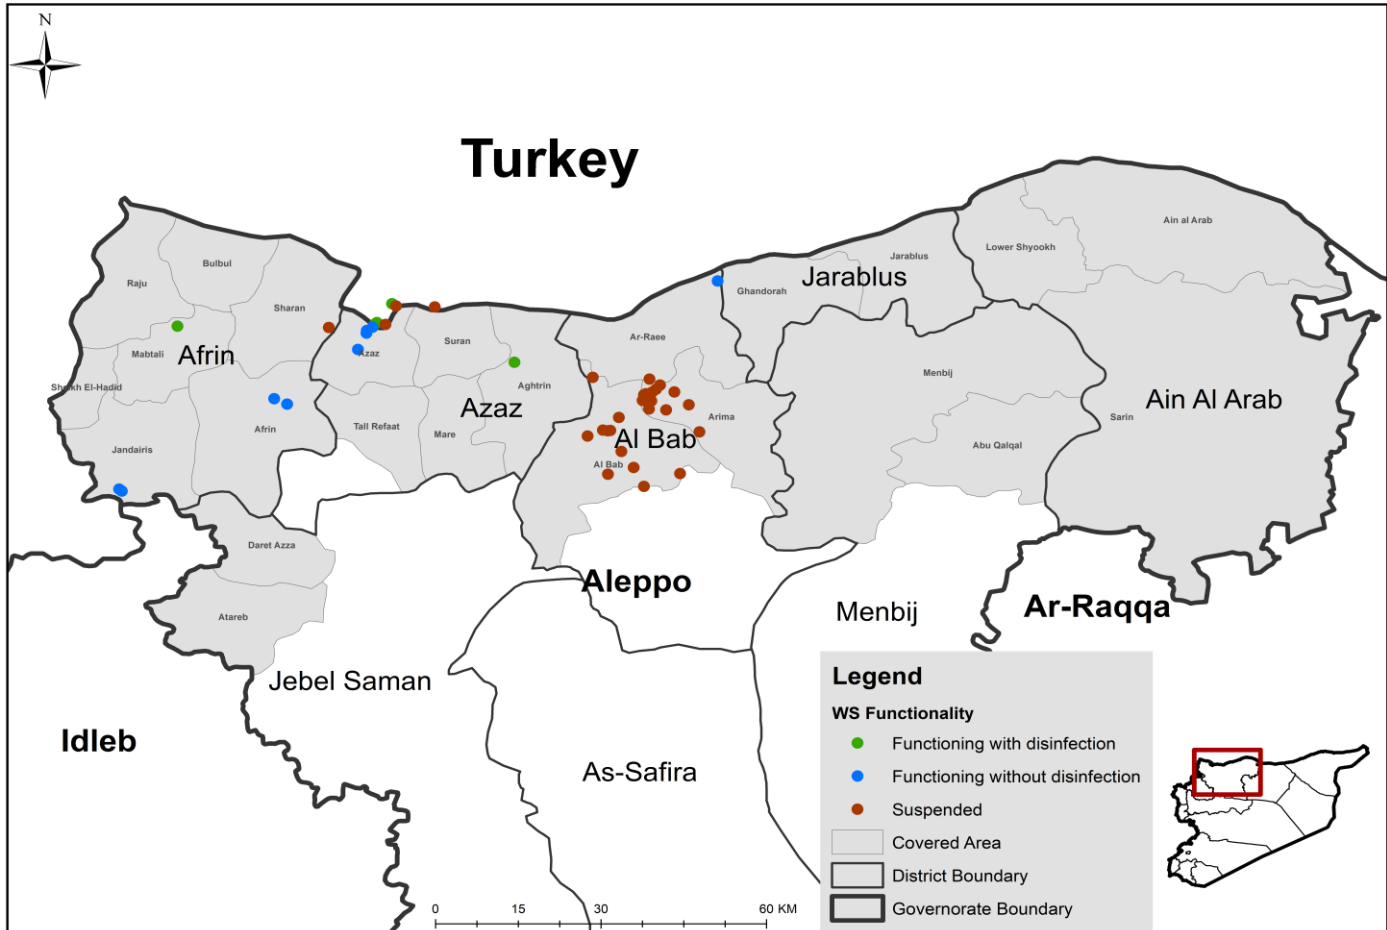


Drinking Water Stations Distribution in Idleb (Communities Water Stations)

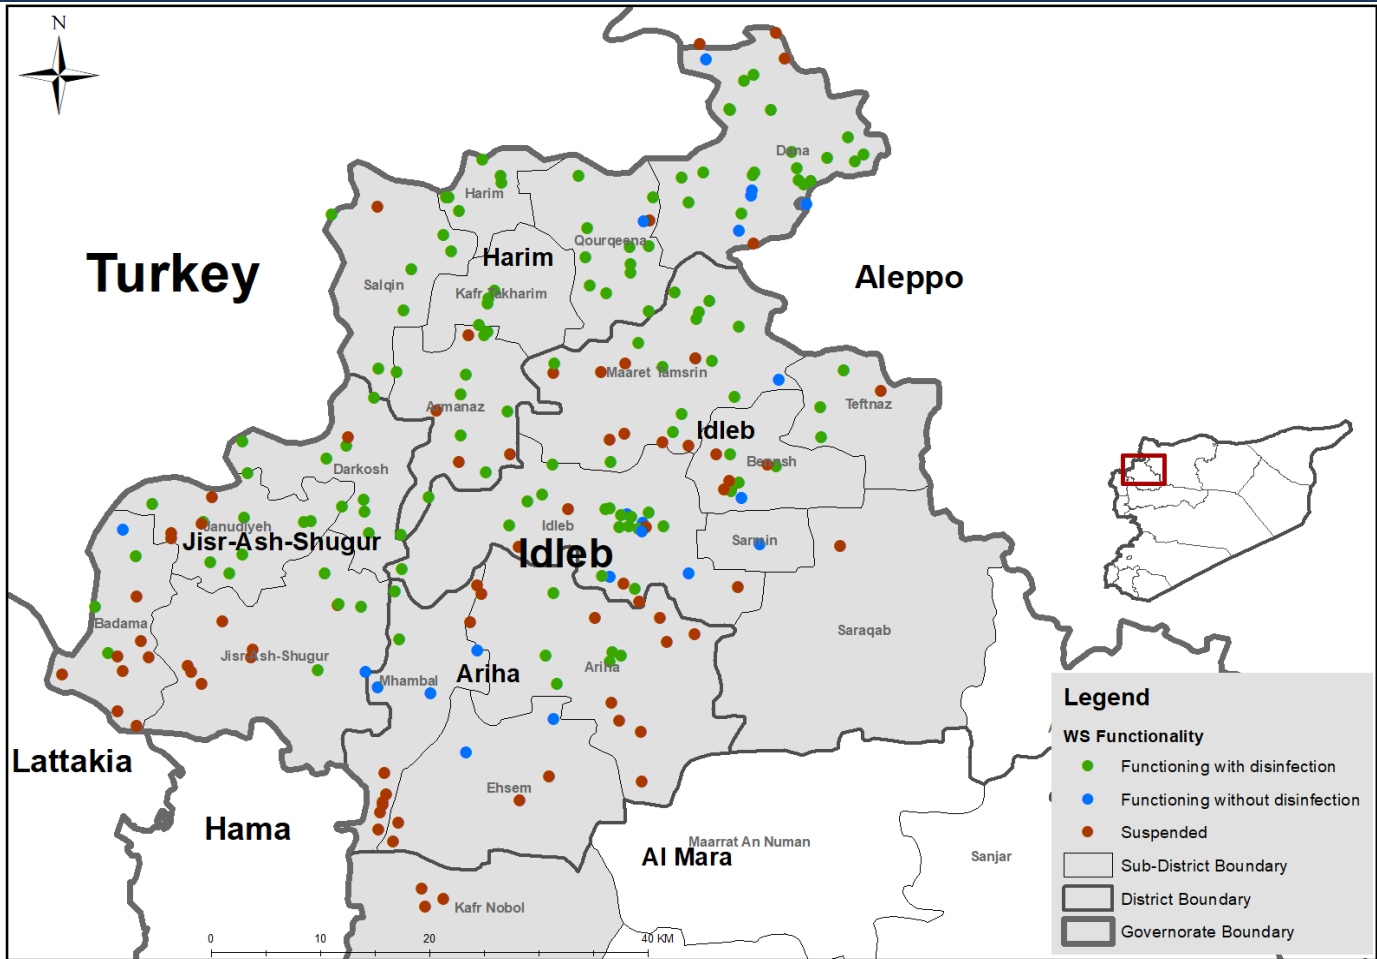


Drinking Water Stations Distribution in Idleb (Camps Water Stations)

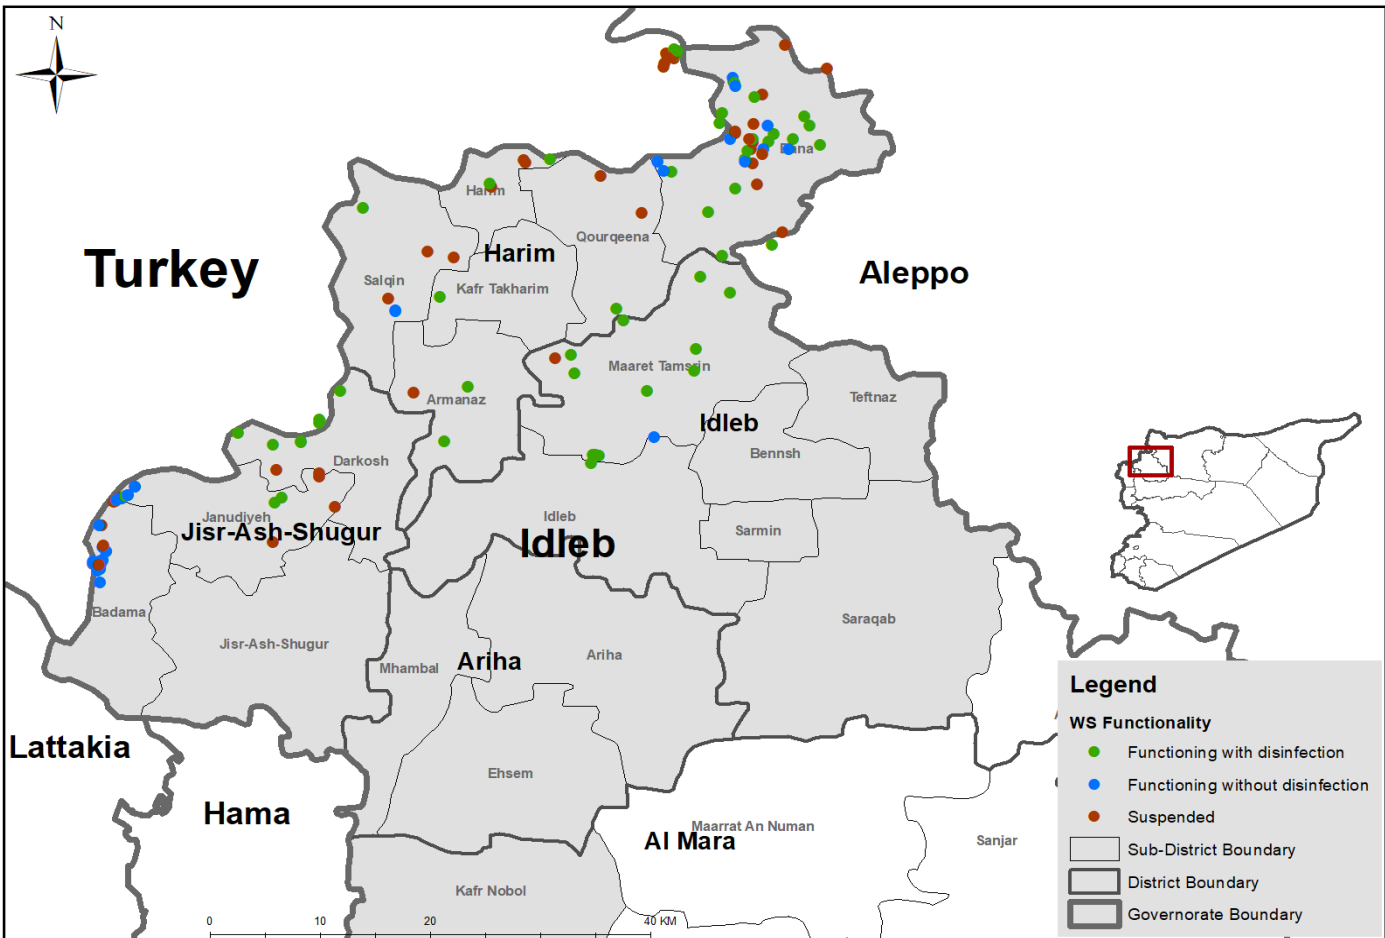


Drinking Water Stations Distribution in Hama

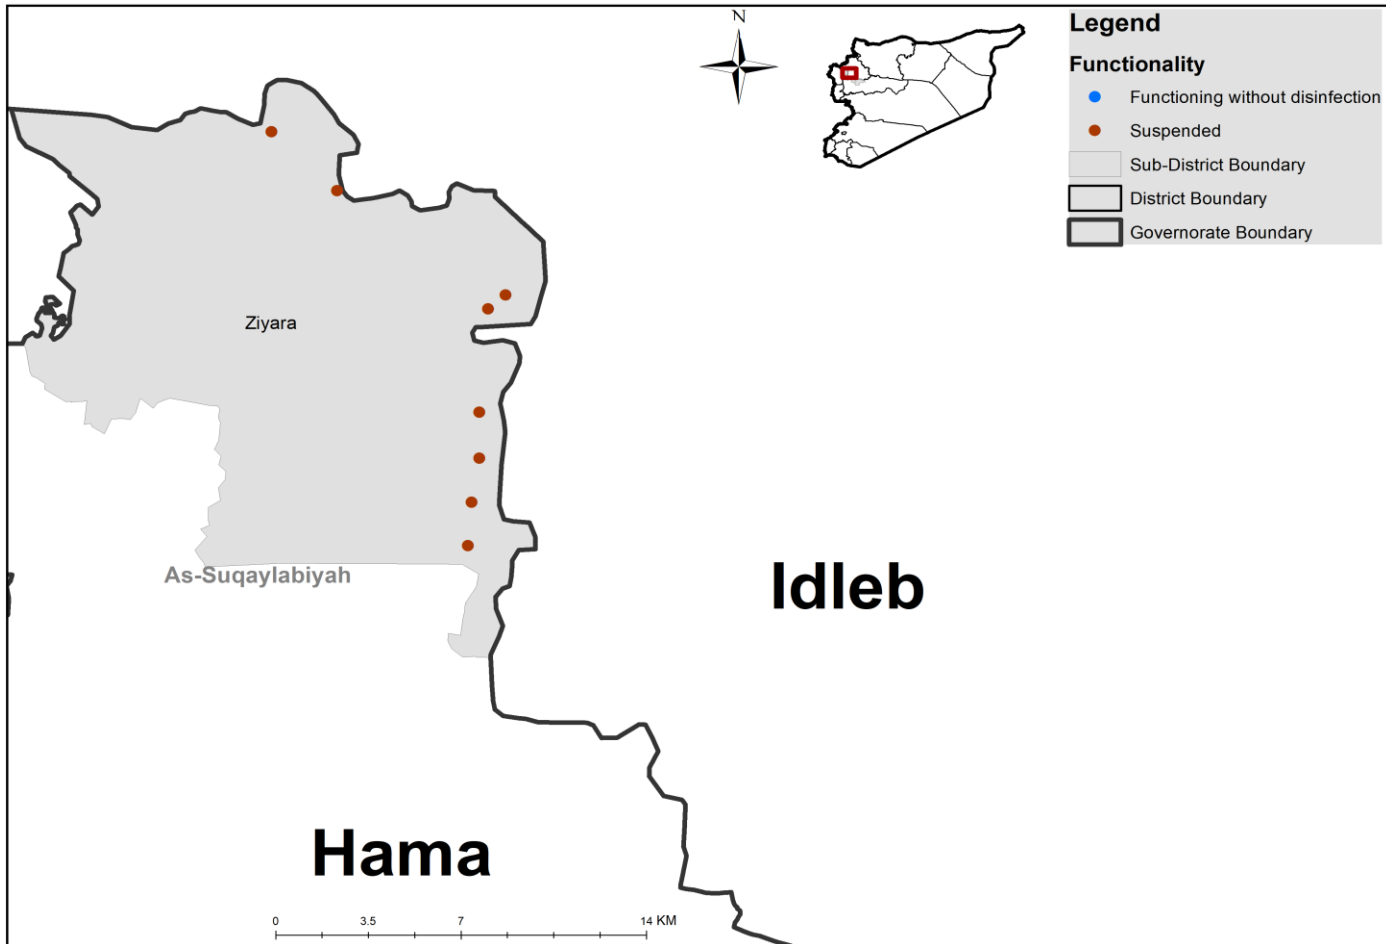

Drinking Water Stations Distribution in Ar-raqqa

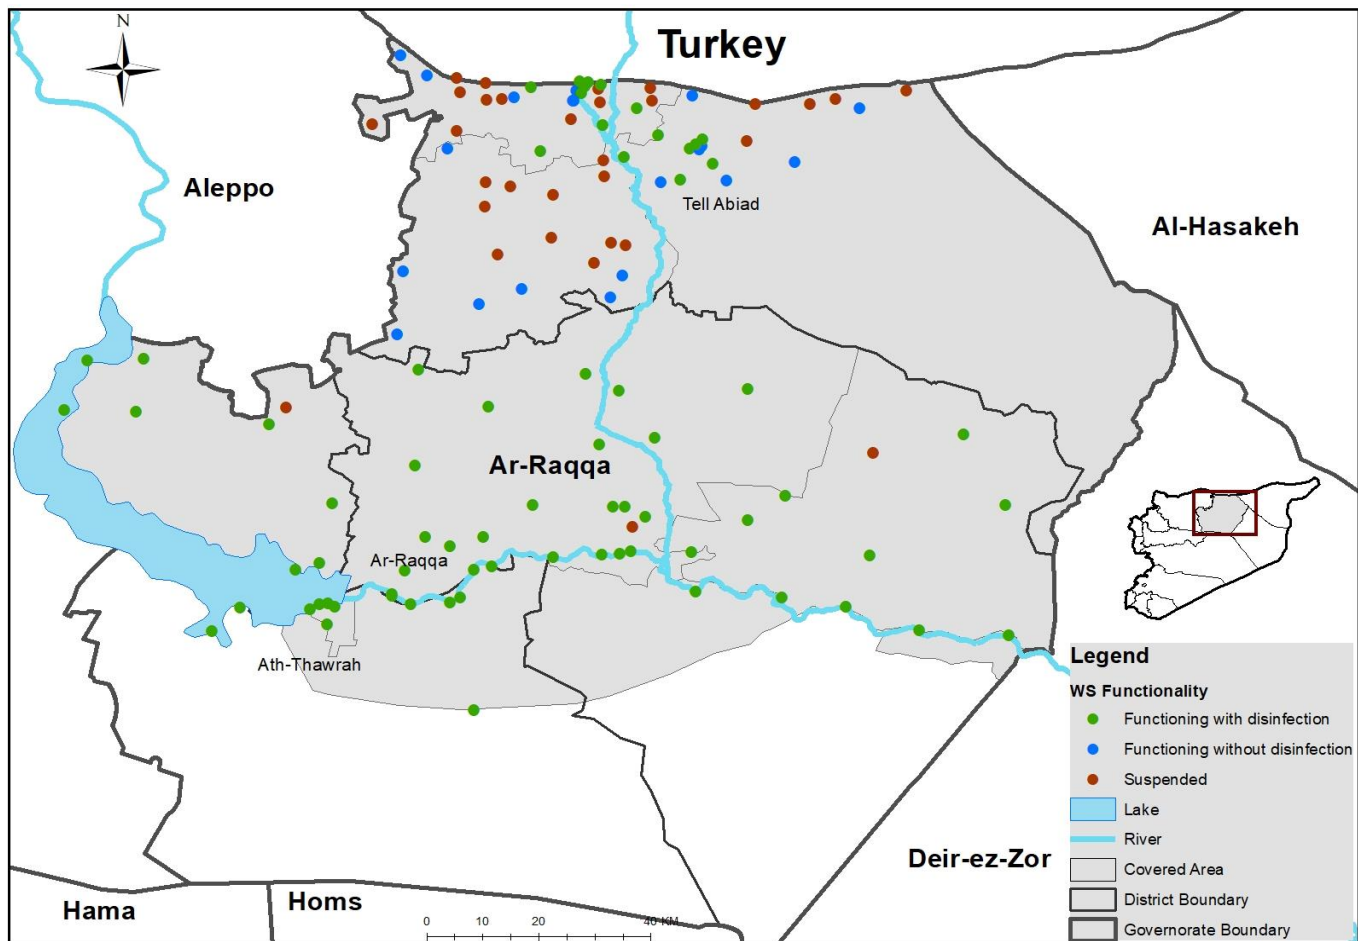

Drinking Water Stations Distribution in Deir-ez-Zor

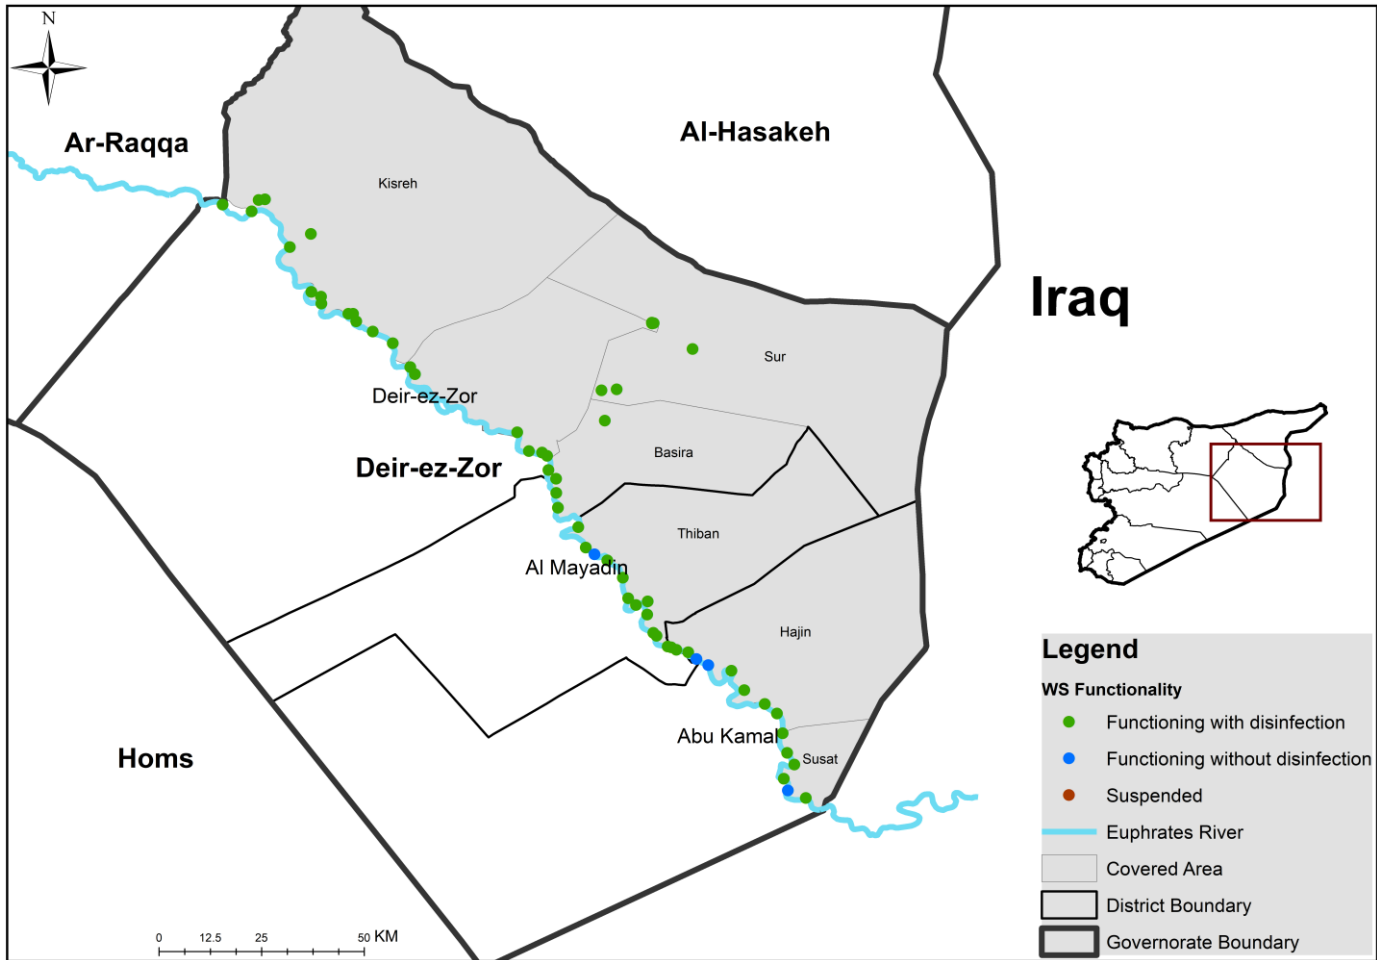

Drinking Water Stations Distribution in Al-Hasakeh

