






WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network

Date: 8 Oct - 21 Oct 2023 Week No. 41-42


Highlights

- This report covers 1327 public drinking water stations monitored in 6 governorates, 1109 community-based, and 218 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 73% (963/1327) were functioning, while 27% (364/1327) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 22%, and the percentage of the suspended stations due to the need for total-scale maintenance is 25%, of the total suspended water stations.
- Of the water stations, 33% depend on the grid and 32% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 63% (606/963).
- Of the functioning water stations, percentage of 88% (838/963) delivered water using a piping network, percentage of 08% (61/963) delivered water using water trucking and percentage of 04% (59/963) delivered water using both, and 01% (5/963) delivered water using manhal.
- 20 water quality tests were conducted, 05 of them were contaminated.


EWARN Coverage

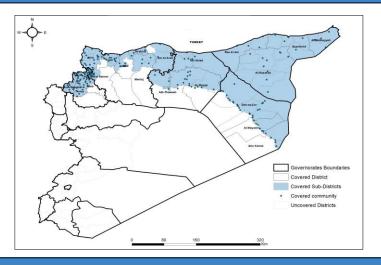

WASH Coverage by EWARN

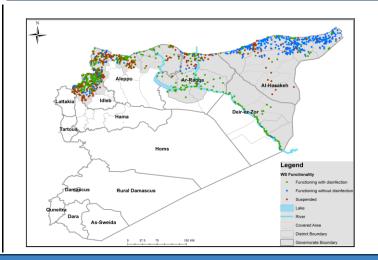

Completeness and Timeliness of Biweekly Reports

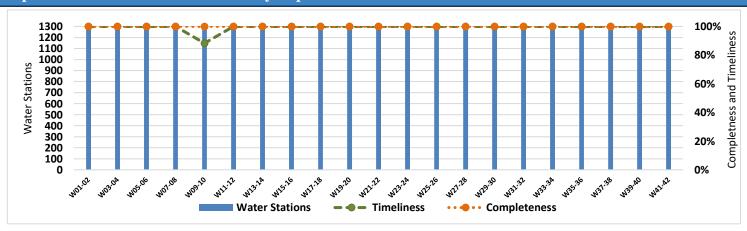



Drinking Water Stations Status in Each Governorate

| | Drinking Water Stations Status | | | | |
|----------------------|--------------------------------|-----|------------|--|--|
| Governorate | Total Functionii | | Percentage | | |
| Aleppo (Communities) | 260 | 148 | 57% | | |
| Aleppo (Camps) | 51 | 21 | 41% | | |
| Idleb (Communities) | 231 | 148 | 64% | | |
| Idleb (Camps) | 167 | 118 | 71% | | |
| Hama | 8 | 0 | 0% | | |
| Ar-raqqa | 122 | 93 | 76% | | |
| Deir-ez-Zor | 61 | 59 | 97% | | |
| Al-Hasakeh | 427 | 376 | 88% | | |
| Total | 1327 | 963 | 73% | | |


| | Functioning DWS Clorination Status | | | | |
|----------------------|------------------------------------|-------------------|------------|--|--|
| Governorate | Total | With disinfection | Percentage | | |
| Aleppo (Communities) | 148 | 131 | 89% | | |
| Aleppo (Camps) | 21 | 16 | 76% | | |
| Idleb (Communities) | 148 | 133 | 90% | | |
| Idleb (Camps) | 118 | 81 | 69% | | |
| Hama | 0 | 0 | 0% | | |
| Ar-raqqa | 93 | 77 | 83% | | |
| Deir-ez-Zor | 59 | 56 | 95% | | |
| Al-Hasakeh | 376 | 112 | 30% | | |
| Total | 963 | 606 | 63% | | |

Drinking Water Stations Status

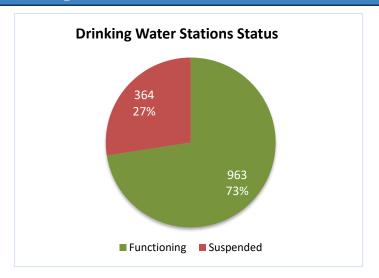

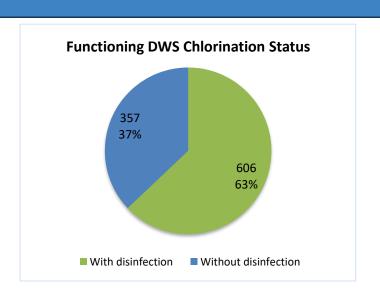


Drinking Water Stations Status in Governorates

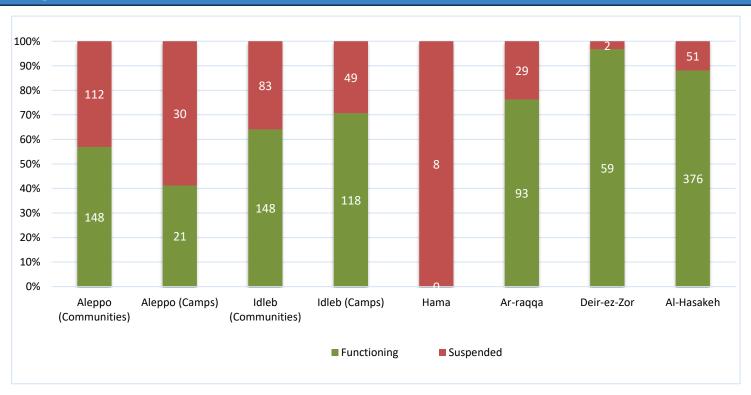


The Reason for Suspension

| Governorate | Temporary suspension | Lack of operational costs | Under maintenance | Need for simple- scale maintenance | Need for moderate- scale maintenance | Need for total-scale maintenance | Military issues | Totally destroyed |
|-------------|-------------------------|---------------------------|----------------------|---------------------------------------|---|-------------------------------------|--------------------|----------------------|
| Aleppo | 25 | 30 | 4 | 5 | 22 | 41 | 9 | 6 |
| Idleb | 9 | 41 | 4 | 12 | 11 | 40 | 11 | 3 |
| Hama | 0 | 0 | 0 | 0 | 0 | 0 | 8 | 0 |
| Ar-raqqa | 2 | 6 | 0 | 3 | 5 | 4 | 9 | 0 |
| Deir-ez-Zor | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 |
| Al-Hasakeh | 18 | 3 | 0 | 0 | 1 | 5 | 22 | 2 |
| Total | 54 | 80 | 8 | 20 | 39 | 91 | 60 | 11 |

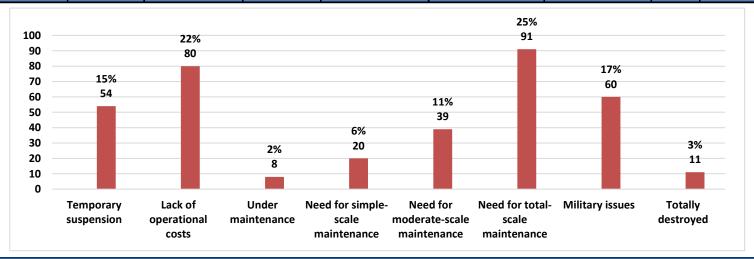


Source of the Electric Power


| Governorate | Grid | Generator | Solar power | Grid and generator | Grid and solar power | Generator and solar power | Grid and generator and solar power |
|-------------|------|-----------|-------------|--------------------|----------------------|---------------------------|------------------------------------|
| Aleppo | 21 | 164 | 15 | 45 | 3 | 43 | 20 |
| Idleb | 9 | 237 | 35 | 34 | 5 | 68 | 10 |
| Hama | 0 | 8 | 0 | 0 | 0 | 0 | 0 |
| Ar-raqqa | 77 | 3 | 4 | 34 | 0 | 2 | 2 |
| Deir-ez-Zor | 0 | 12 | 0 | 49 | 0 | 0 | 0 |
| Al-Hasakeh | 336 | 3 | 0 | 66 | 13 | 0 | 9 |
| Total | 443 | 427 | 54 | 228 | 21 | 113 | 41 |

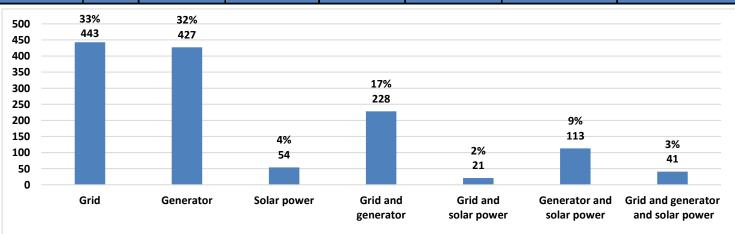


Functioning Drinking Water Stations Clorination Status

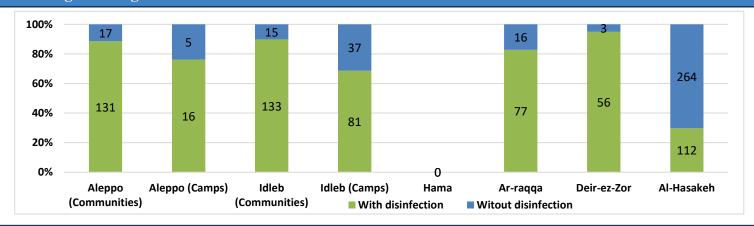

The Reason for not Chlorination

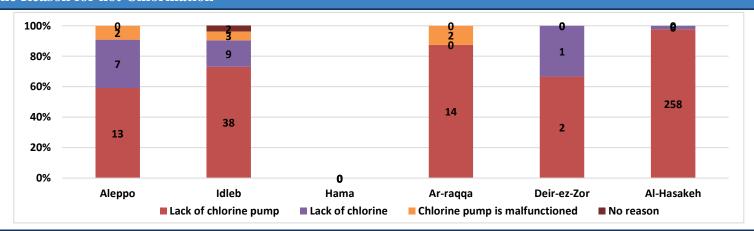


Chlorination Status Over Weeks

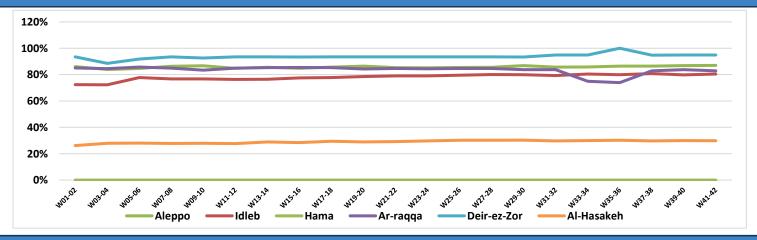


Connection Method


| | | Method | | | | |
|-------------|-----------------|---------|-------------------|------|--------|--|
| Governorate | Functioning DWS | Network | Water Trucking | Both | Manhal | |
| Aleppo | 169 | 148 | 2 | 14 | 5 | |
| Idleb | 266 | 171 | 52 | 43 | 0 | |
| Hama | 0 | 0 | 0 | 0 | 0 | |
| Ar-raqqa | 93 | 90 | 2 | 1 | 0 | |
| Deir-ez-Zor | 59 | 55 | 4 | 0 | 0 | |
| Al-Hasakeh | 376 | 374 | 1 | 1 | 0 | |
| Total | 963 | 838 | 61 | 59 | 5 | |

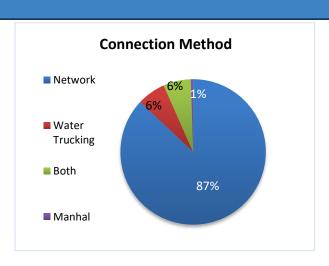


Drinking Water Stations Distribution in Aleppo (Communities Water Stations)

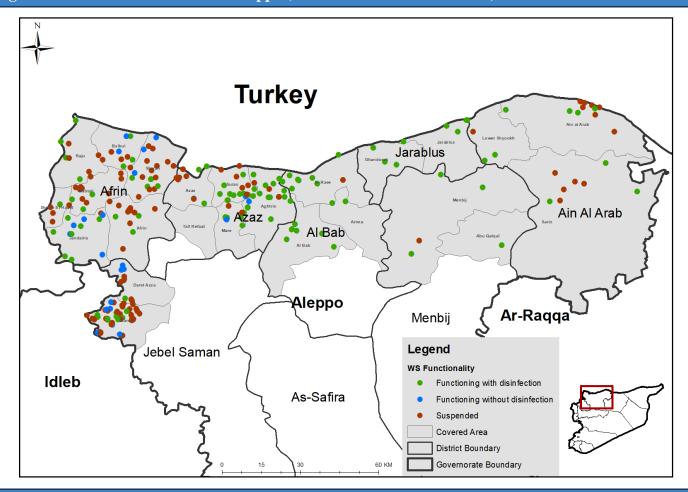


Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

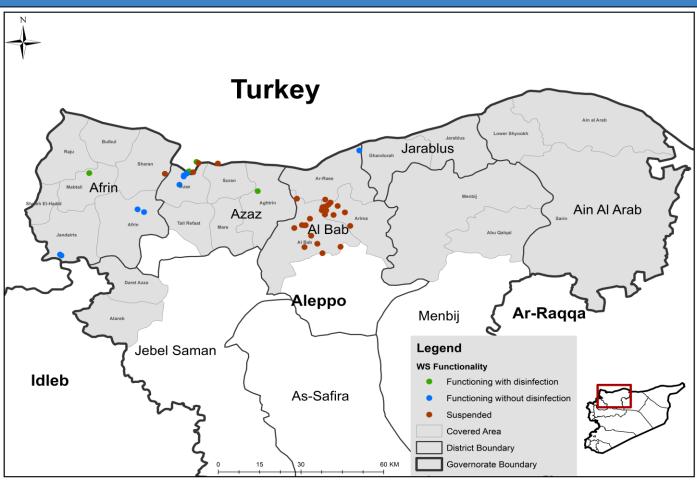


Drinking Water Stations Distribution in Idleb (Communities Water Stations)

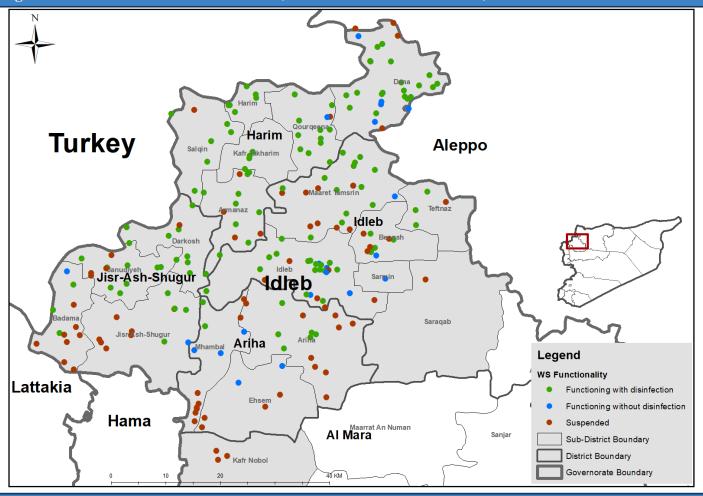


Drinking Water Stations Distribution in Idleb (Camps Water Stations)

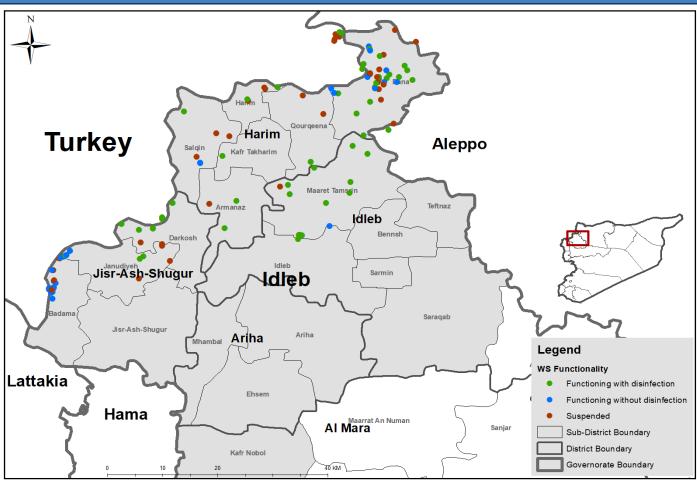


Drinking Water Stations Distribution in Hama

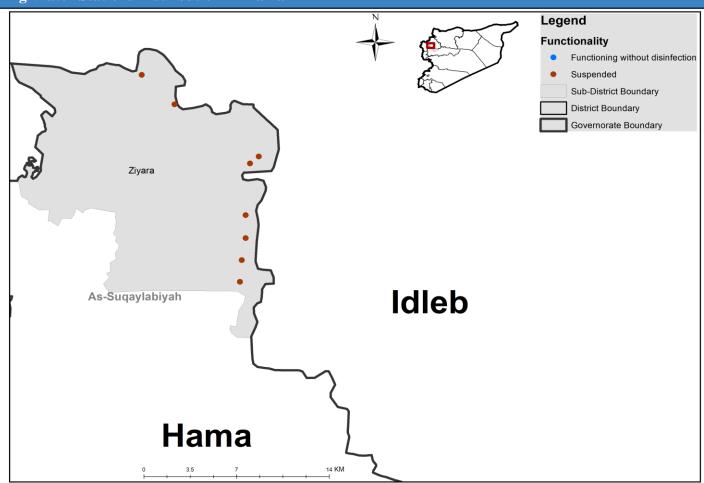


Drinking Water Stations Distribution in Ar-raqqa

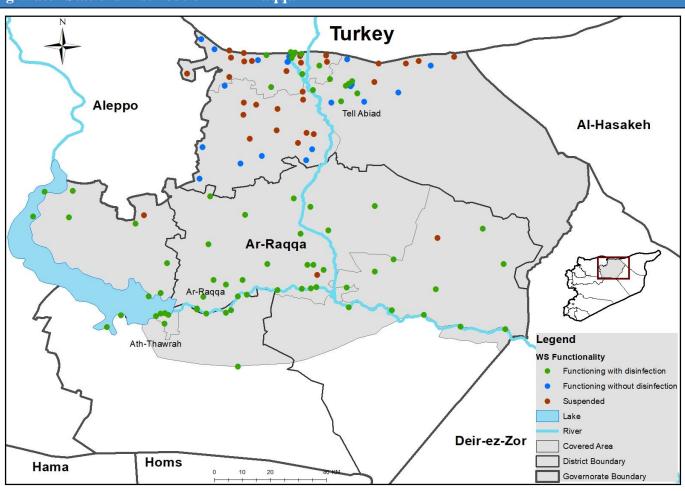

Drinking Water Stations Distribution in Deir-ez-Zor

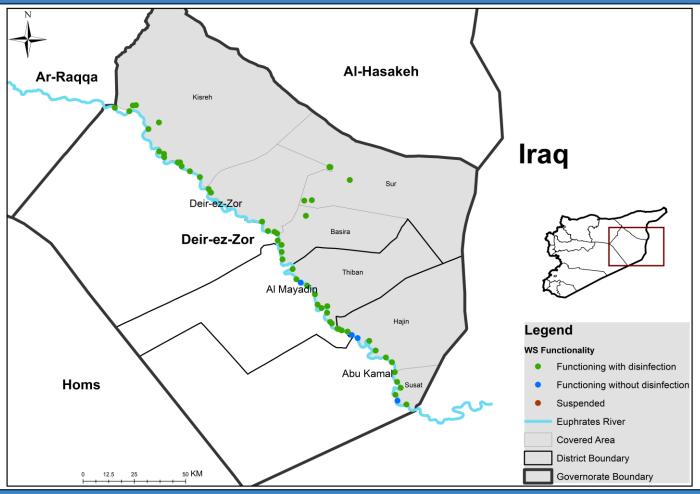

Drinking Water Stations Distribution in Al-Hasakeh

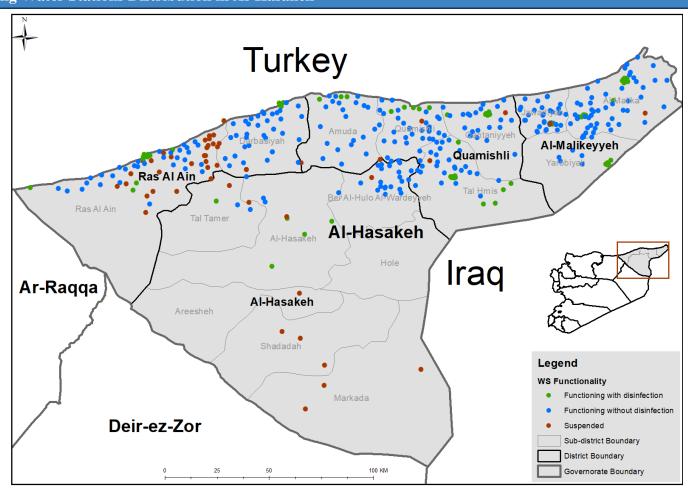

WASH Bulletin EN - Syria EWARN Week 41-42 2023