

## WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network


Date: 22 Oct - 4 Nov 2023

Week No. 43-44


### Highlights

- This report covers 1328 public drinking water stations monitored in 6 governorates, 1110 community-based, and 218 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 72% (961/1328) were functioning, while 28% (367/1328) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 22%, and the percentage of the suspended stations due to the need for total-scale maintenance is 25%, of the total suspended water stations.
- Of the water stations, 33% depend on the grid and 32% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 63% (607/961).
- Of the functioning water stations, percentage of 88% (836/961) delivered water using a piping network, percentage of 08% (61/961) delivered water using water trucking and percentage of 04% (59/961) delivered water using both, and 01% (5/961) delivered water using manhal.
- 44 water quality tests were conducted, 06 of them were contaminated.


### EWARN Coverage

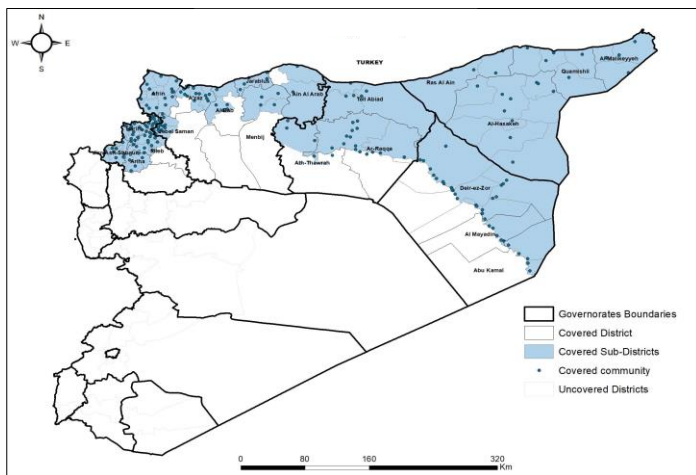

### WASH Coverage by EWARN

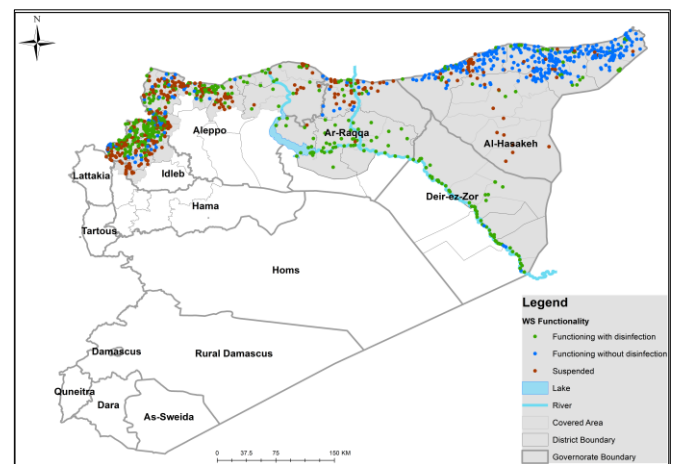

### Completeness and Timeliness of Biweekly Reports


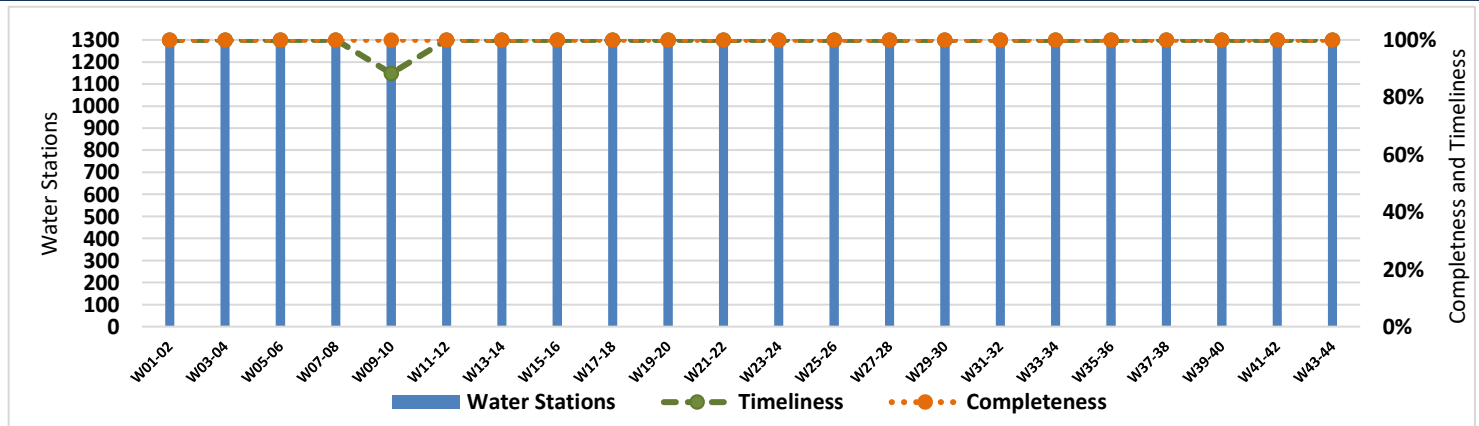


## Drinking Water Stations Status in Each Governorate


Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Communities)	261	149	57%
Aleppo (Camps)	51	21	41%
Idleb (Communities)	231	148	64%
Idleb (Camps)	167	118	71%
Hama	8	0	0%
Ar-raqqa	122	93	76%
Deir-ez-Zor	61	58	95%
Al-Hasakeh	427	374	88%
<b>Total</b>	<b>1328</b>	<b>961</b>	<b>72%</b>

Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Communities)	149	132	89%
Aleppo (Camps)	21	16	76%
Idleb (Communities)	148	133	90%
Idleb (Camps)	118	81	69%
Hama	0	0	0%
Ar-raqqa	93	78	84%
Deir-ez-Zor	58	55	95%
Al-Hasakeh	374	112	30%
<b>Total</b>	<b>961</b>	<b>607</b>	<b>63%</b>

## Drinking Water Stations Status

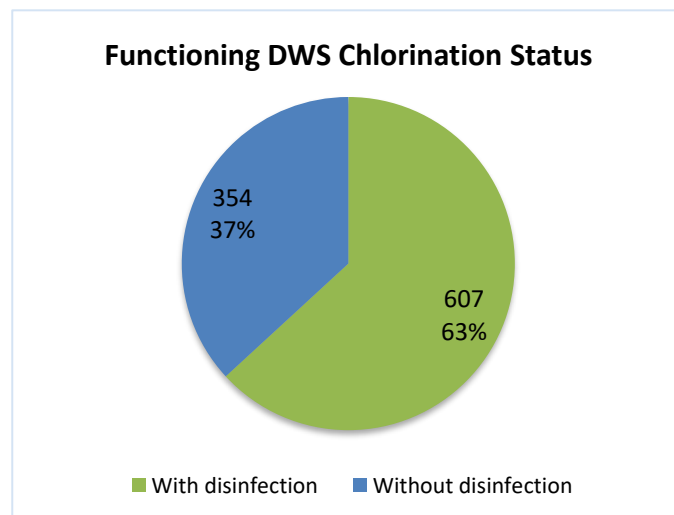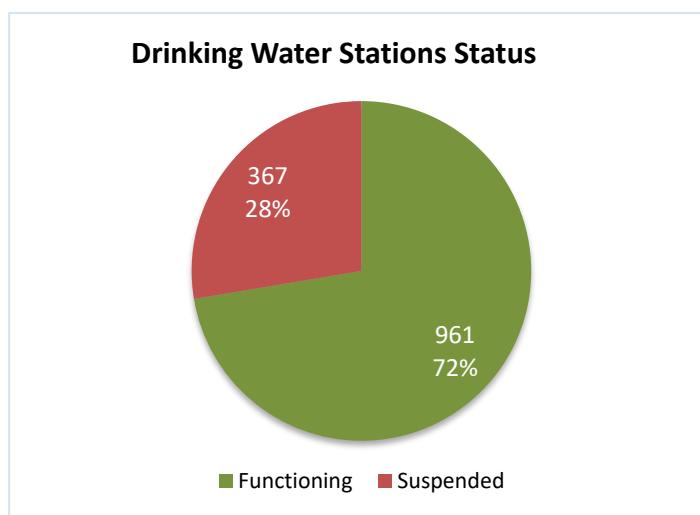


## Drinking Water Stations Status in Governorates

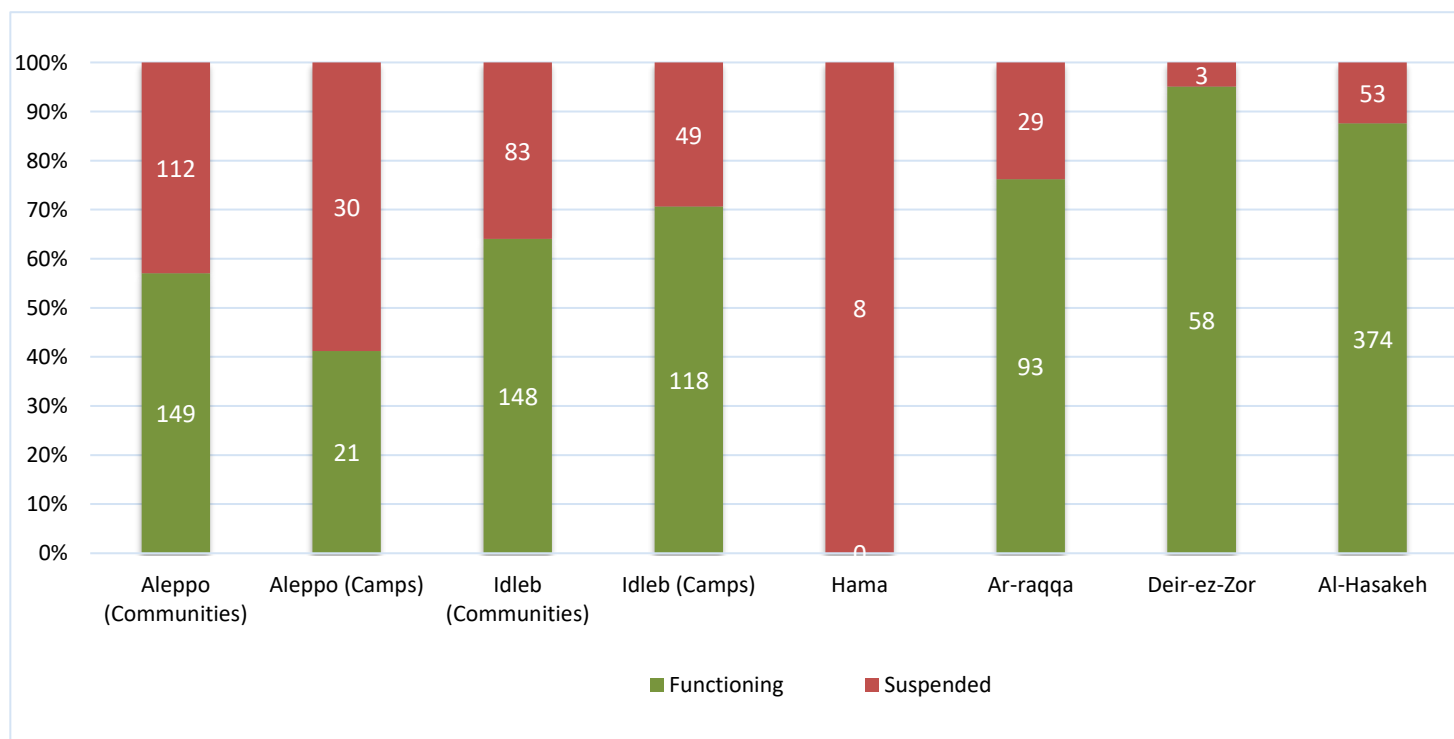


## The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	25	31	3	5	22	41	9	6
Idleb	9	42	4	12	11	40	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqqa	2	6	0	3	5	4	9	0
Deir-ez-Zor	0	0	0	0	0	1	2	0
Al-Hasakeh	18	3	1	1	1	5	22	2
<b>Total</b>	<b>54</b>	<b>82</b>	<b>8</b>	<b>21</b>	<b>39</b>	<b>91</b>	<b>61</b>	<b>11</b>

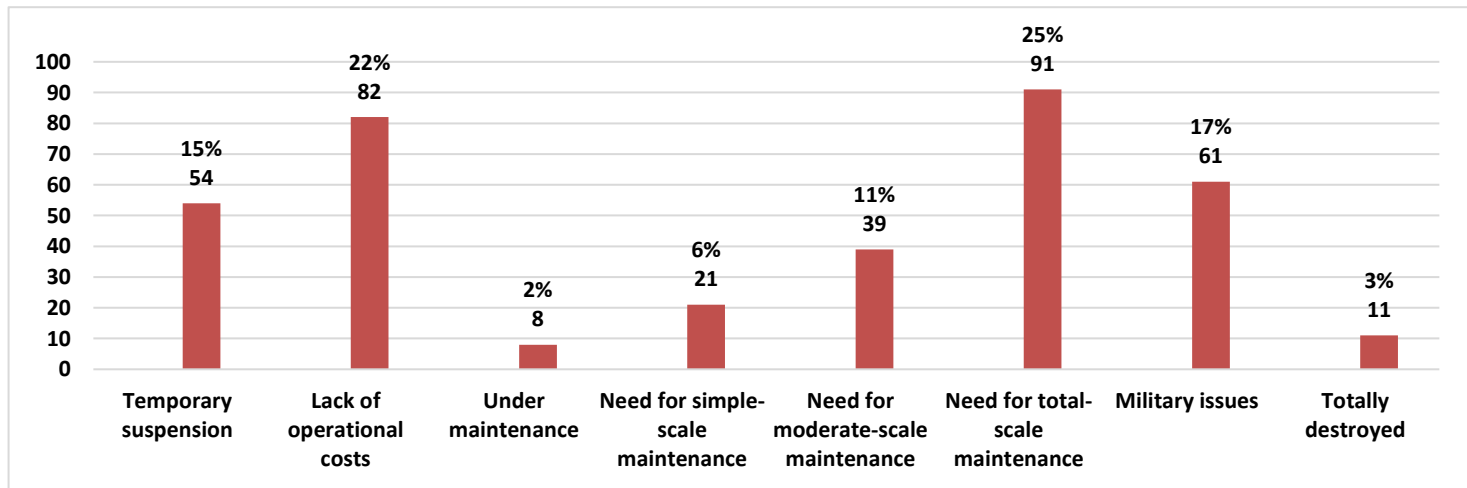


## Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	21	164	15	45	3	43	21
Idleb	9	236	35	34	5	69	10
Hama	0	8	0	0	0	0	0
Ar-raqqqa	77	2	4	30	0	5	4
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	336	3	0	66	13	0	9
<b>Total</b>	<b>443</b>	<b>425</b>	<b>54</b>	<b>224</b>	<b>21</b>	<b>117</b>	<b>44</b>

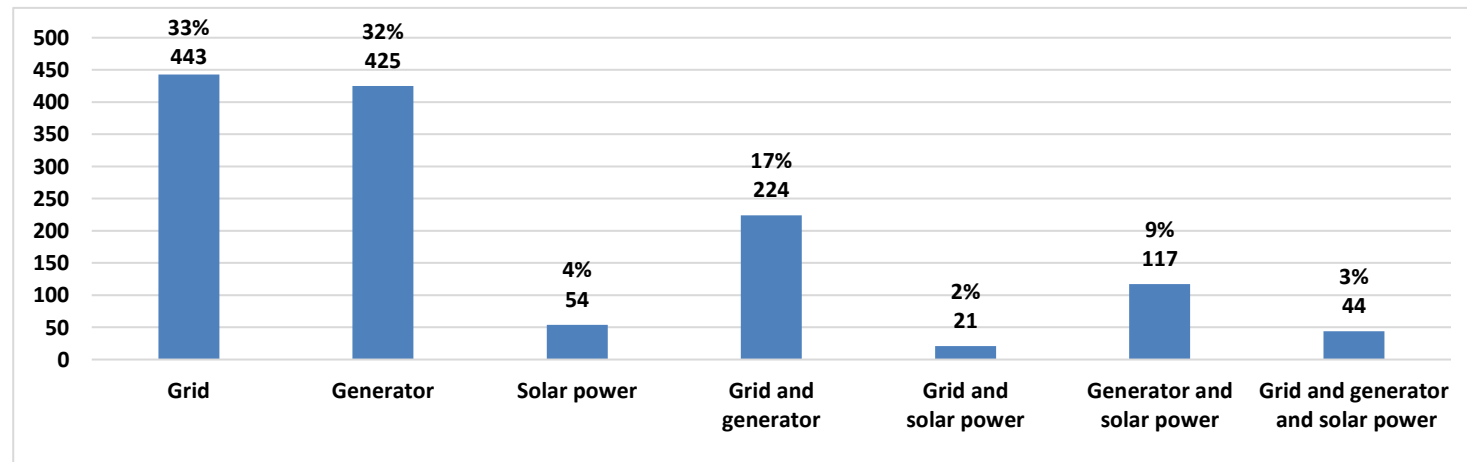


## Functioning Drinking Water Stations Chlorination Status

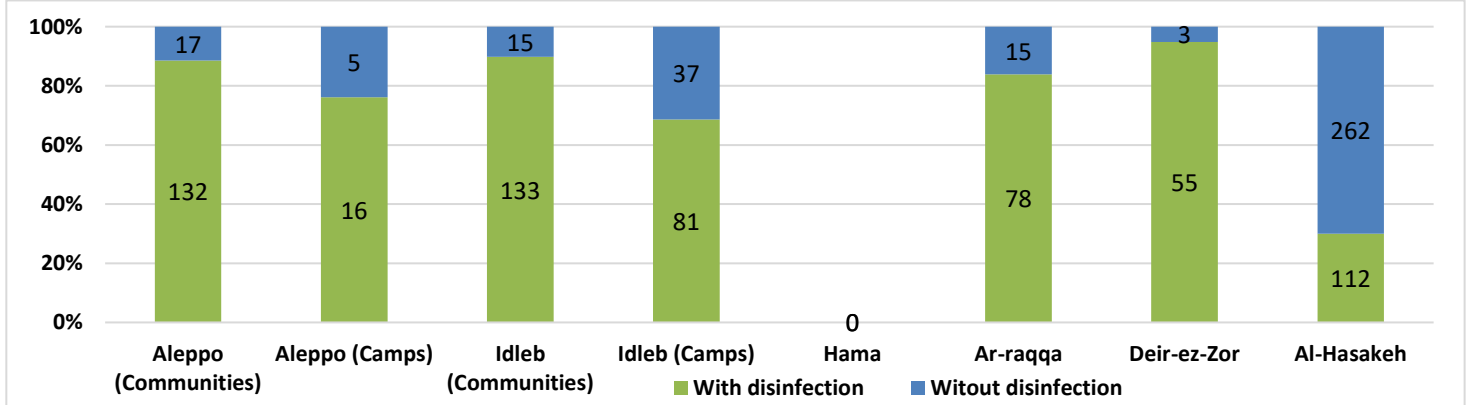

## The Reason for not Chlorination

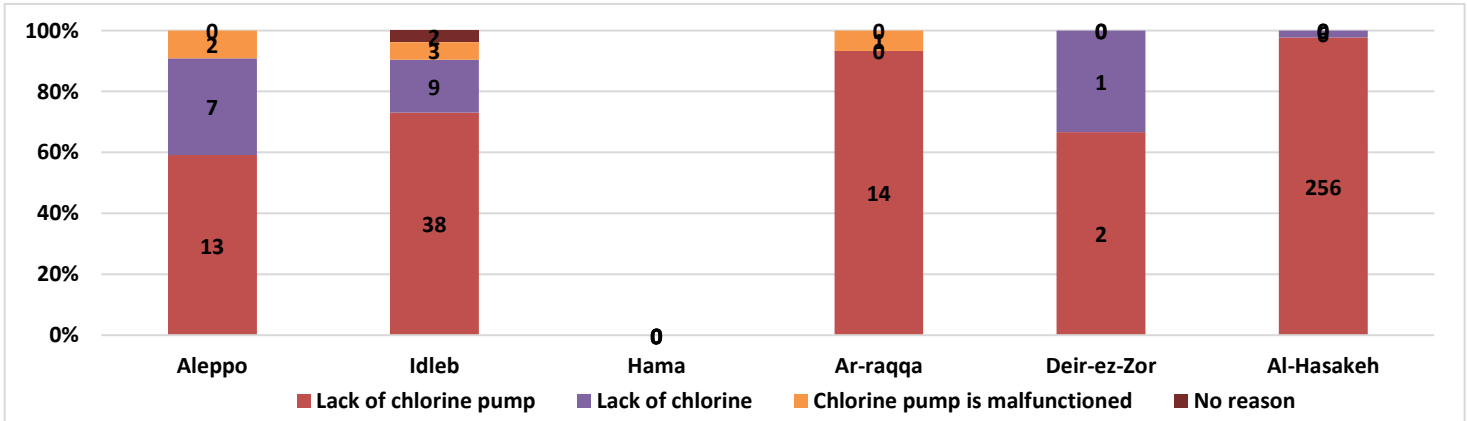


## Chlorination Status Over Weeks

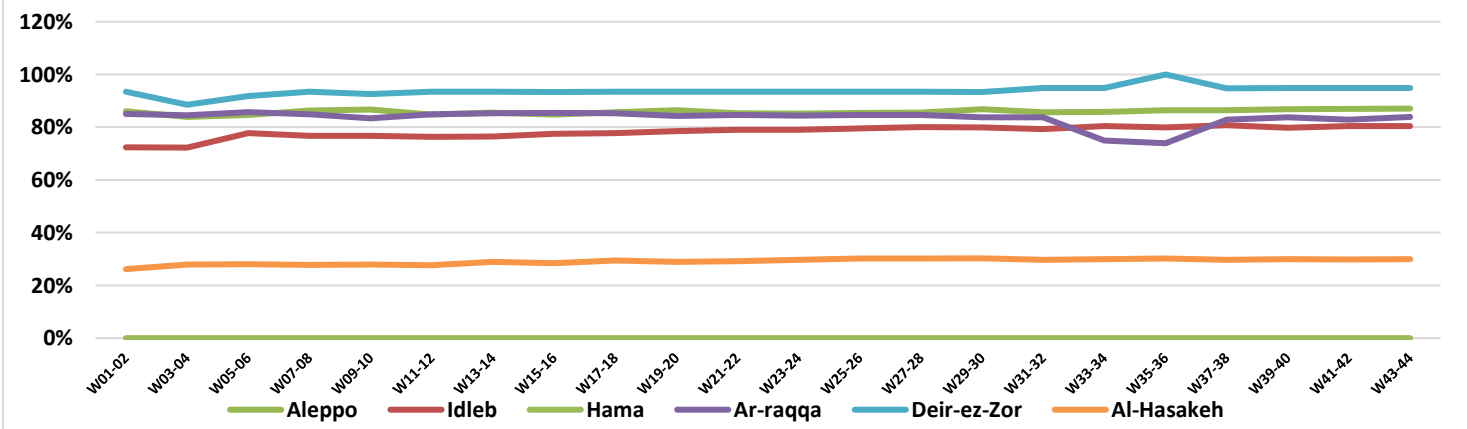


## Connection Method


Governorate	Functioning DWS	Method			
		Network	Water Trucking	Both	Manhal
Aleppo	170	149	2	14	5
Idleb	266	171	52	43	0
Hama	0	0	0	0	0
Ar-raqqa	93	90	2	1	0
Deir-ez-Zor	58	54	4	0	0
Al-Hasakeh	374	372	1	1	0
<b>Total</b>	<b>961</b>	<b>836</b>	<b>61</b>	<b>59</b>	<b>5</b>

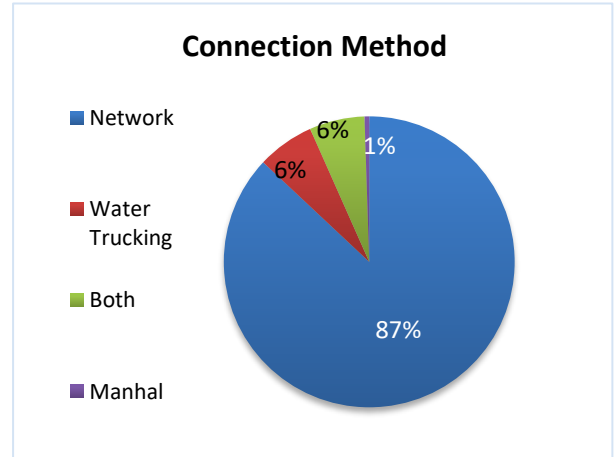


## Drinking Water Stations Distribution in Aleppo (Communities Water Stations)

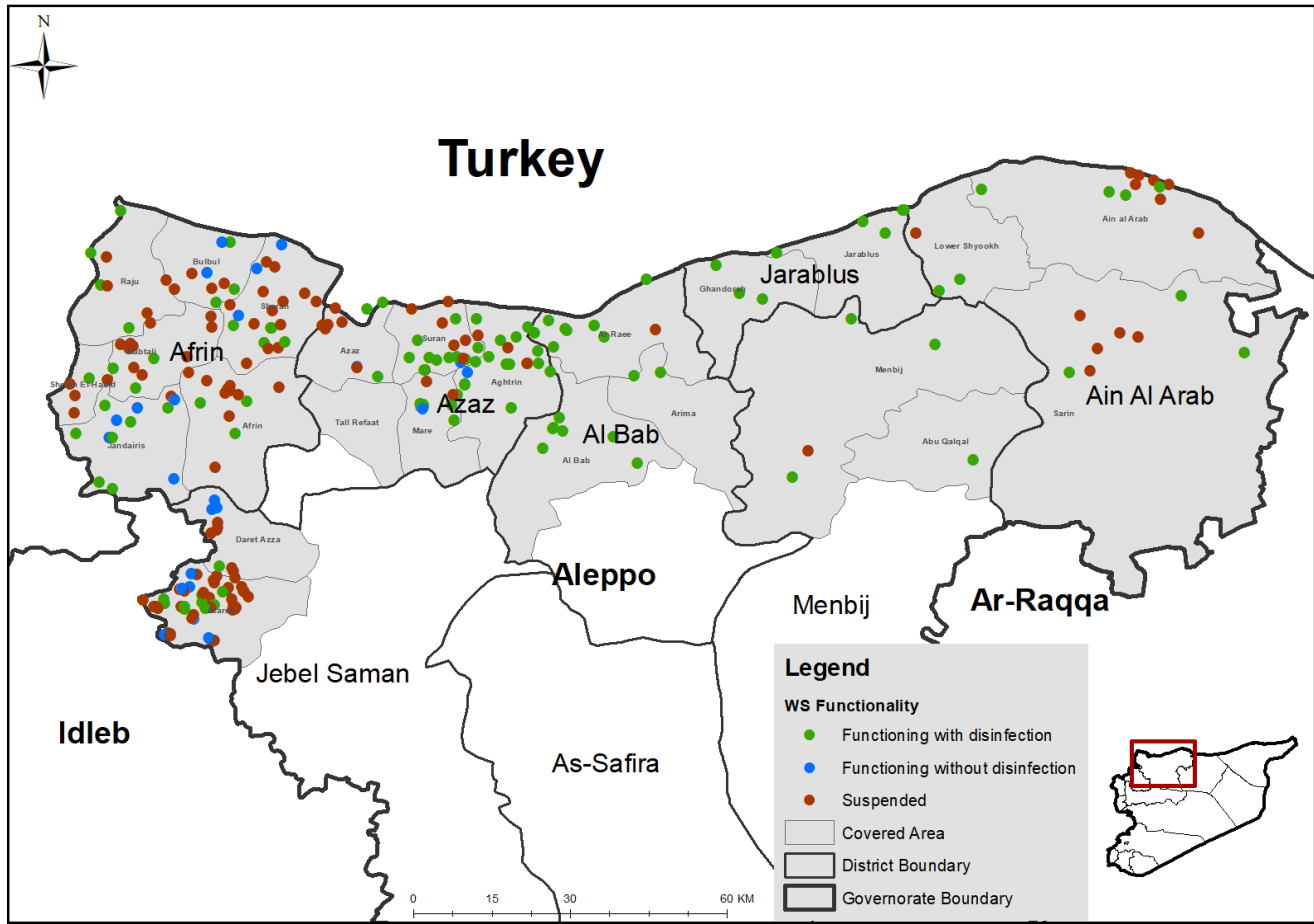


## Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

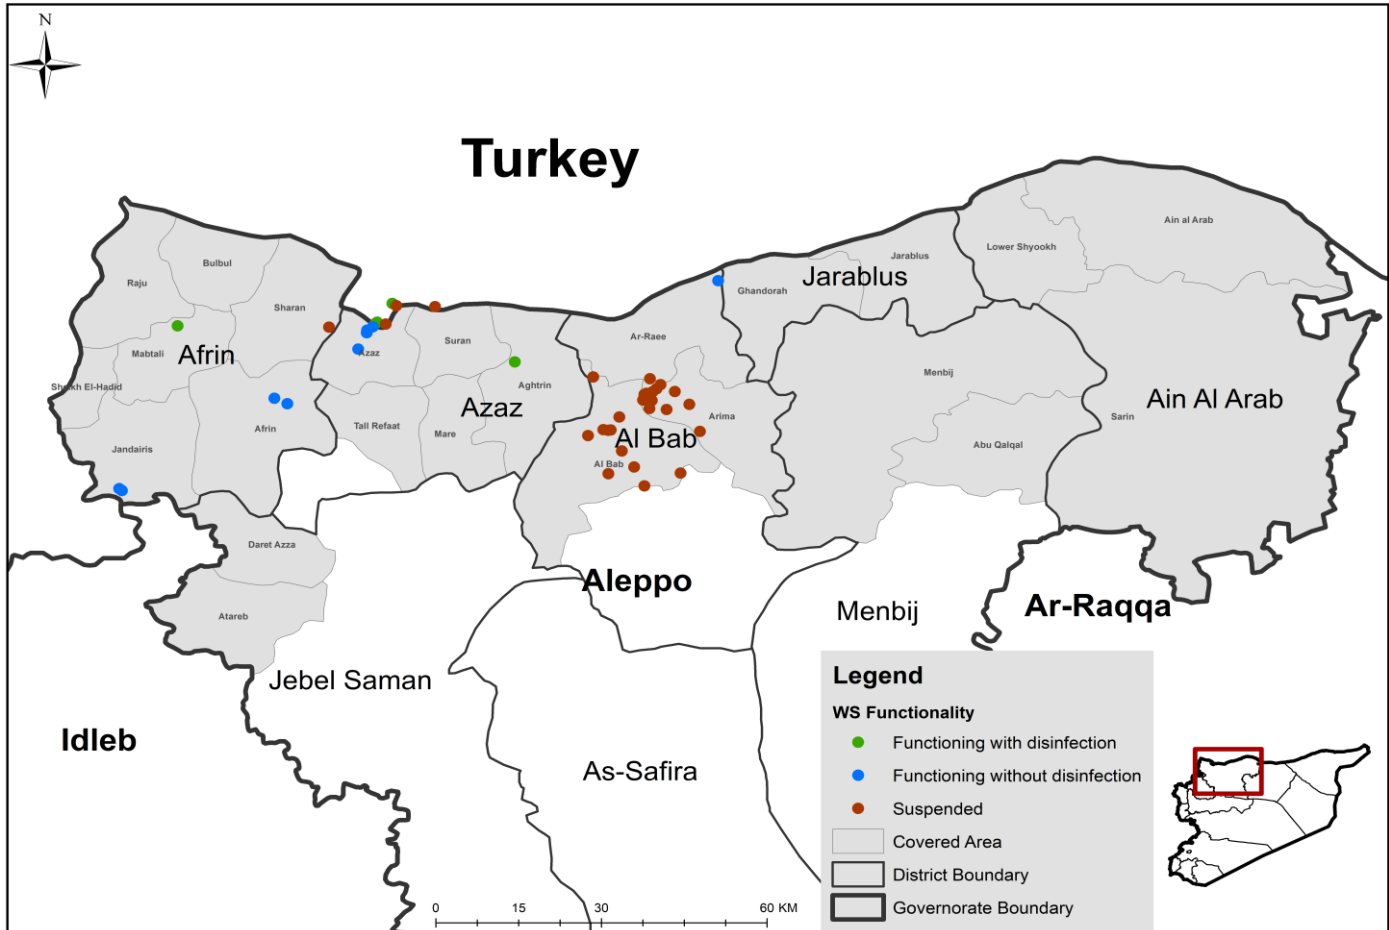


## Drinking Water Stations Distribution in Idleb (Communities Water Stations)

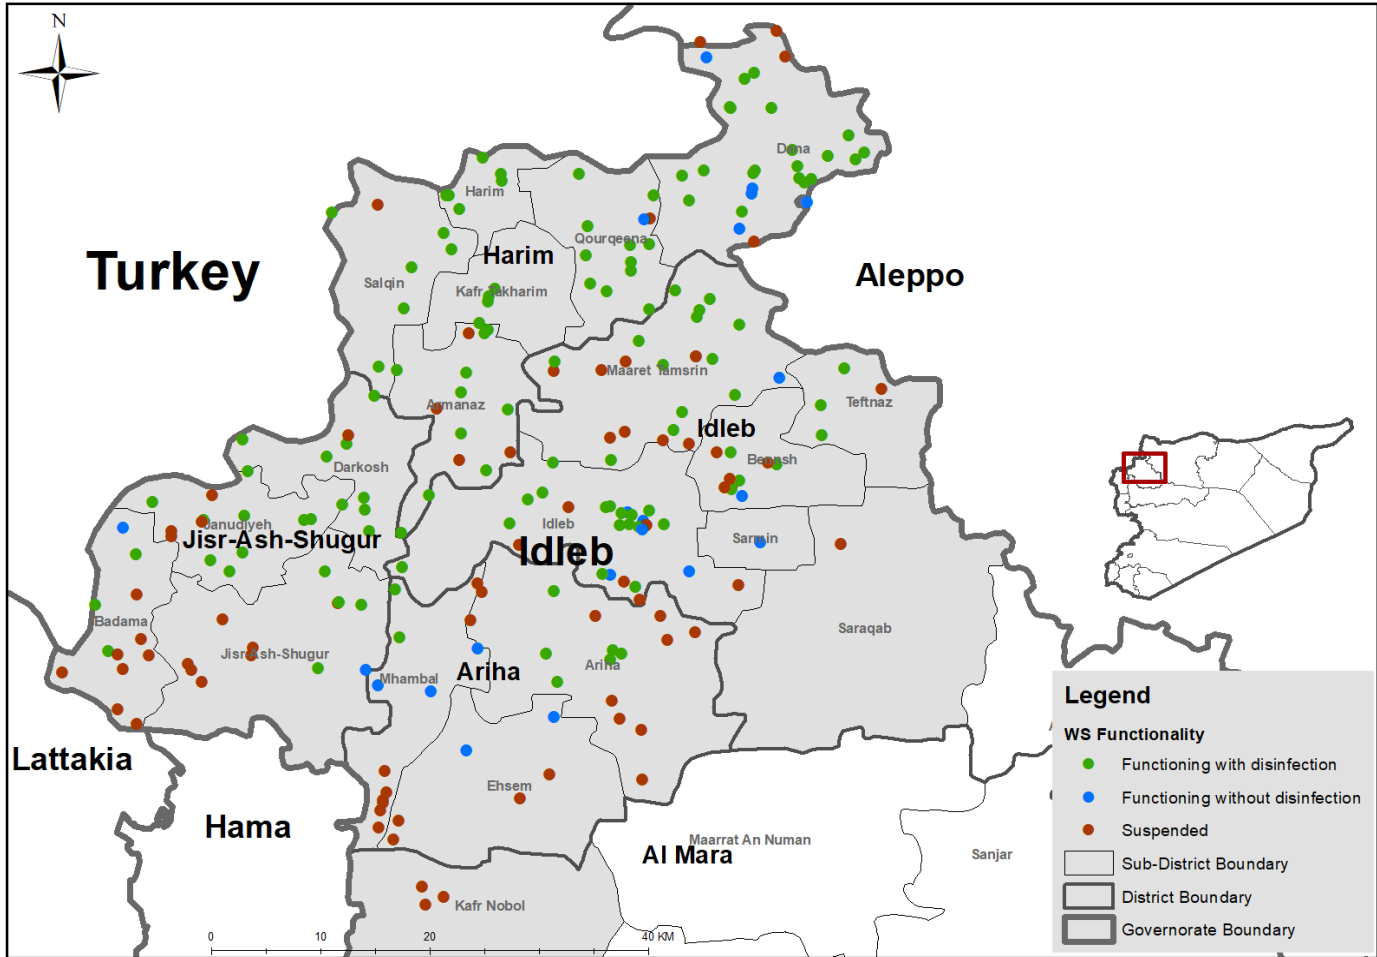


## Drinking Water Stations Distribution in Idleb (Camps Water Stations)

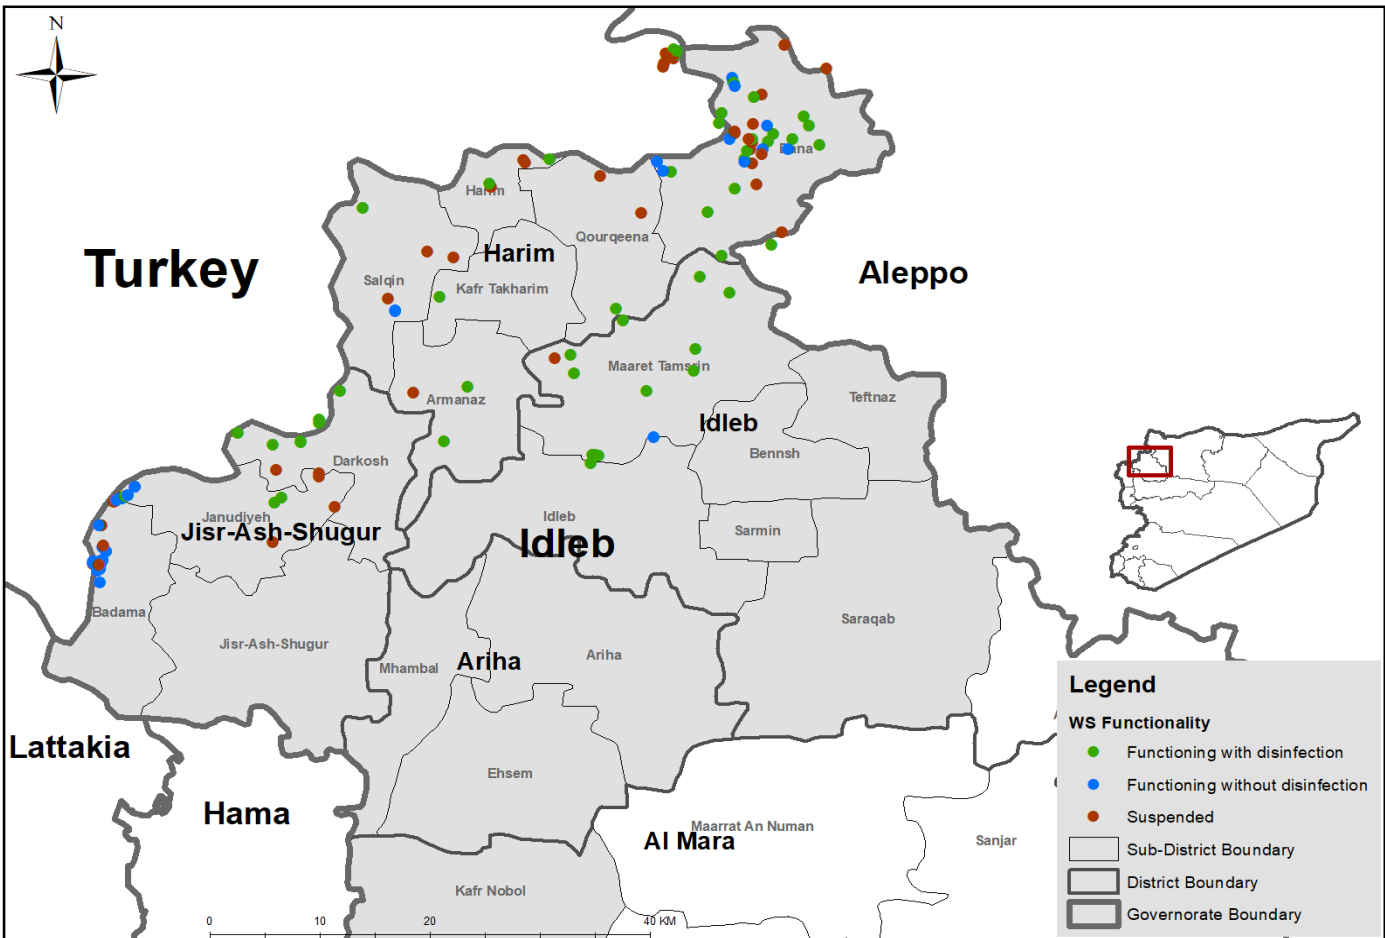


## Drinking Water Stations Distribution in Hama

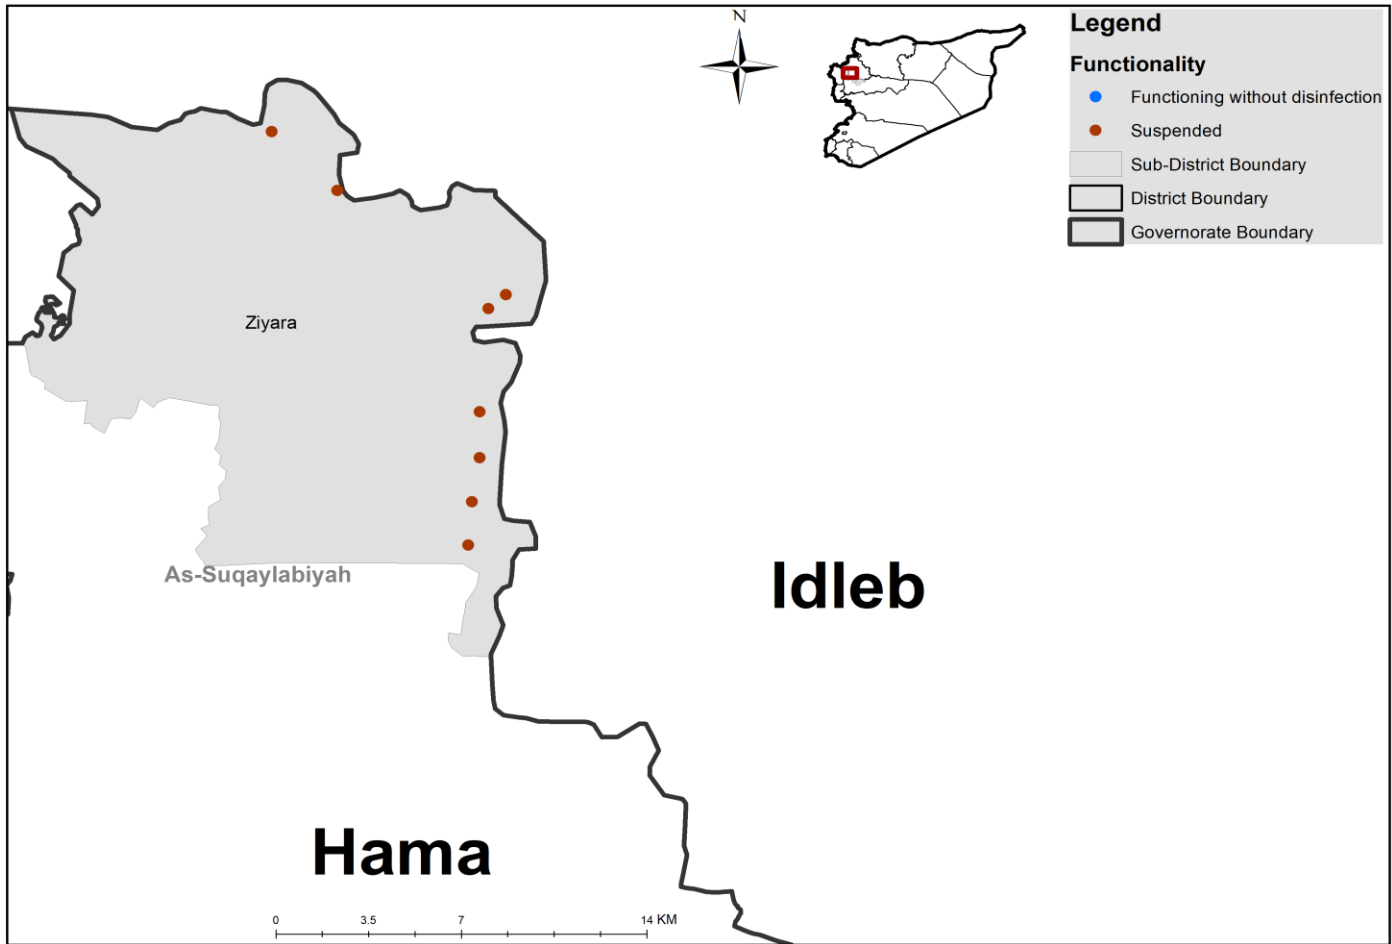

## Drinking Water Stations Distribution in Ar-raqqa

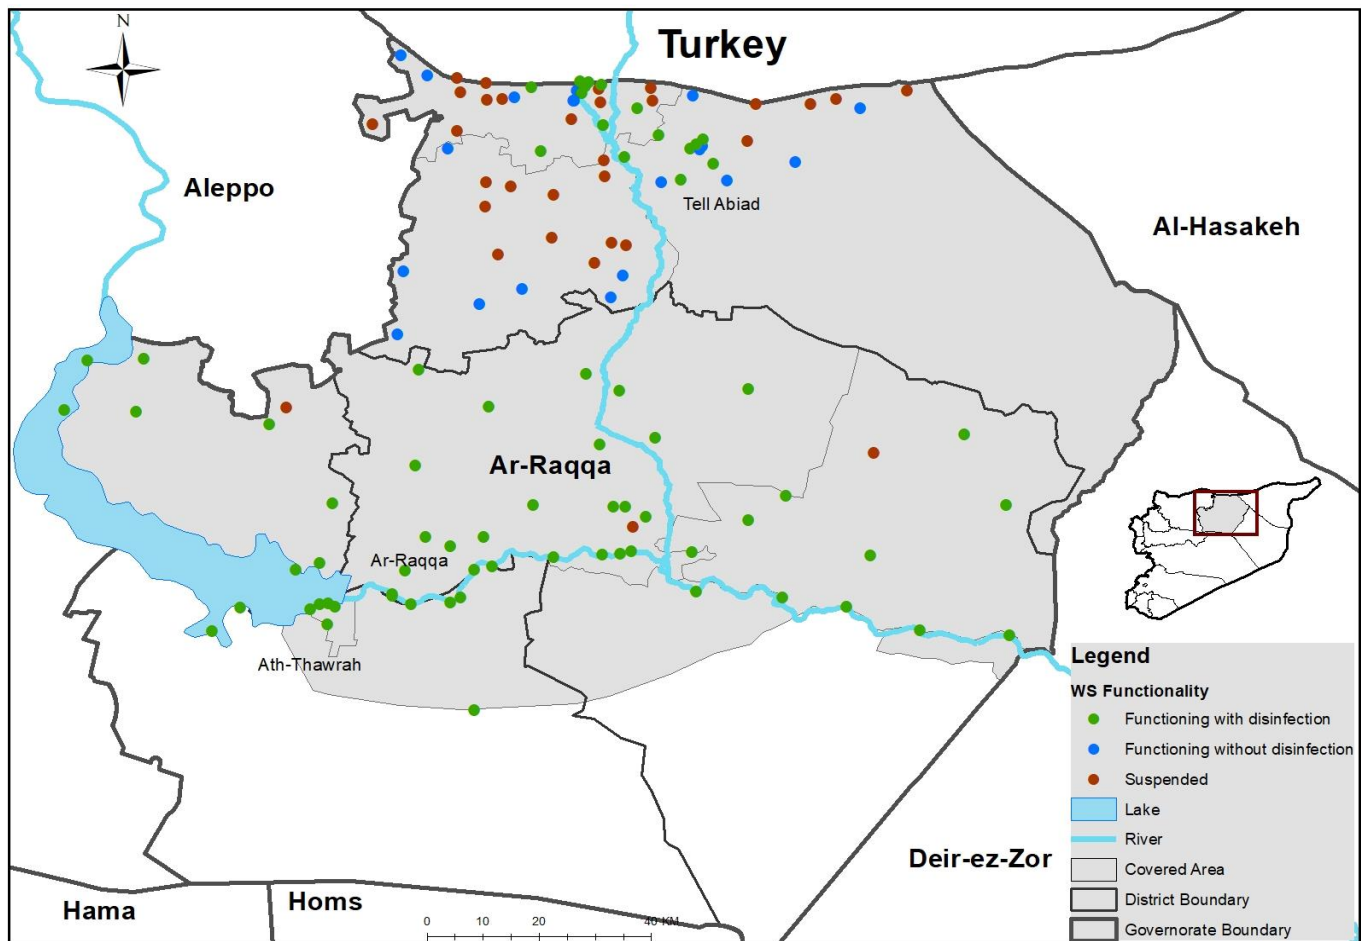

## Drinking Water Stations Distribution in Deir-ez-Zor

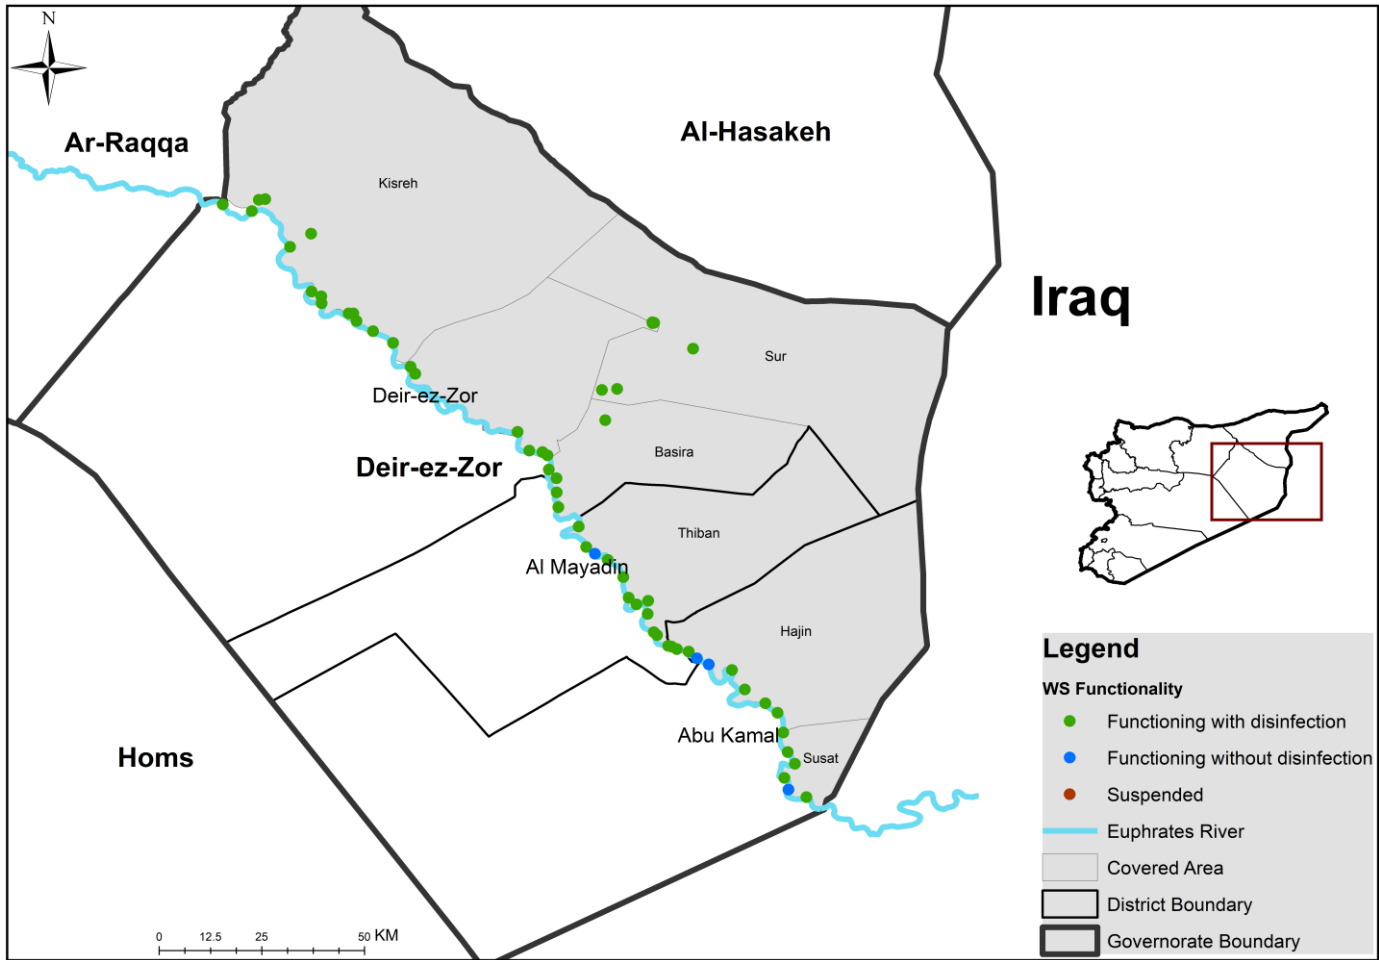

## Drinking Water Stations Distribution in Al-Hasakeh

