



WASH Biweekly Bulletin - Syria


Early Warning Alert and Response Network

Date: 14 Jul - 27 Jul 2024

Week No. 29-30

Highlights

- This report covers 1347 public drinking water stations monitored in 6 governorates, 1122 community-based, and 225 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 70% (943/1347) were functioning, while 30% (404/1347) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 21%, and the percentage of the suspended stations due to the need for total-scale maintenance is 21%, of the total suspended water stations.
- Of the water stations, 32% depend on the grid and 30% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 63% (594/943).
- Of the functioning water stations, percentage of 88% (815/943) delivered water using a piping network, percentage of 08% (63/943) delivered water using water trucking and percentage of 04% (63/943) delivered water using both, and 00% (2/943) delivered water using manhal.
- 5 water quality tests were conducted, 0 of them were contaminated.

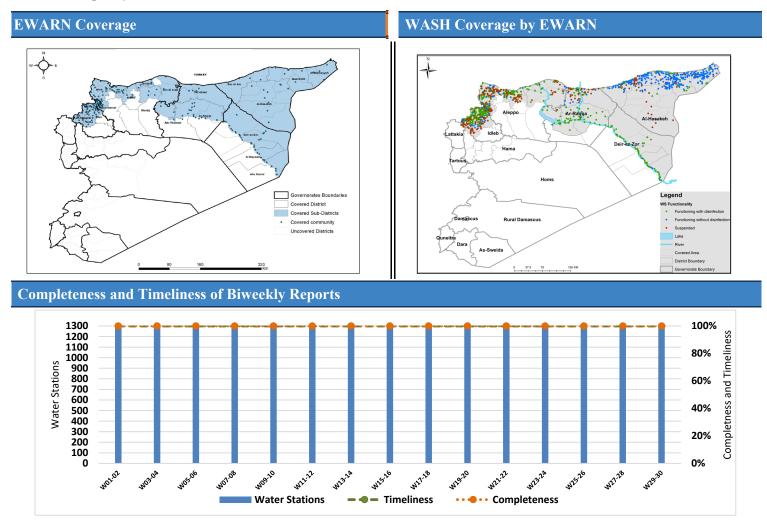



Drinking Water Stations Status in Each Governorate

	Drinking Water Stations Status					
Governorate	Total	Functioning	Percentage			
Aleppo (Communities)	262	149	57%			
Aleppo (Camps)	51	18	35%			
Idleb (Communities)	242	160	66%			
Idleb (Camps)	174	121	70%			
Hama	8	0	0%			
Ar-raqqa	122	94	77%			
Deir-ez-Zor	61	60	98%			
Al-Hasakeh	427	341	80%			
Total	1347	943	70%			


	Functioning DWS Clorination Status				
Governorate	Total With disinfection		Percentage		
Aleppo (Communities)	149	127	85%		
Aleppo (Camps)	18	16	89%		
Idleb (Communities)	160	134	84%		
Idleb (Camps)	121	83	69%		
Hama	0	0	0%		
Ar-raqqa	94	83	88%		
Deir-ez-Zor	60	48	80%		
Al-Hasakeh	341	103	30%		
Total	943	594	63%		

Drinking Water Stations Status



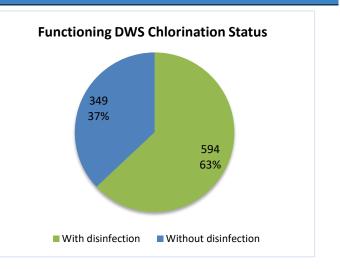


Drinking Water Stations Status in Governorates

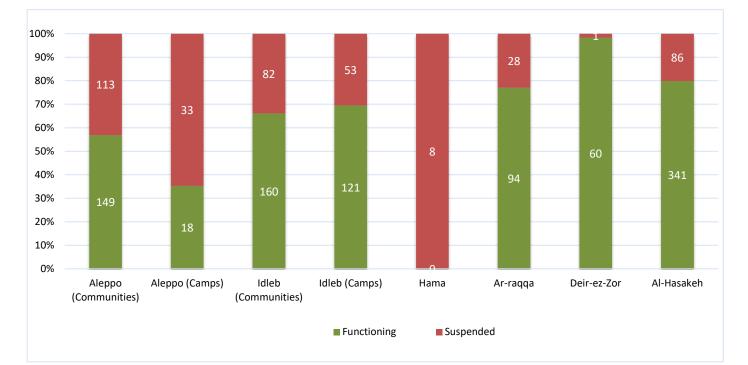


The Reason for Suspension


Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple- scale maintenance	Need for moderate- scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	24	33	3	5	27	39	9	6
Idleb	8	43	6	10	13	41	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	2	6	0	3	6	3	8	0
Deir-ez-Zor	0	0	0	0	0	0	1	0
Al-Hasakeh	14	2	0	6	36	3	23	2
Total	48	84	9	24	82	86	60	11

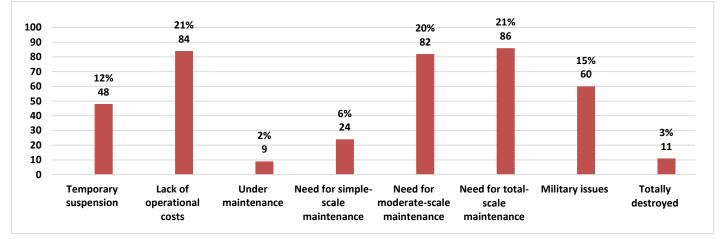


Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	22	163	15	44	3	45	21
Idleb	11	210	36	54	6	77	18
Hama	0	8	0	0	0	0	0
Ar-raqqa	74	2	5	28	5	6	2
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	317	7	2	60	30	2	9
Total	424	402	58	235	44	130	50

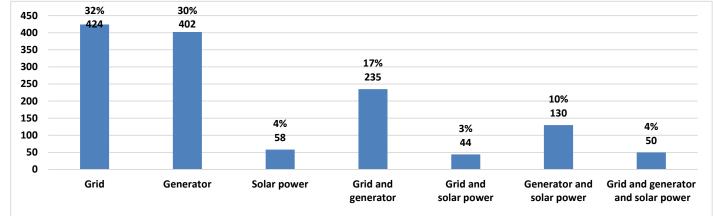

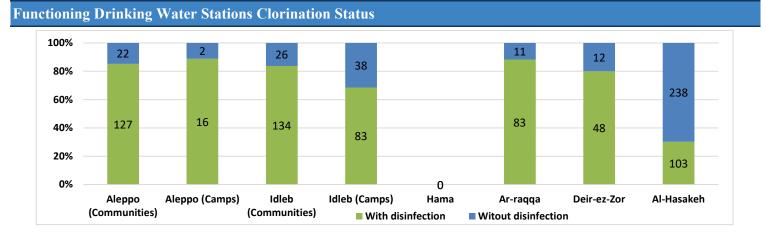


The Reason for not Chlorination

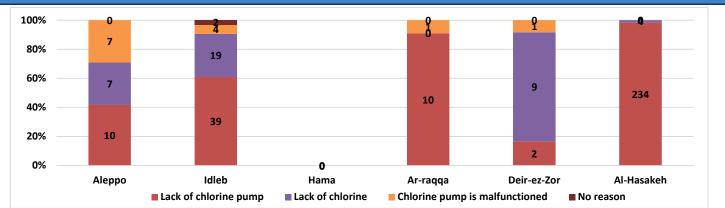

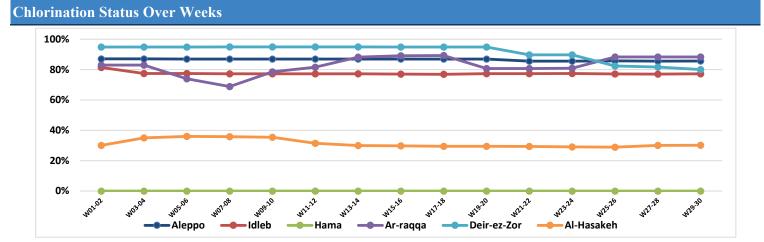


Connection Method


		Method				
Governorate	Functioning DWS	Network	Water Trucking	Both	Manhal	
Aleppo	167	148	3	14	2	
Idleb	281	181	53	47	0	
Hama	0	0	0	0	0	
Ar-raqqa	94	91	2	1	0	
Deir-ez-Zor	60	56	4	0	0	
Al-Hasakeh	341	339	1	1	0	
Total	943	815	63	63	2	

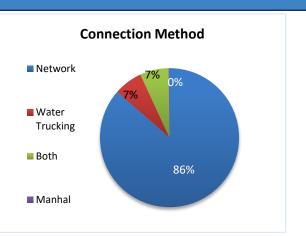


For any inquiries, please contact us: wash@acu-sy.org

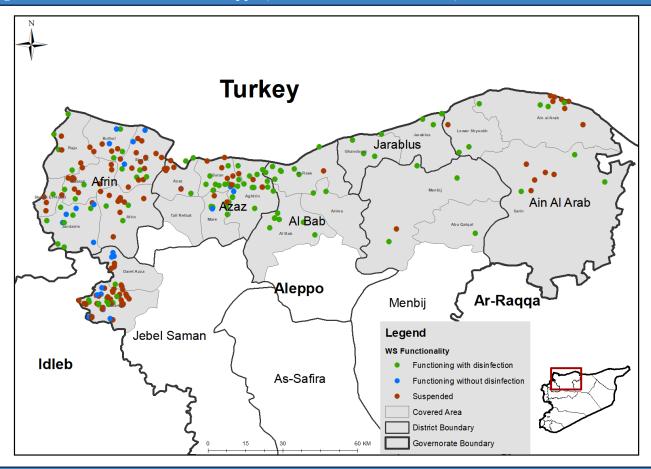


Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

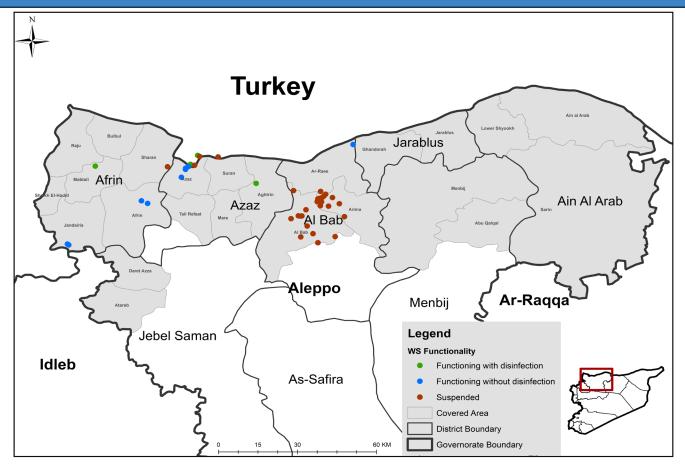




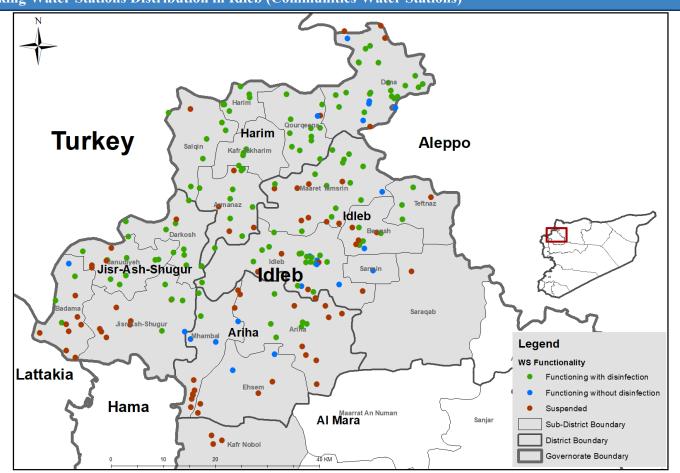


Drinking Water Stations Distribution in Idleb (Camps Water Stations)

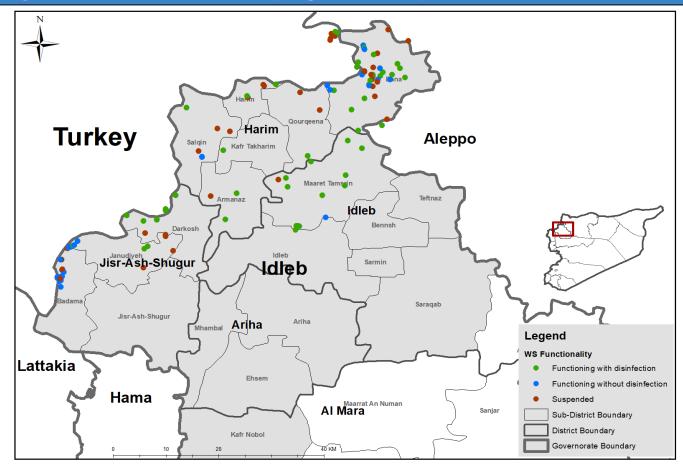


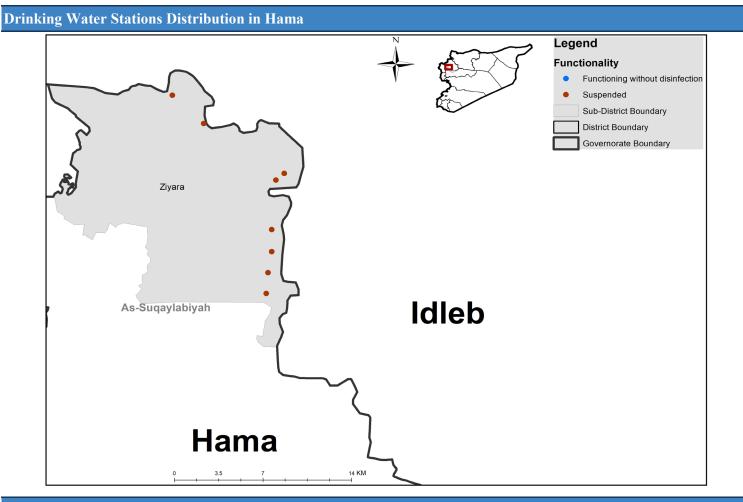

Drinking Water Stations Distribution in Ar-raqqa

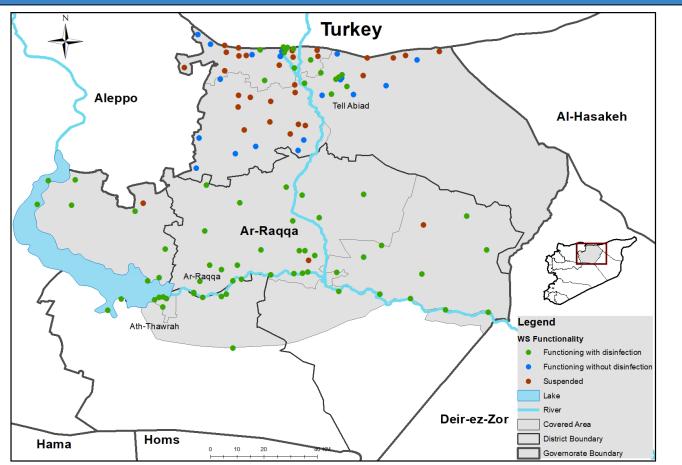

Drinking Water Stations Distribution in Deir-ez-Zor

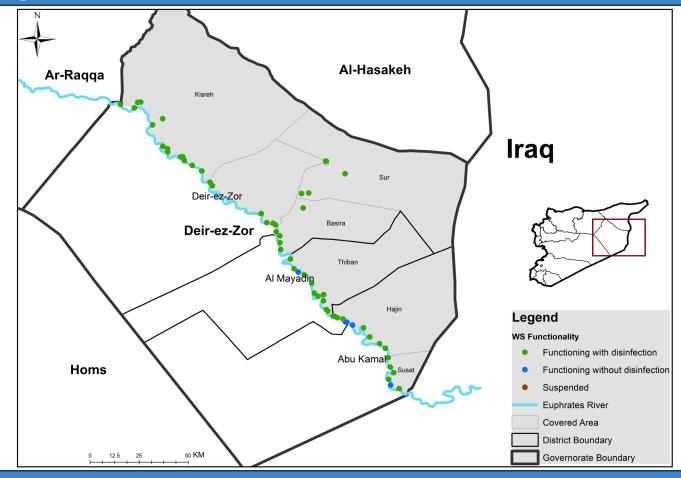

Drinking Water Stations Distribution in Al-Hasakeh

