






WASH Biweekly Bulletin - Syria Early Warning Alert and Response Network

Date: 28 Jul - 10 Aug 2024 Week No. 31-32


Highlights

- This report covers 1347 public drinking water stations monitored in 6 governorates, 1122 community-based, and 225 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 70% (945/1347) were functioning, while 30% (402/1347) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 20%, and the percentage of the suspended stations due to the need for total-scale maintenance is 21%, of the total suspended water stations.
- Of the water stations, 32% depend on the grid and 30% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 63% (595/945).
- Of the functioning water stations, percentage of 88% (816/945) delivered water using a piping network, percentage of 08% (63/945) delivered water using water trucking and percentage of 04% (64/945) delivered water using both, and 00% (2/945) delivered water using manhal.
- 10 water quality tests were conducted, 3 of them were contaminated.


EWARN Coverage

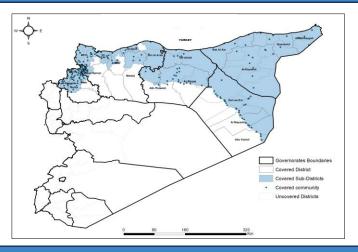

WASH Coverage by EWARN

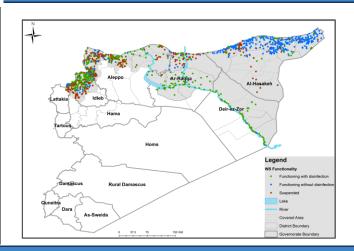

Completeness and Timeliness of Biweekly Reports

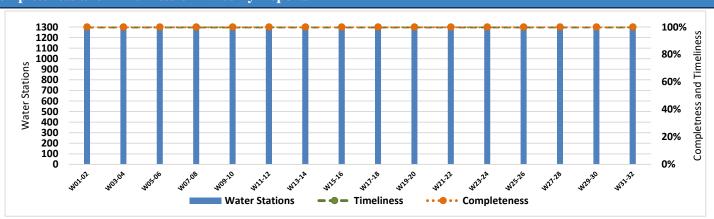



Drinking Water Stations Status in Each Governorate

	Drinking Water Stations Status				
Governorate	Total	Functioning	Percentage		
Aleppo (Communities)	262	149	57%		
Aleppo (Camps)	51	18	35%		
Idleb (Communities)	242	162	67%		
Idleb (Camps)	174	121	70%		
Hama	8	0	0%		
Ar-raqqa	122	94	77%		
Deir-ez-Zor	61	60	98%		
Al-Hasakeh	427	341	80%		
Total	1347	945	70%		


	Functioning DWS Clorination Status				
Governorate	Total	With disinfection	Percentage		
Aleppo (Communities)	149	127	85%		
Aleppo (Camps)	18	16	89%		
Idleb (Communities)	162	136	84%		
Idleb (Camps)	121	83	69%		
Hama	0	0	0%		
Ar-raqqa	94	83	88%		
Deir-ez-Zor	60	47	78%		
Al-Hasakeh	341	103	30%		
Total	945	595	63%		

Drinking Water Stations Status

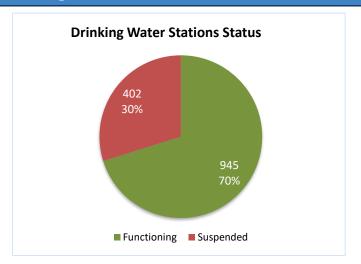

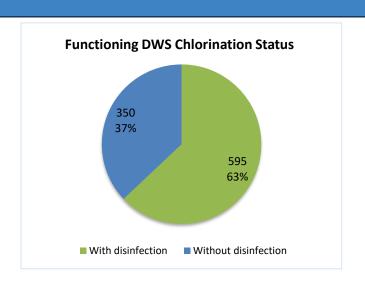


Drinking Water Stations Status in Governorates

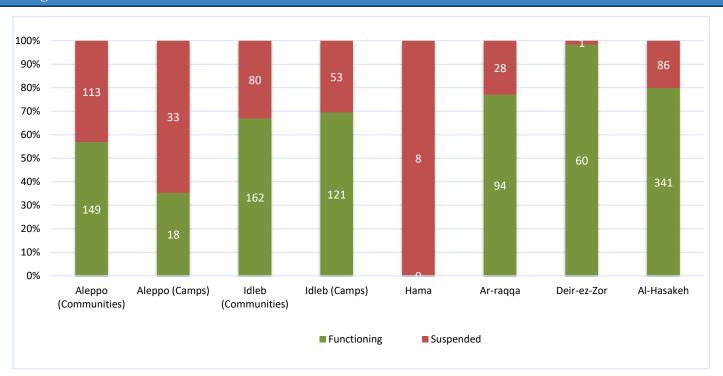


The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple- scale maintenance	Need for moderate- scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	24	33	3	5	27	39	9	6
Idleb	8	41	6	10	13	41	11	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	2	6	0	3	6	3	8	0
Deir-ez-Zor	0	0	0	0	0	0	1	0
Al-Hasakeh	14	2	1	5	36	3	23	2
Total	48	82	10	23	82	86	60	11

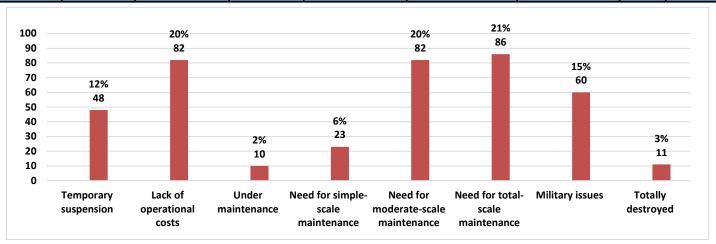


Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	22	164	15	44	2	45	21
Idleb	11	210	36	54	6	77	18
Hama	0	8	0	0	0	0	0
Ar-raqqa	74	2	5	28	5	6	2
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	317	7	2	60	30	2	9
Total	424	403	58	235	43	130	50

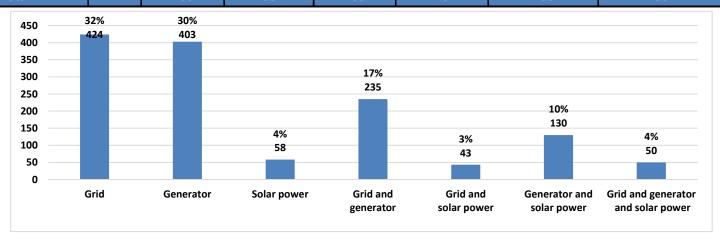


Functioning Drinking Water Stations Clorination Status

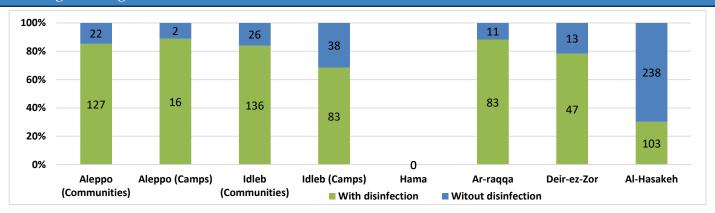

The Reason for not Chlorination

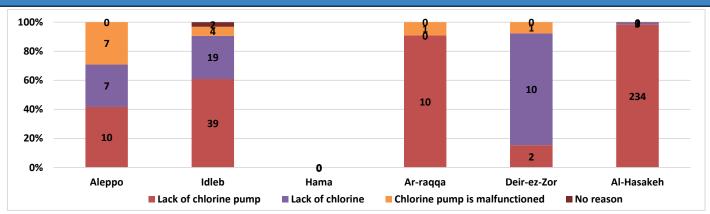


Chlorination Status Over Weeks

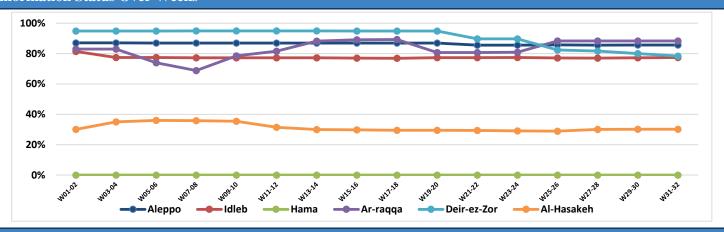


Connection Method


		Method				
Governorate	Functioning DWS	Network	Water Trucking	Both	Manhal	
Aleppo	167	148	3	14	2	
Idleb	283	182	53	48	0	
Hama	0	0	0	0	0	
Ar-raqqa	94	91	2	1	0	
Deir-ez-Zor	60	56	4	0	0	
Al-Hasakeh	341	339	1	1	0	
Total	945	816	63	64	2	

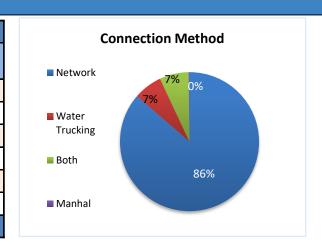


Drinking Water Stations Distribution in Aleppo (Communities Water Stations)

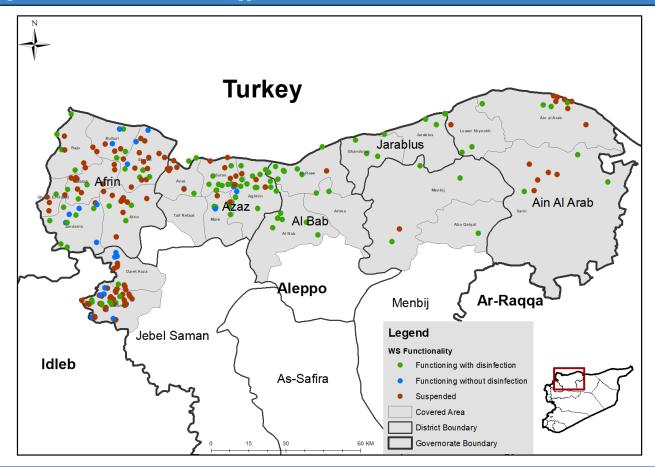


Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

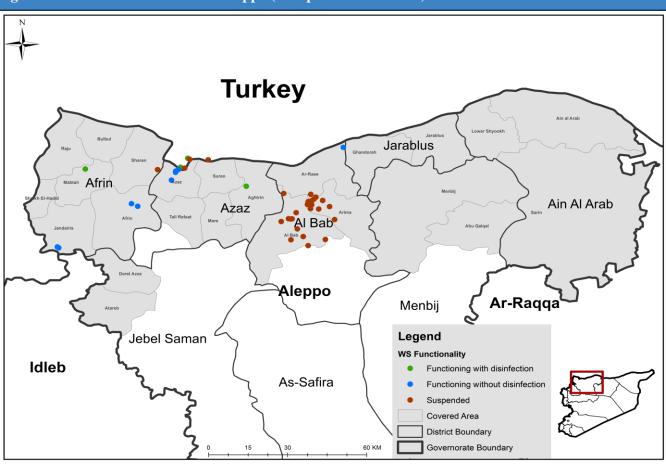


Drinking Water Stations Distribution in Idleb (Communities Water Stations)

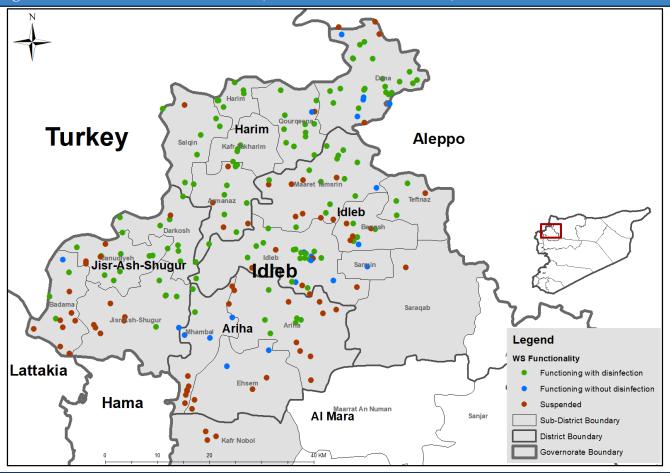


Drinking Water Stations Distribution in Idleb (Camps Water Stations)

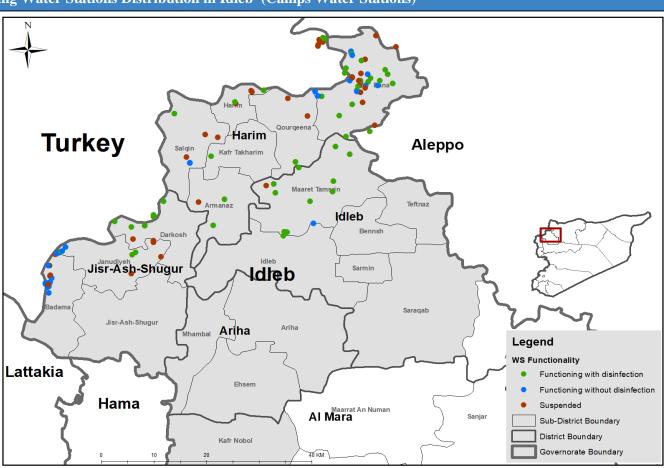


Drinking Water Stations Distribution in Hama

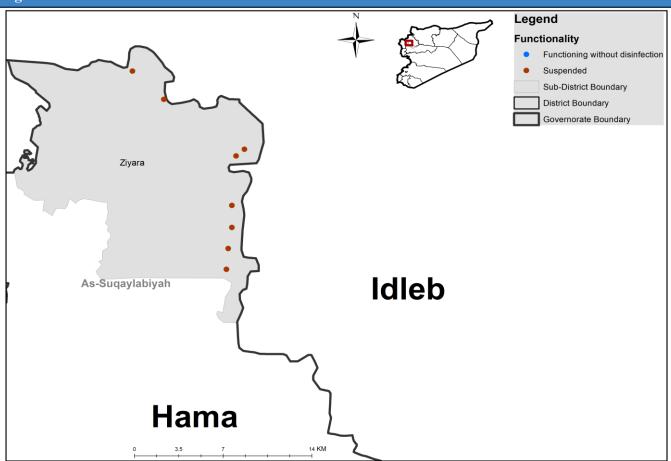

Drinking Water Stations Distribution in Ar-raqqa

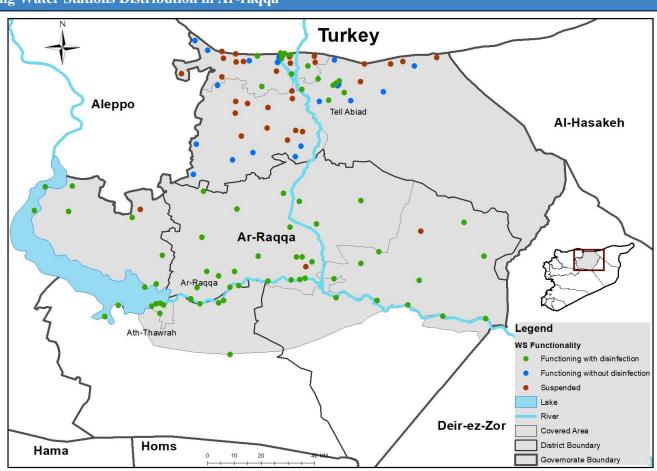

Drinking Water Stations Distribution in Deir-ez-Zor

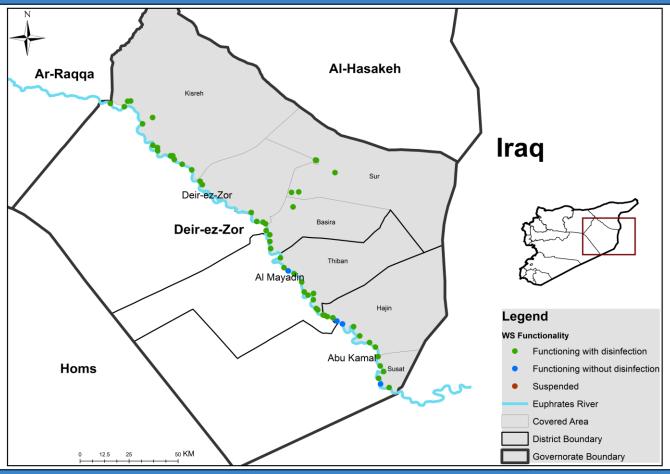

Drinking Water Stations Distribution in Al-Hasakeh

