

## WASH Biweekly Bulletin - Syria

### Early Warning Alert and Response Network


Date: 26 Jan - 8 Feb 2025

Week No. 05-06


### Highlights

- This report covers 1550 public drinking water stations monitored in 6 governorates, 1317 community-based, and 233 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 65% (1003/1550) were functioning, while 35% (547/1550) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 13%, and the percentage of the suspended stations due to the need for total-scale maintenance is 38%, of the total suspended water stations.
- Of the water stations, 29% depend on the grid and 32% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 61% (608/1003).
- Of the functioning water stations, percentage of 88% (865/1003) delivered water using a piping network, percentage of 08% (64/1003) delivered water using water trucking and percentage of 04% (72/1003) delivered water using both, and 00% (2/1003) delivered water using manhal.
- 10 water quality tests were conducted, 3 of them were contaminated.


### EWARN Coverage

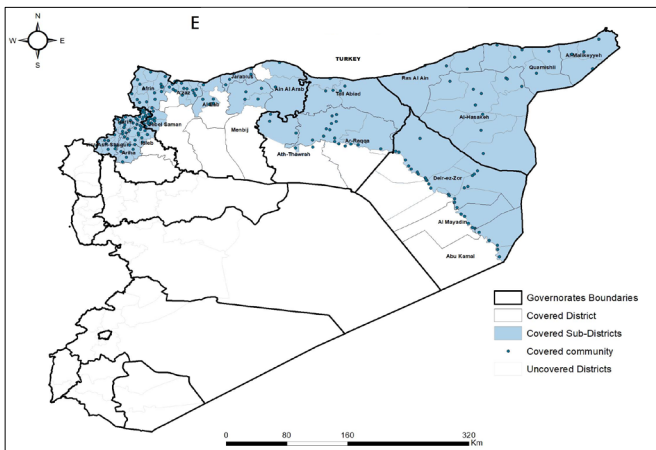

### WASH Coverage by EWARN

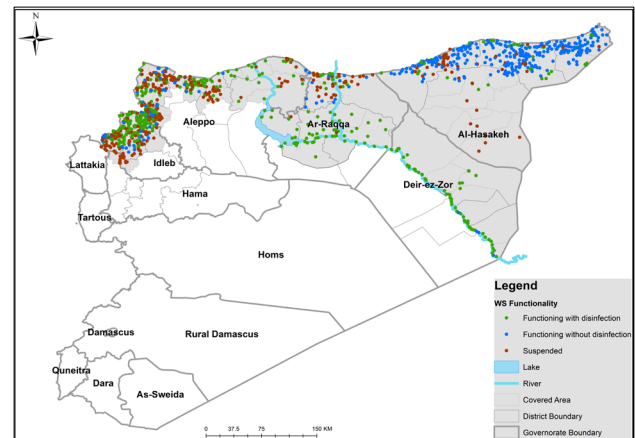

### Completeness and Timeliness of Biweekly Reports

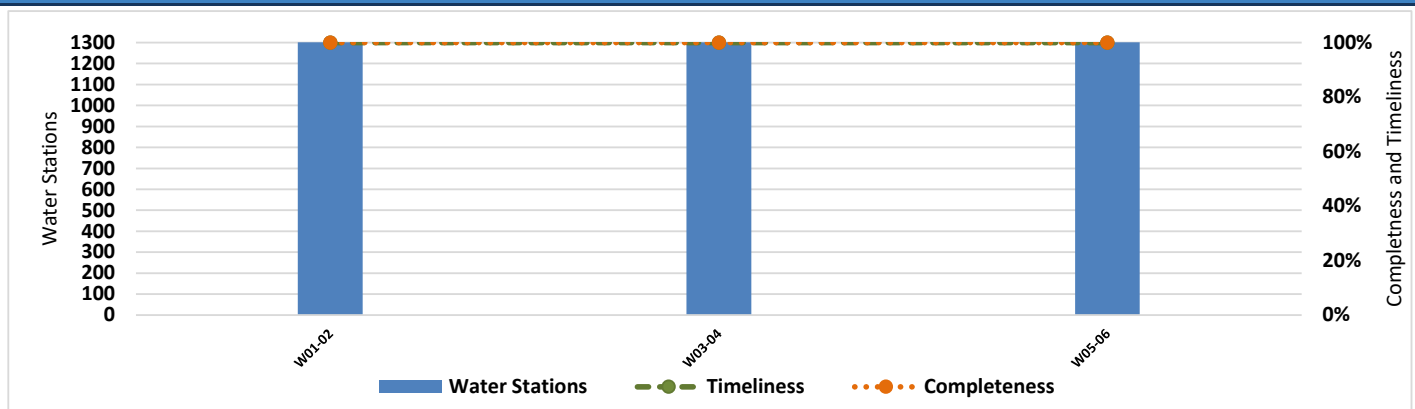


## Drinking Water Stations Status in Each Governorate

Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Communities)	381	191	50%
Aleppo (Camps)	54	16	30%
Idleb (Communities)	318	161	51%
Idleb (Camps)	179	125	70%
Hama	8	0	0%
Ar-raqqa	122	105	86%
Deir-ez-Zor	61	59	97%
Al-Hasakeh	427	346	81%
<b>Total</b>	<b>1550</b>	<b>1003</b>	<b>65%</b>


Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Communities)	191	139	73%
Aleppo (Camps)	16	11	69%
Idleb (Communities)	161	136	84%
Idleb (Camps)	125	85	68%
Hama	0	0	0%
Ar-raqqa	105	78	74%
Deir-ez-Zor	59	56	95%
Al-Hasakeh	346	103	30%
<b>Total</b>	<b>1003</b>	<b>608</b>	<b>61%</b>

## Drinking Water Stations Status


Drinking Water Stations Status

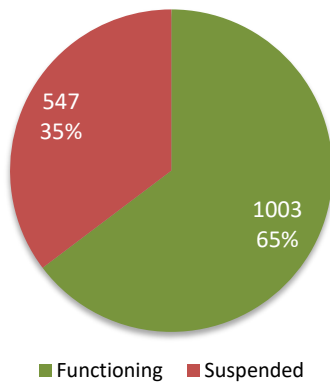

Functioning DWS Chlorination Status

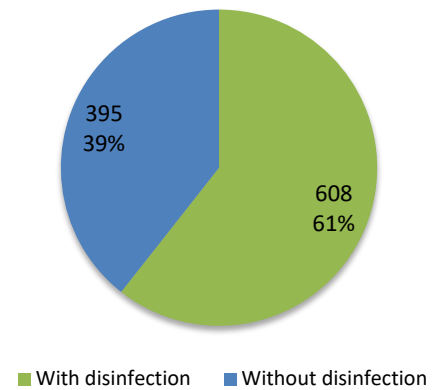


## Drinking Water Stations Status in Governorates

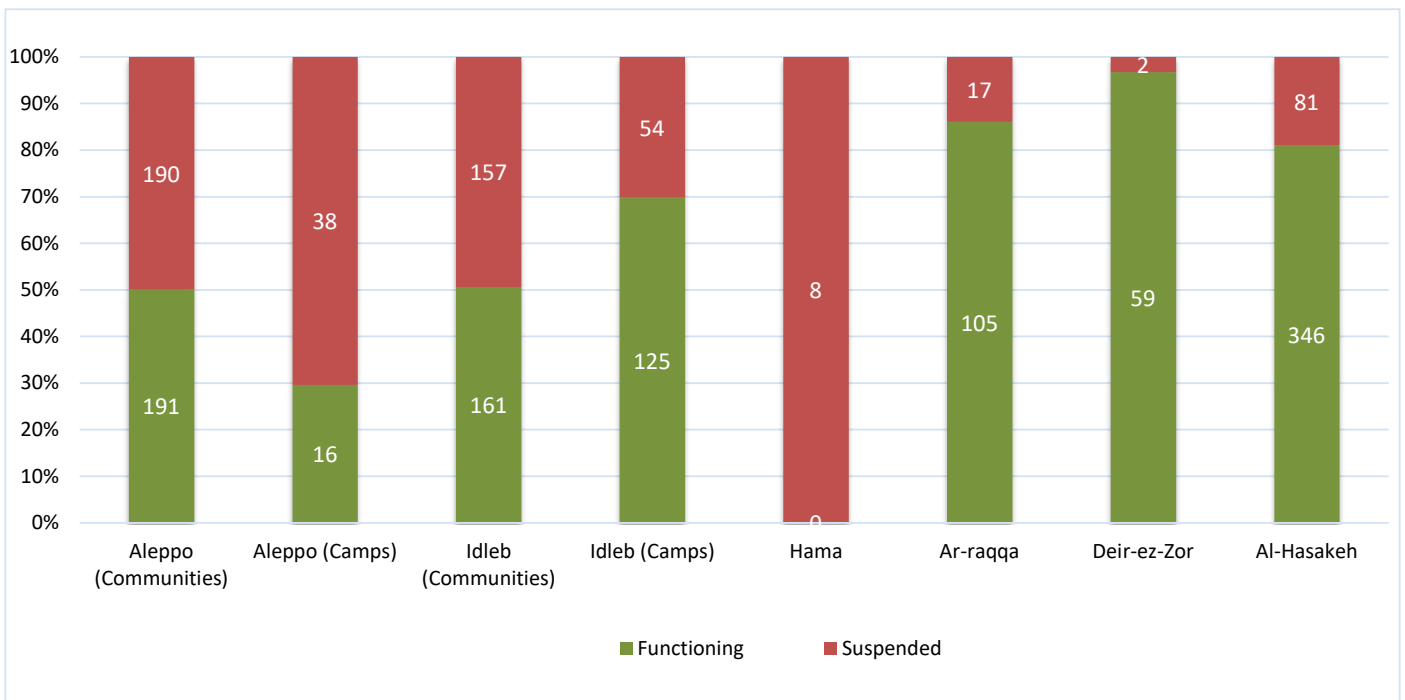


## The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	24	26	4	14	53	84	9	14
Idleb	8	44	6	10	13	119	8	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	2	0	0	2	4	2	7	0
Deir-ez-Zor	0	0	1	1	0	0	0	0
Al-Hasakeh	14	2	1	6	30	3	23	2
<b>Total</b>	<b>48</b>	<b>72</b>	<b>12</b>	<b>33</b>	<b>100</b>	<b>208</b>	<b>55</b>	<b>19</b>

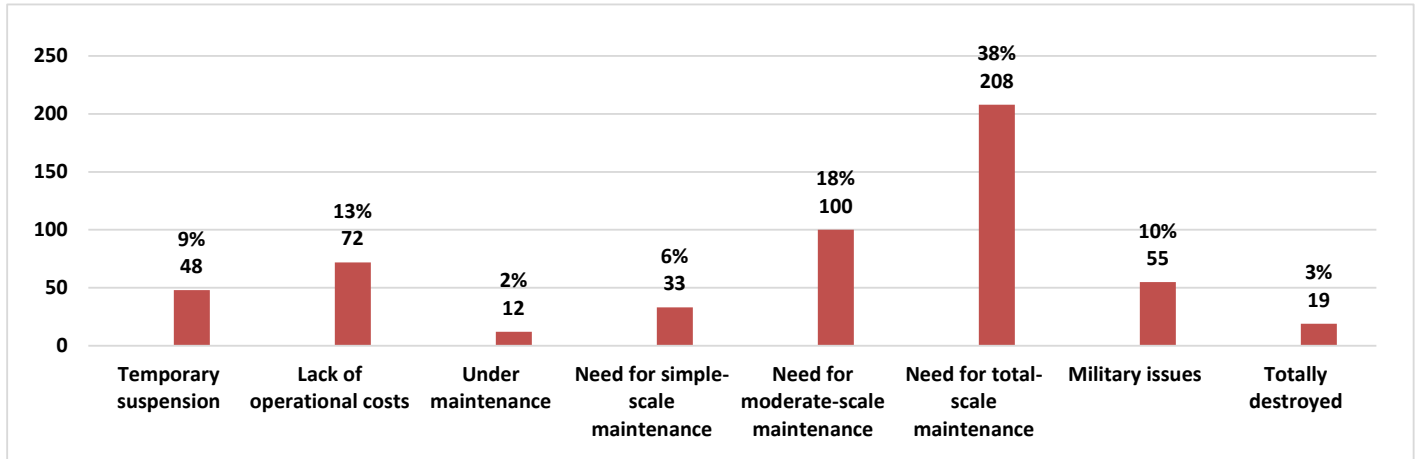


## Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	51	166	22	83	14	47	23
Idleb	11	285	39	55	7	79	19
Hama	0	8	0	0	0	0	0
Ar-raqqa	66	1	21	18	6	7	3
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	315	7	2	60	32	2	9
<b>Total</b>	<b>443</b>	<b>479</b>	<b>84</b>	<b>265</b>	<b>59</b>	<b>135</b>	<b>54</b>

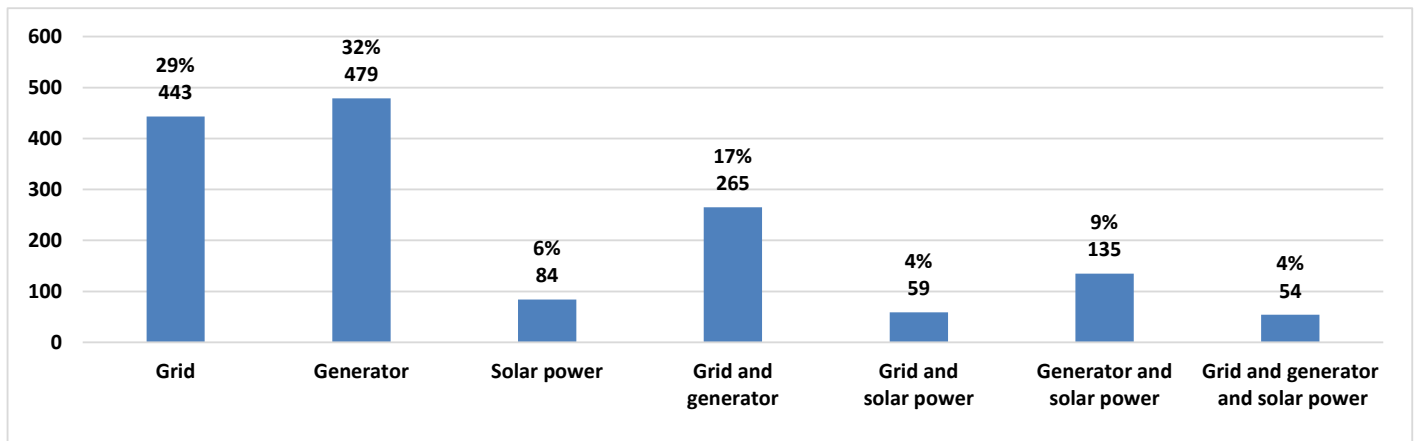


## Functioning Drinking Water Stations Chlorination Status

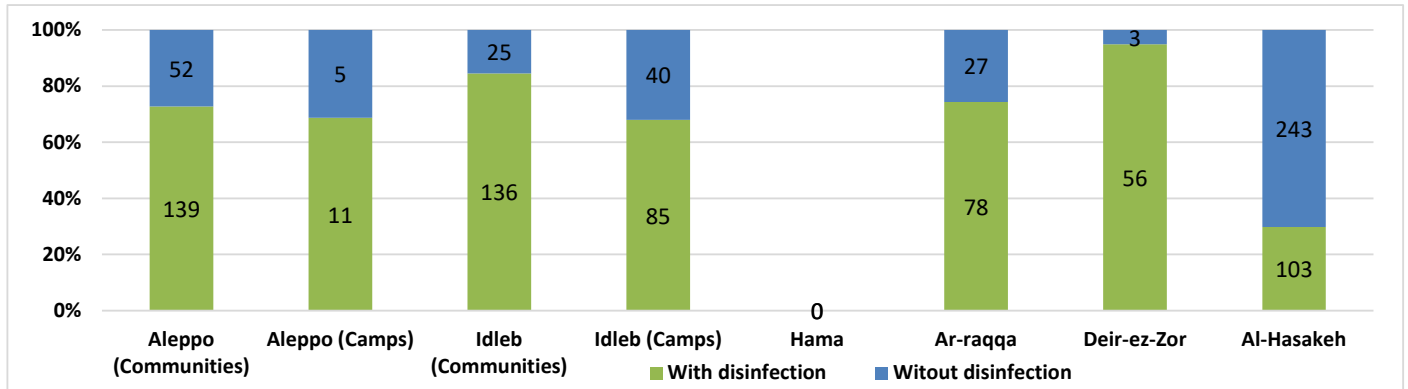

## The Reason for not Chlorination

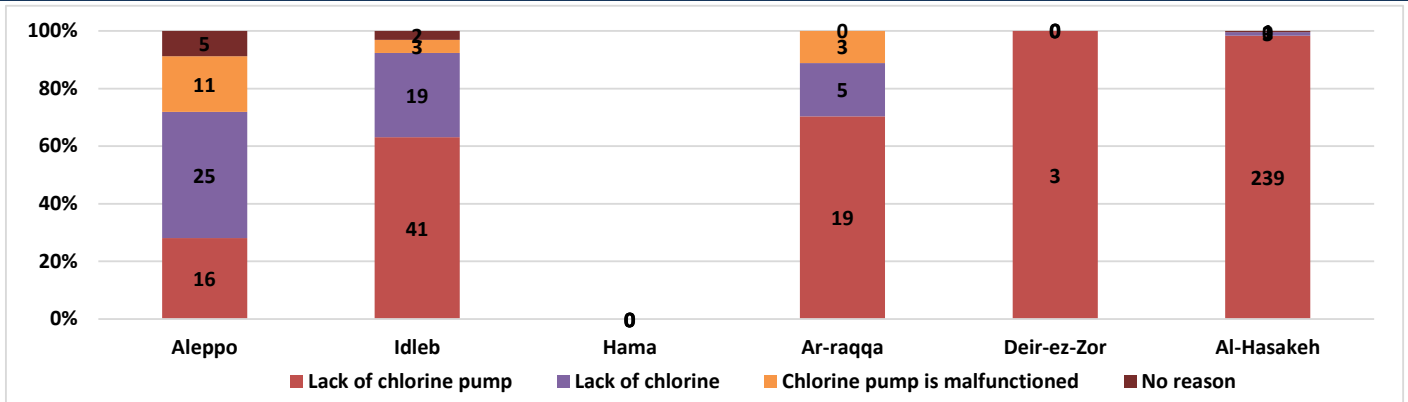


## Chlorination Status Over Weeks

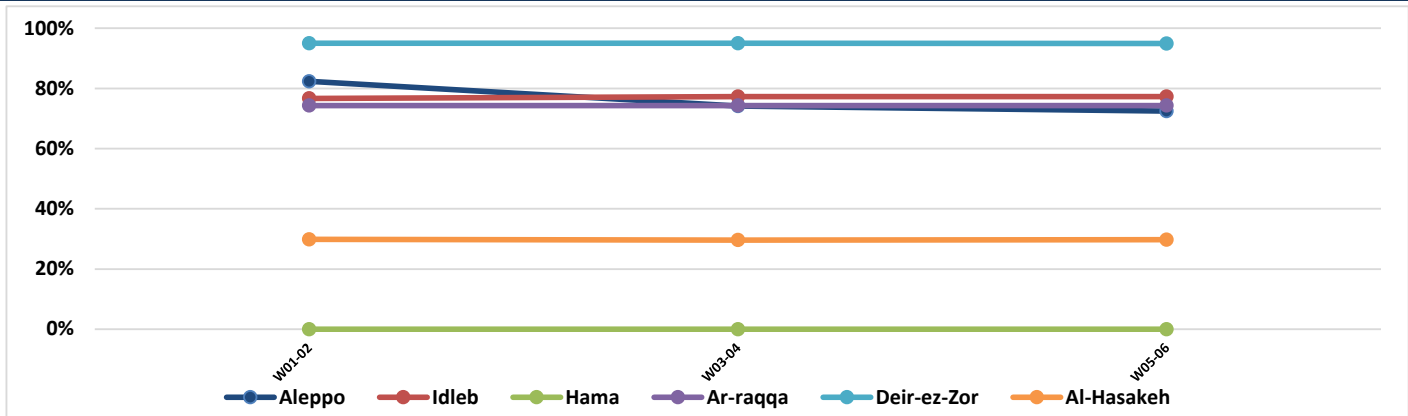


## Connection Method


Governorate	Functioning DWS	Method			
		Network	Water Trucking	Both	Manhal
Aleppo	207	176	6	23	2
Idleb	286	188	51	47	0
Hama	0	0	0	0	0
Ar-raqqqa	105	102	2	1	0
Deir-ez-Zor	59	55	4	0	0
Al-Hasakeh	346	344	1	1	0
<b>Total</b>	<b>1003</b>	<b>865</b>	<b>64</b>	<b>72</b>	<b>2</b>

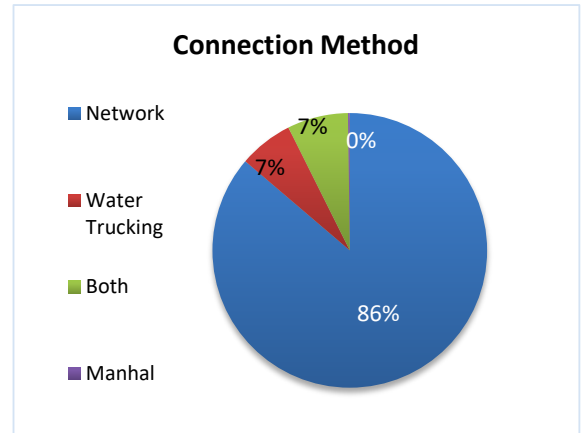


## Drinking Water Stations Distribution in Aleppo (Communities Water Stations)

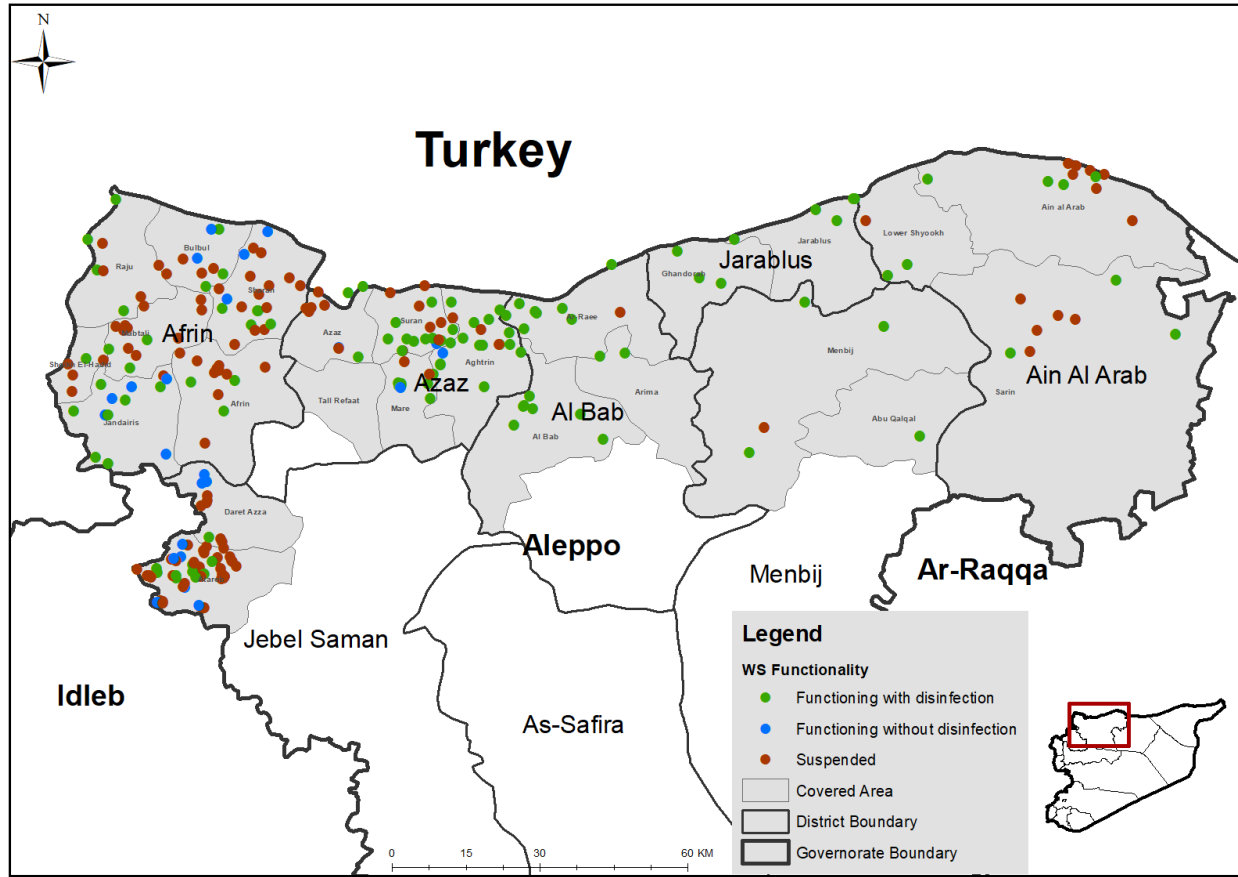


## Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

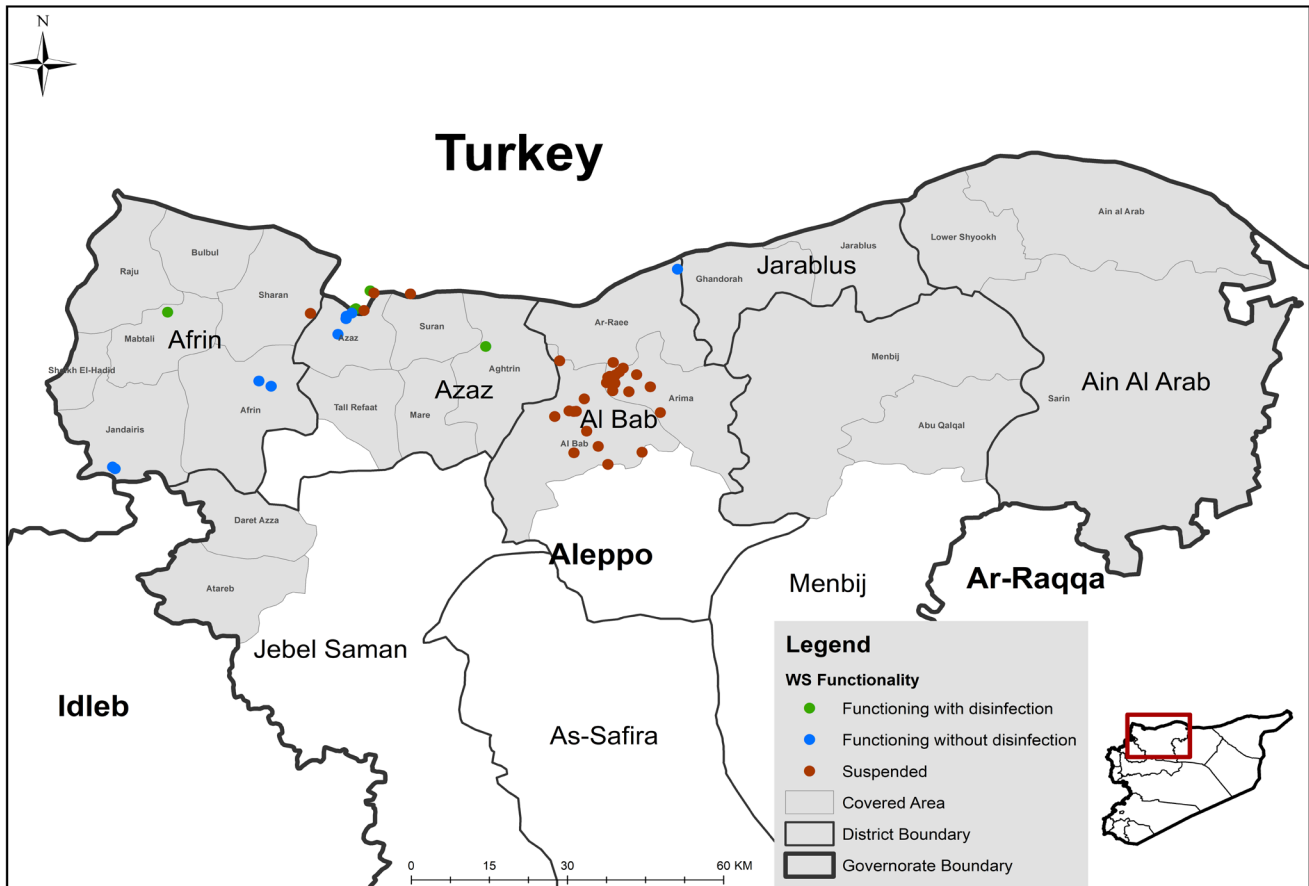


## Drinking Water Stations Distribution in Idleb (Communities Water Stations)

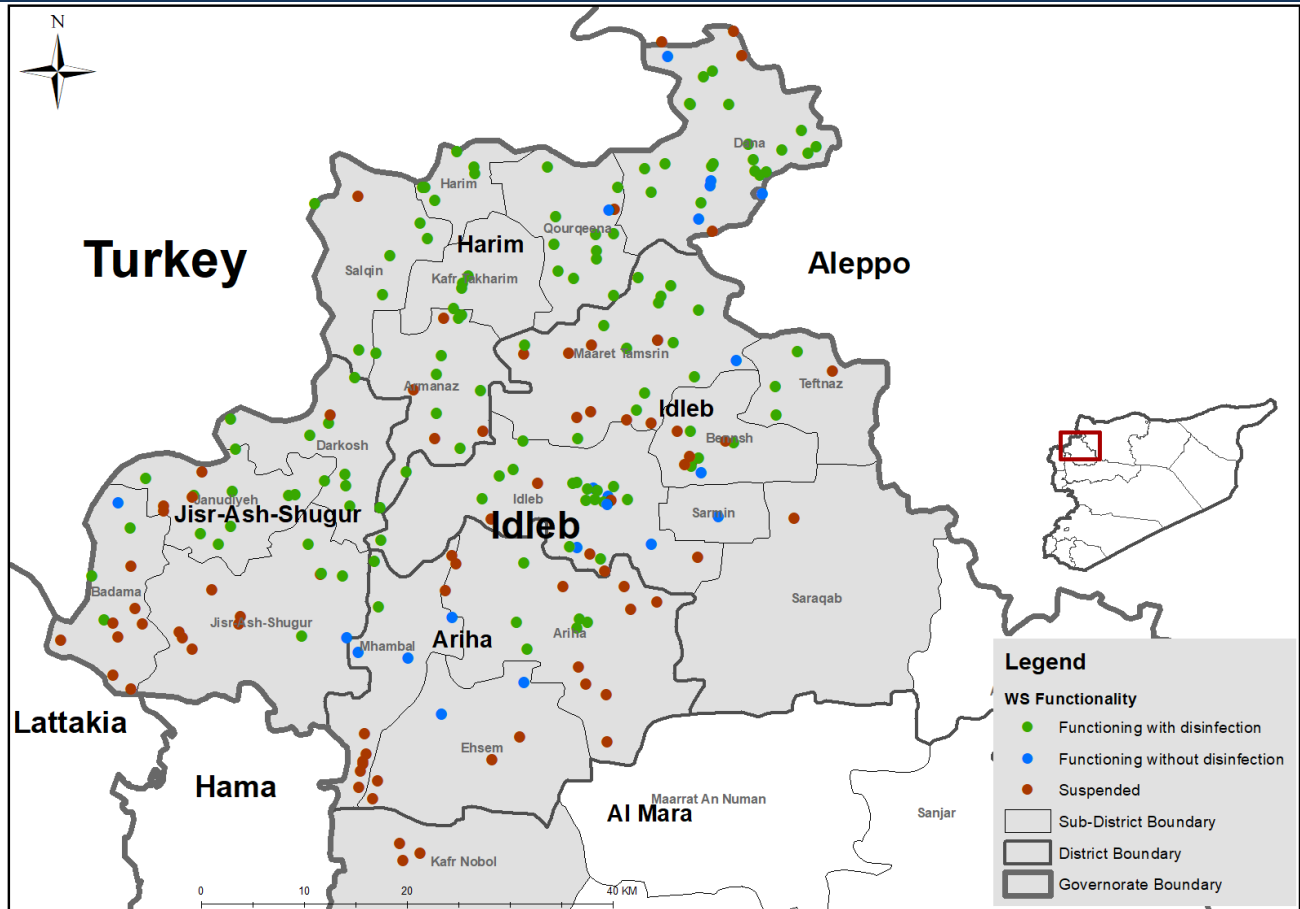


## Drinking Water Stations Distribution in Idleb (Camps Water Stations)

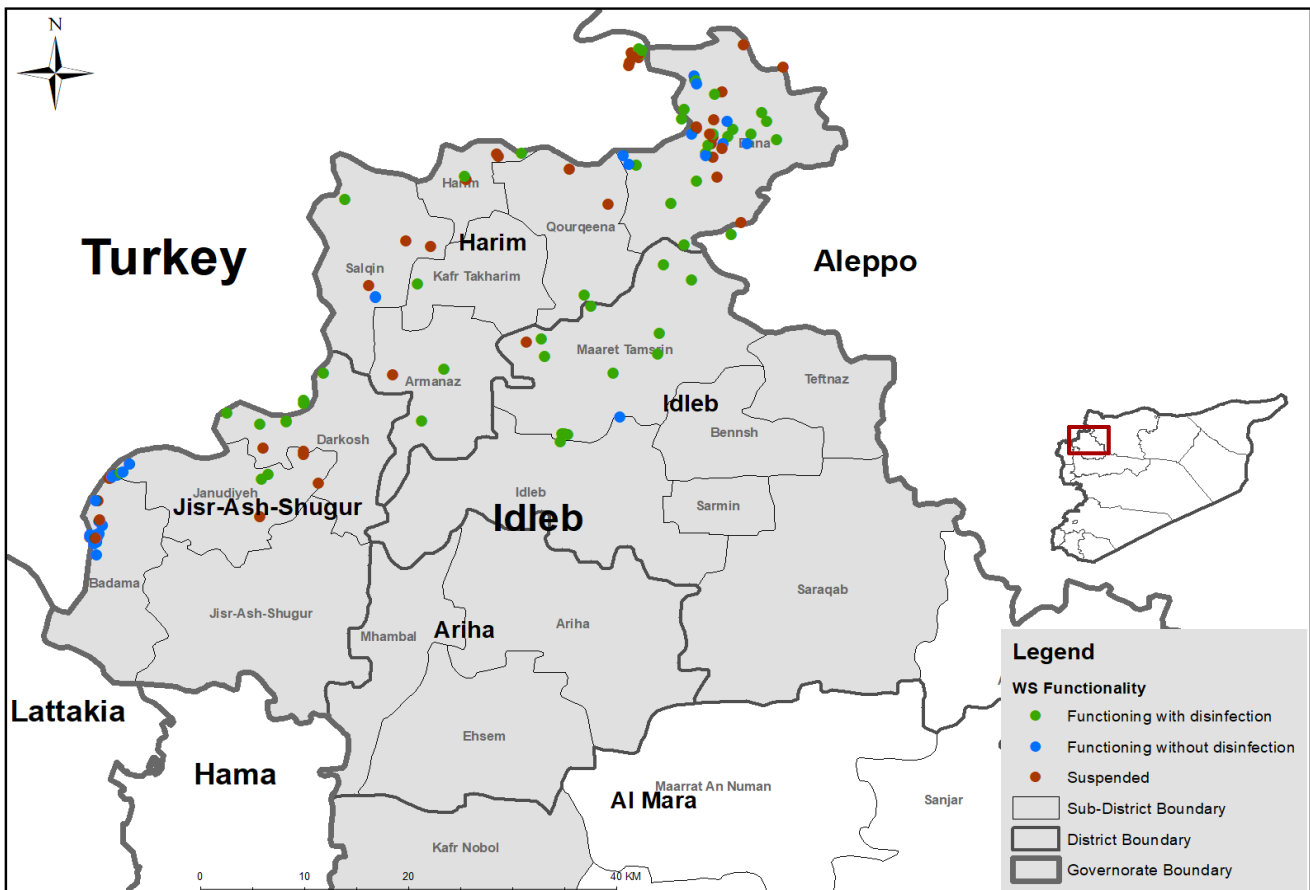


## Drinking Water Stations Distribution in Hama

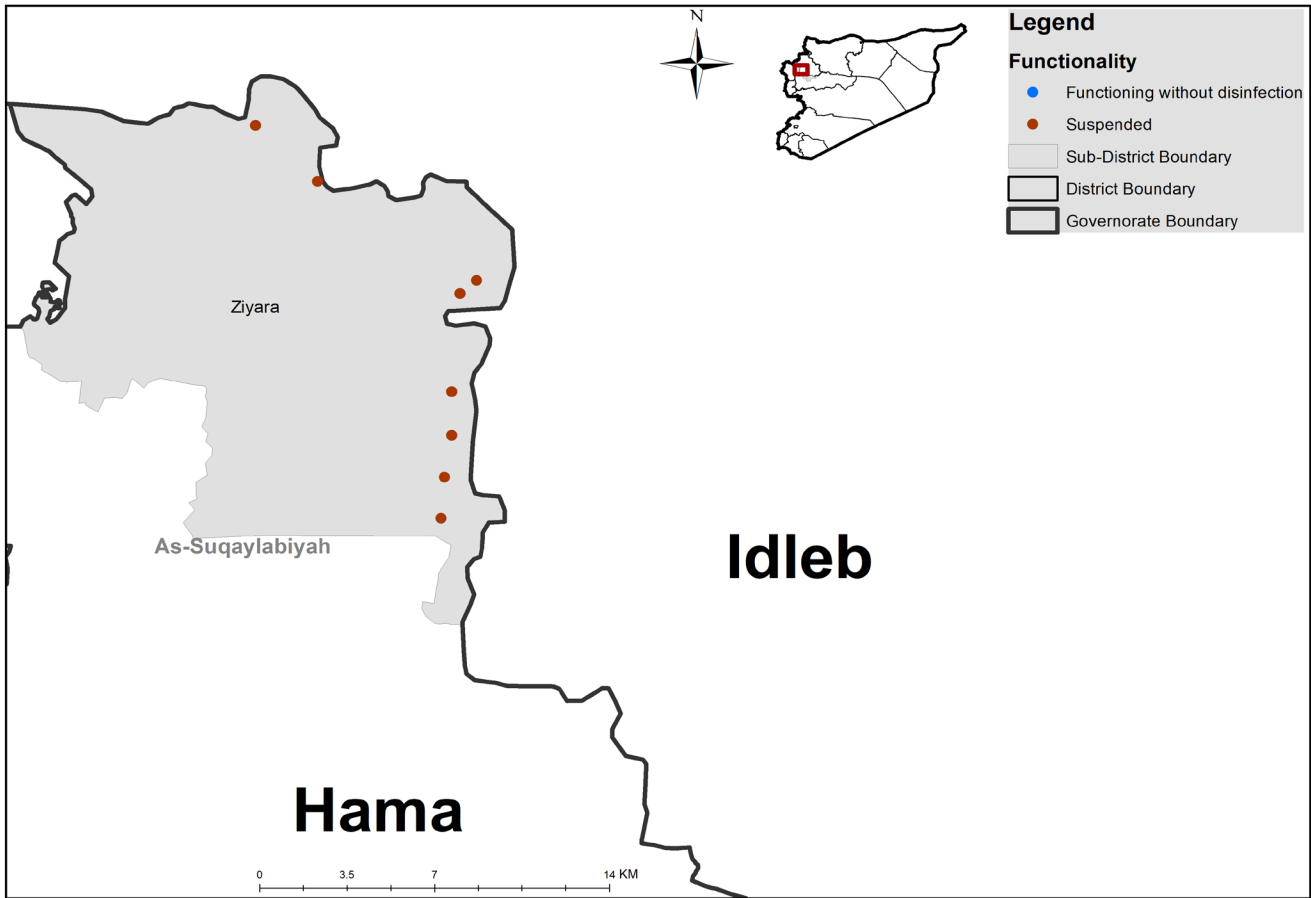

## Drinking Water Stations Distribution in Ar-raqqa

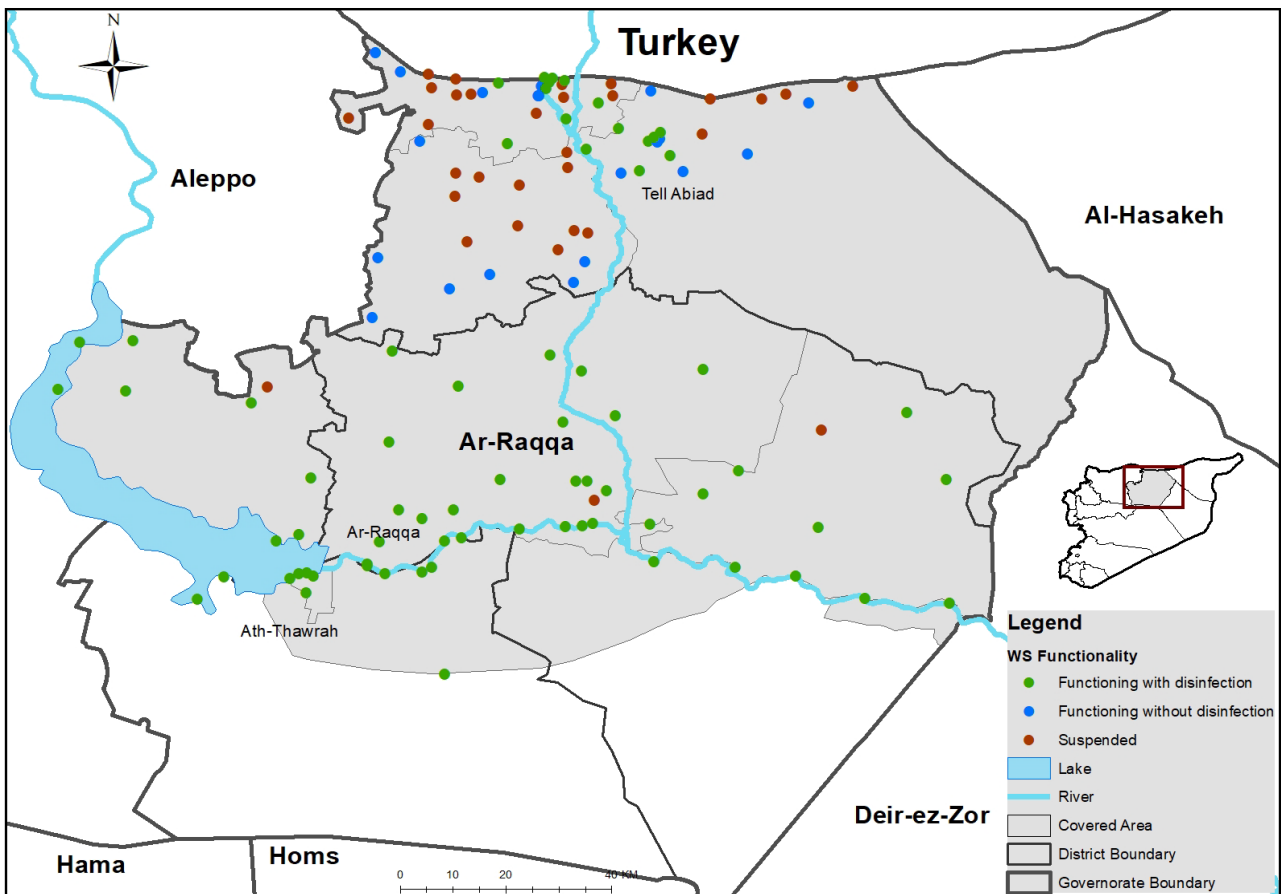

## Drinking Water Stations Distribution in Deir-ez-Zor

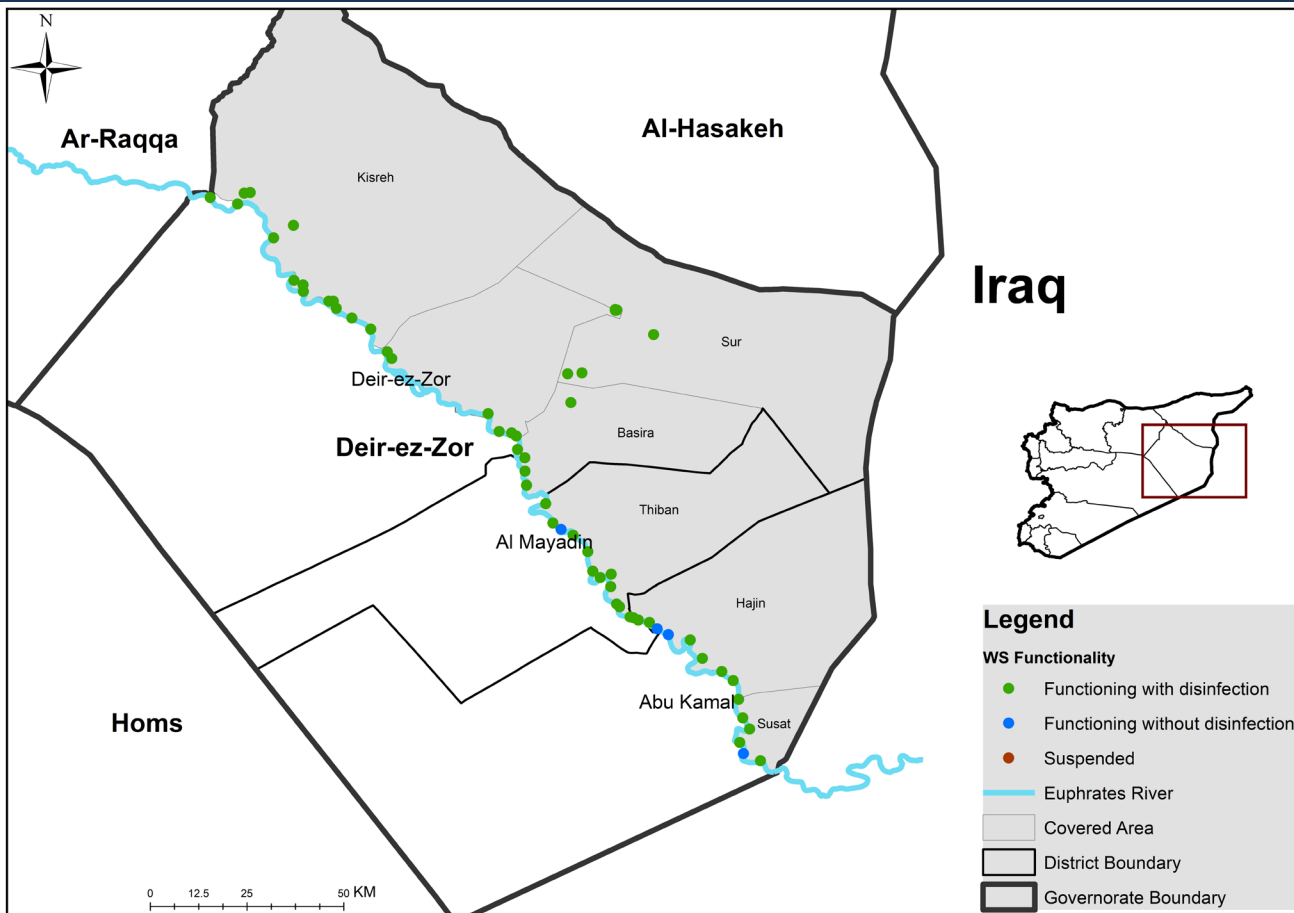

## Drinking Water Stations Distribution in Al-Hasakeh

