

WASH Biweekly Bulletin - Syria

Early Warning Alert and Response Network


Date: 9 Feb - 22 Feb 2025

Week No. 07-08


Highlights

- This report covers 1553 public drinking water stations monitored in 6 governorates, 1320 community-based, and 233 camp-based water stations. The percentages in this report represent only the sources monitored.
- Of the monitored drinking water stations, a percentage of 65% (1016/1553) were functioning, while 35% (537/1553) of the station were non-functional
- The percentage of the suspended stations due to the lack of operational costs is 13%, and the percentage of the suspended stations due to the need for total-scale maintenance is 39%, of the total suspended water stations.
- Of the water stations, 29% depend on the grid and 32% depend on generators as a electric power, while the rest of the stations depend on other sources (more details below).
- In the areas that their stations are suspended, private agricultural wells are used as an alternative water source, and tankers are used in water transportation.
- The percentage of disinfected water sources was 60% (614/1016).
- Of the functioning water stations, percentage of 88% (878/1016) delivered water using a piping network, percentage of 08% (64/1016) delivered water using water trucking and percentage of 04% (72/1016) delivered water using both, and 00% (2/1016) delivered water using manhal.
- 6 water quality tests were conducted, 2 of them were contaminated.


EWARN Coverage

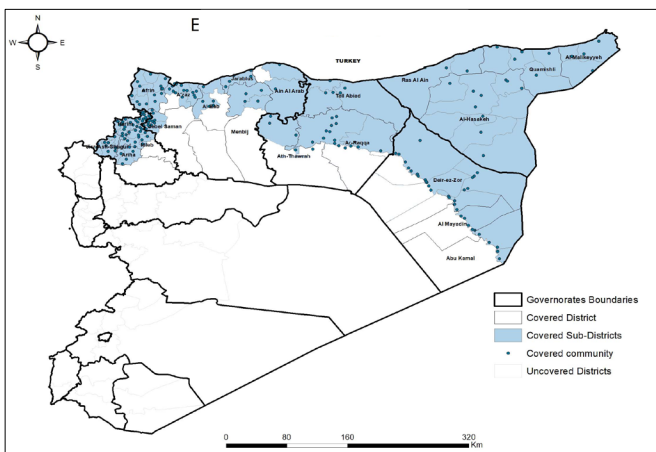

WASH Coverage by EWARN

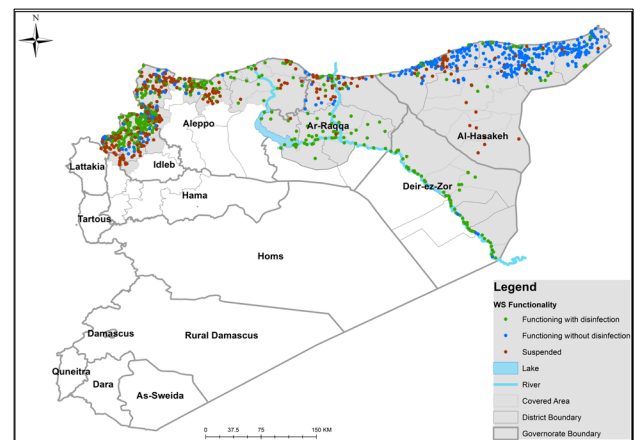

Completeness and Timeliness of Biweekly Reports

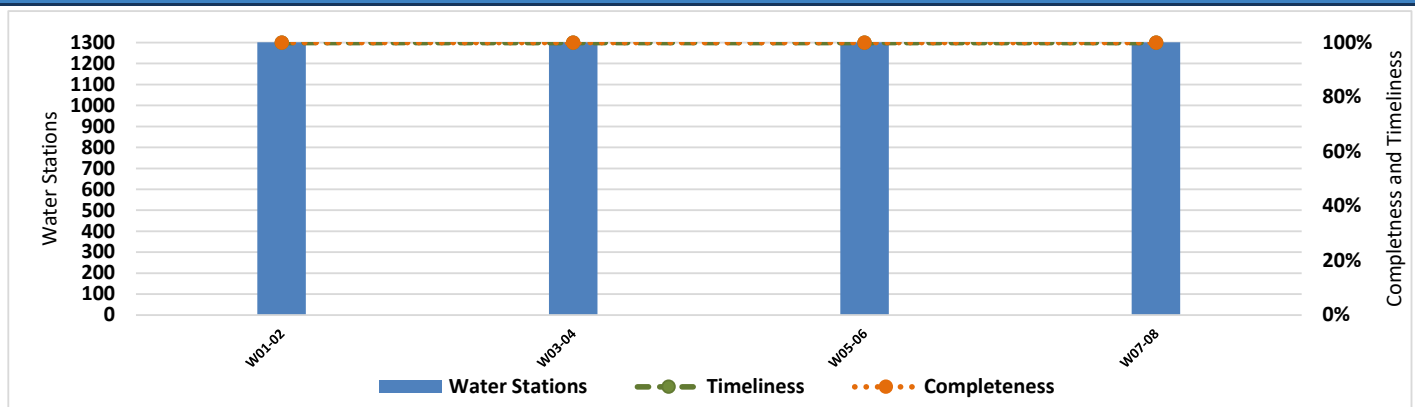


Drinking Water Stations Status in Each Governorate

Governorate	Drinking Water Stations Status		
	Total	Functioning	Percentage
Aleppo (Communities)	384	194	51%
Aleppo (Camps)	54	16	30%
Idleb (Communities)	318	161	51%
Idleb (Camps)	179	127	71%
Hama	8	0	0%
Ar-raqqa	122	105	86%
Deir-ez-Zor	61	60	98%
Al-Hasakeh	427	353	83%
Total	1553	1016	65%


Governorate	Functioning DWS Chlorination Status		
	Total	With disinfection	Percentage
Aleppo (Communities)	194	142	73%
Aleppo (Camps)	16	11	69%
Idleb (Communities)	161	136	84%
Idleb (Camps)	127	87	69%
Hama	0	0	0%
Ar-raqqa	105	78	74%
Deir-ez-Zor	60	57	95%
Al-Hasakeh	353	103	29%
Total	1016	614	60%

Drinking Water Stations Status


Drinking Water Stations Status

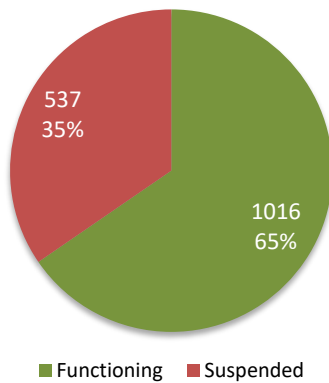

Functioning DWS Chlorination Status

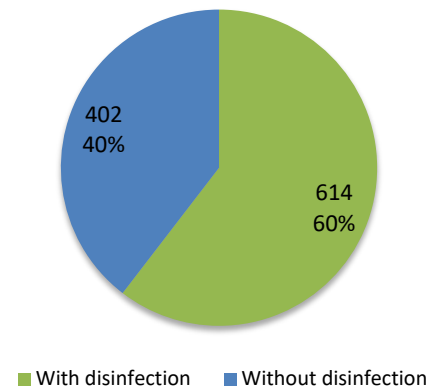


Drinking Water Stations Status in Governorates

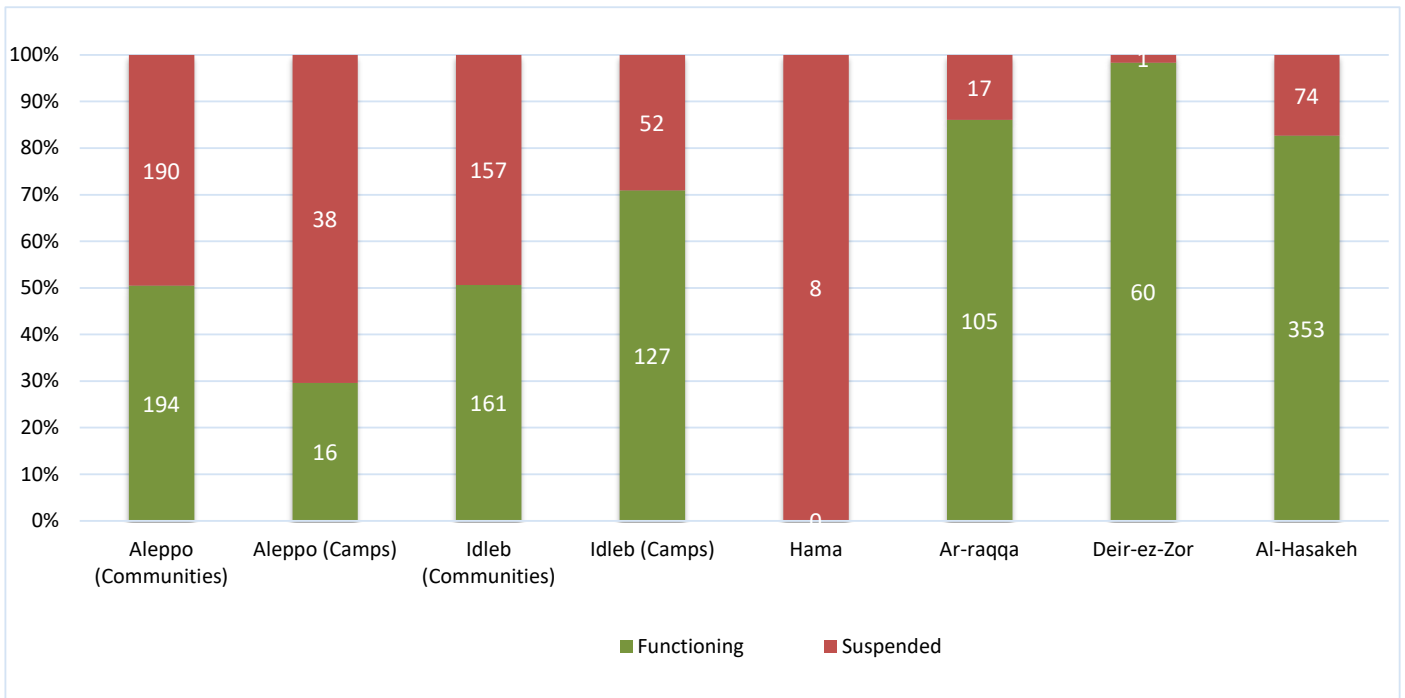


The Reason for Suspension

Governorate	Temporary suspension	Lack of operational costs	Under maintenance	Need for simple-scale maintenance	Need for moderate-scale maintenance	Need for total-scale maintenance	Military issues	Totally destroyed
Aleppo	24	26	4	14	53	84	9	14
Idleb	8	44	5	10	13	118	8	3
Hama	0	0	0	0	0	0	8	0
Ar-raqqa	2	0	0	2	4	2	7	0
Deir-ez-Zor	0	0	0	1	0	0	0	0
Al-Hasakeh	14	1	1	0	30	3	23	2
Total	48	71	10	27	100	207	55	19

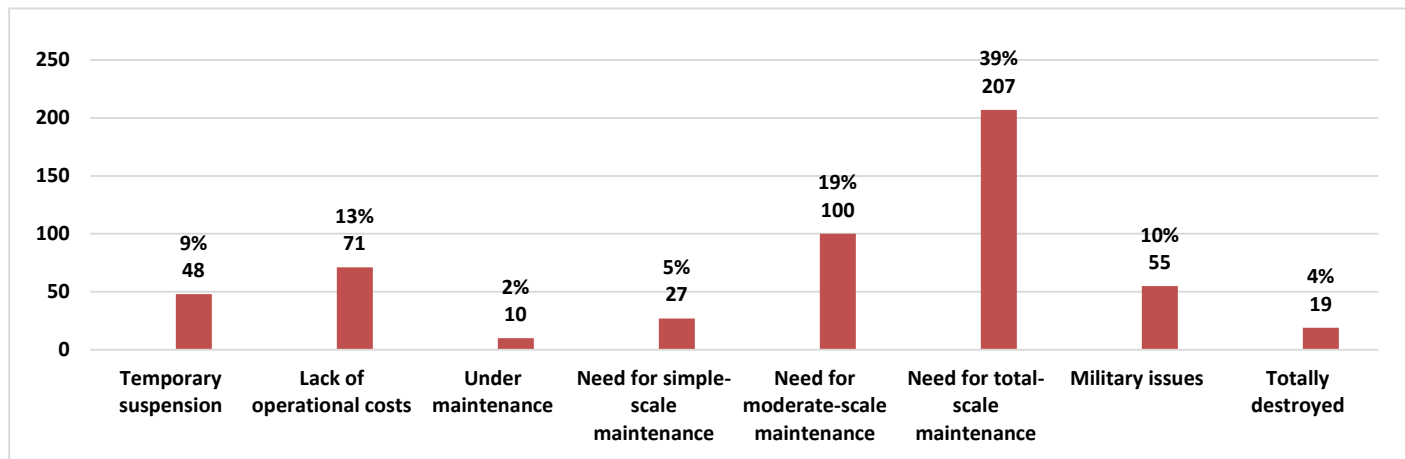


Source of the Electric Power


Governorate	Grid	Generator	Solar power	Grid and generator	Grid and solar power	Generator and solar power	Grid and generator and solar power
Aleppo	51	167	23	80	16	49	23
Idleb	11	285	39	55	7	79	19
Hama	0	8	0	0	0	0	0
Ar-raqqa	66	1	21	18	6	7	3
Deir-ez-Zor	0	12	0	49	0	0	0
Al-Hasakeh	315	7	2	60	32	2	9
Total	443	480	85	262	61	137	54

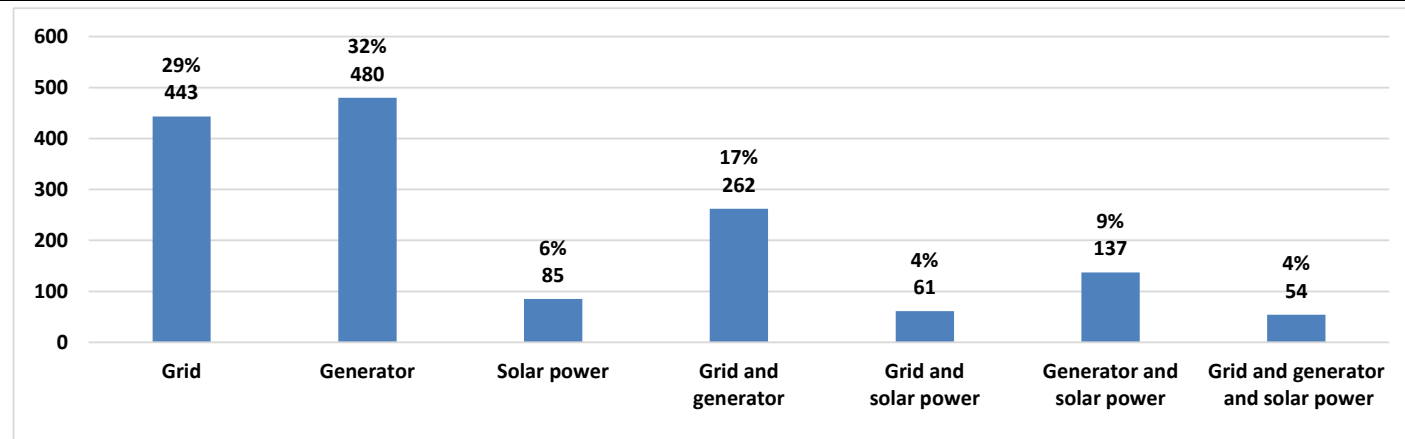


Functioning Drinking Water Stations Chlorination Status

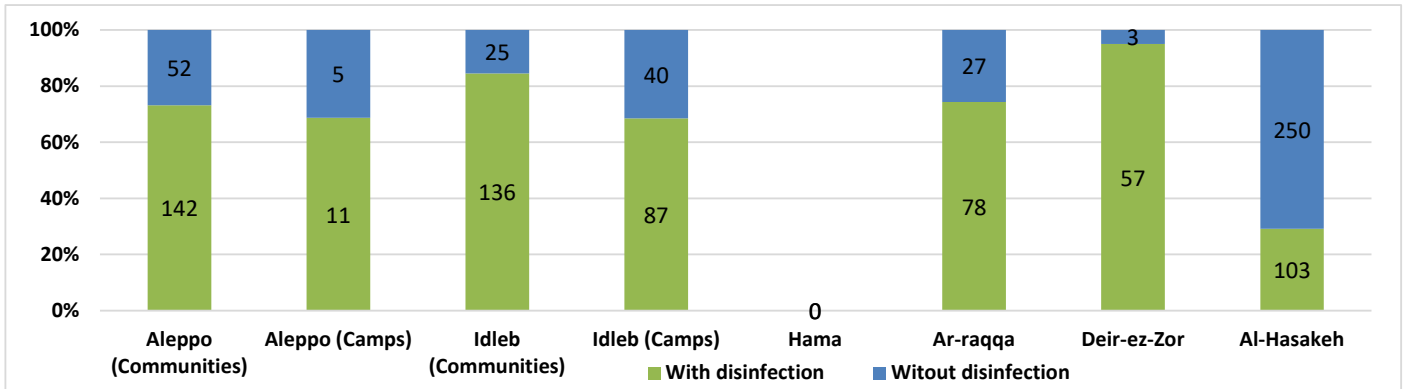

The Reason for not Chlorination

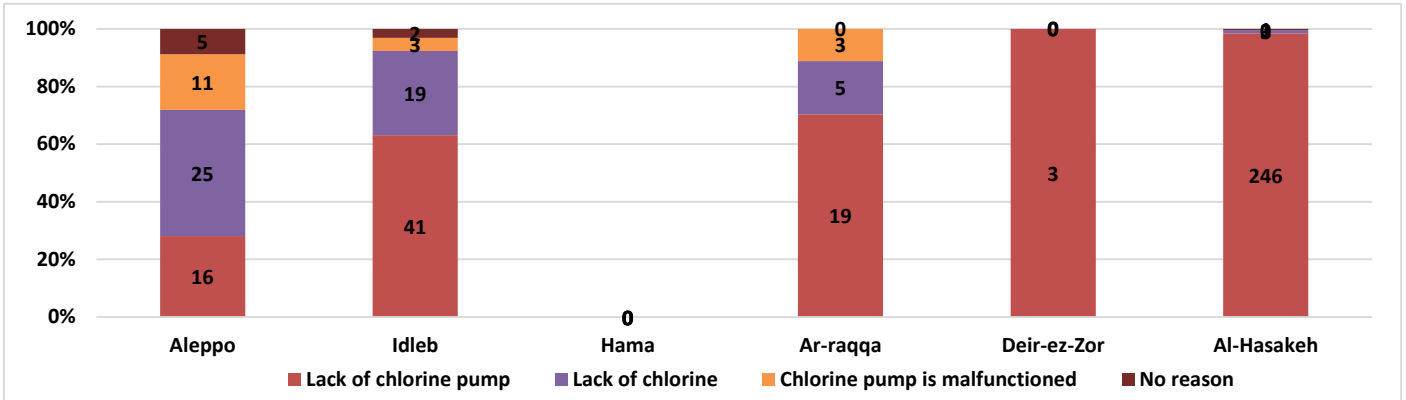


Chlorination Status Over Weeks

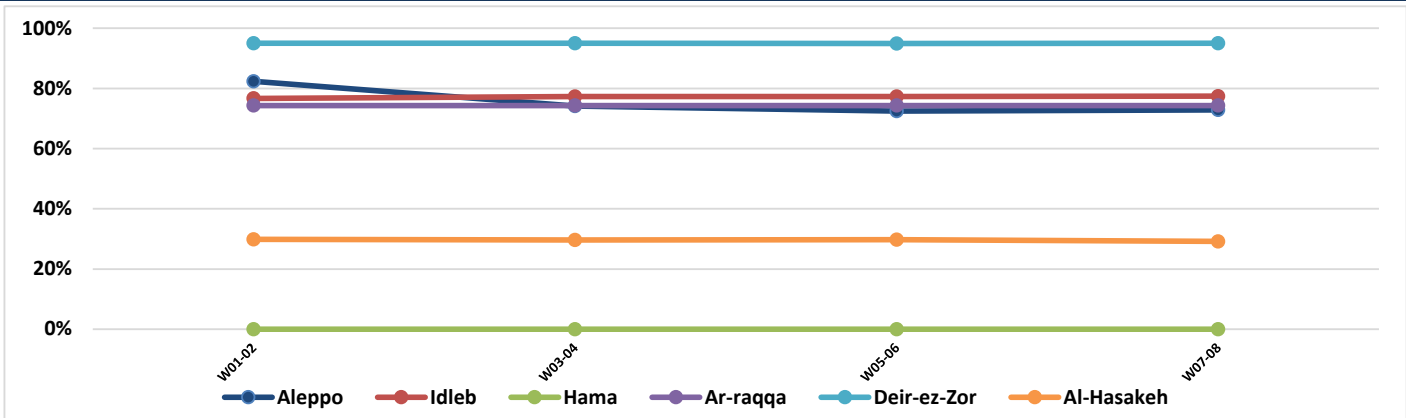


Connection Method


Governorate	Functioning DWS	Method			
		Network	Water Trucking	Both	Manhal
Aleppo	210	179	6	23	2
Idleb	288	190	51	47	0
Hama	0	0	0	0	0
Ar-raqqqa	105	102	2	1	0
Deir-ez-Zor	60	56	4	0	0
Al-Hasakeh	353	351	1	1	0
Total	1016	878	64	72	2

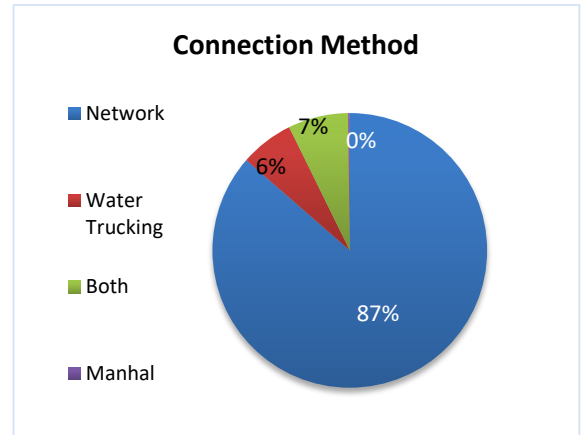


Drinking Water Stations Distribution in Aleppo (Communities Water Stations)

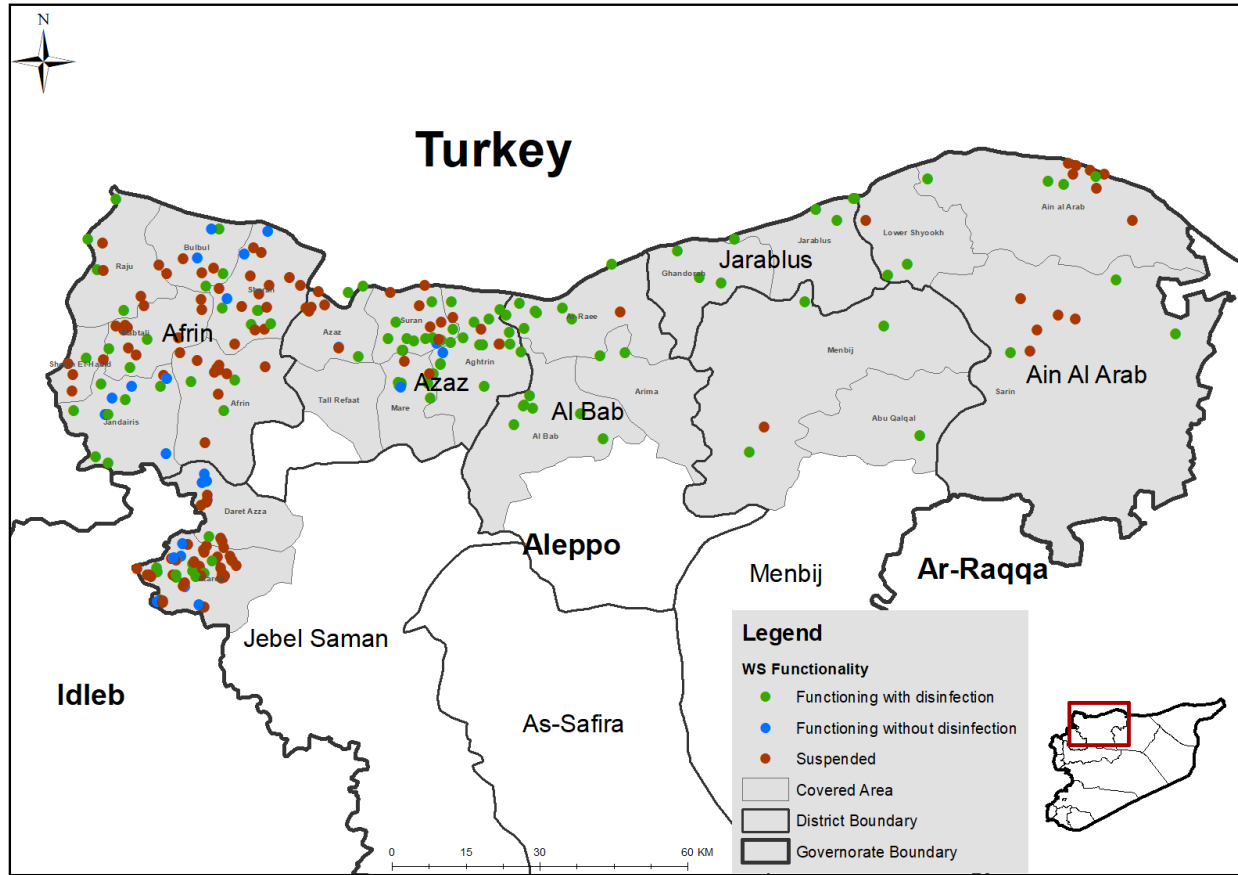


Drinking Water Stations Distribution in Aleppo (Camps Water Stations)

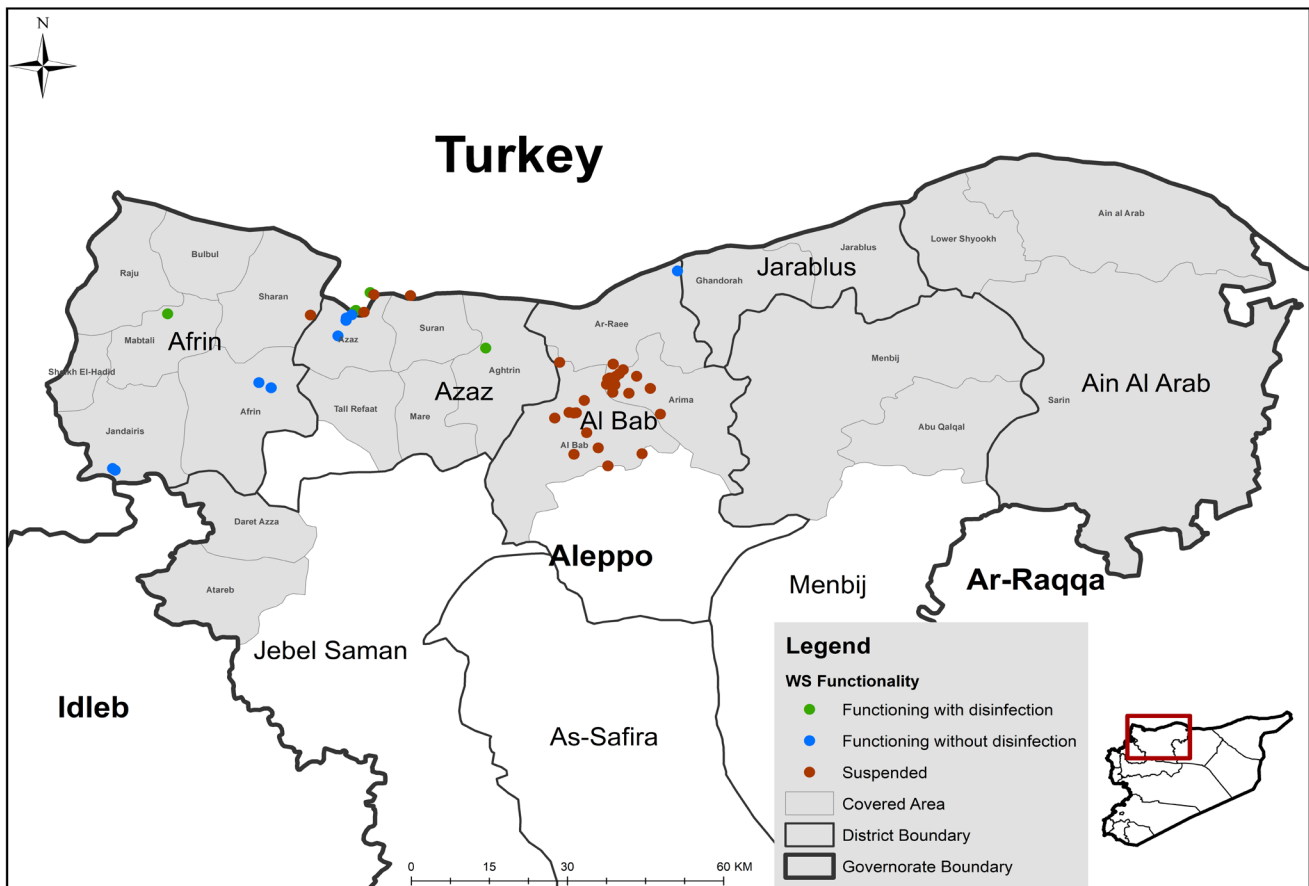


Drinking Water Stations Distribution in Idleb (Communities Water Stations)

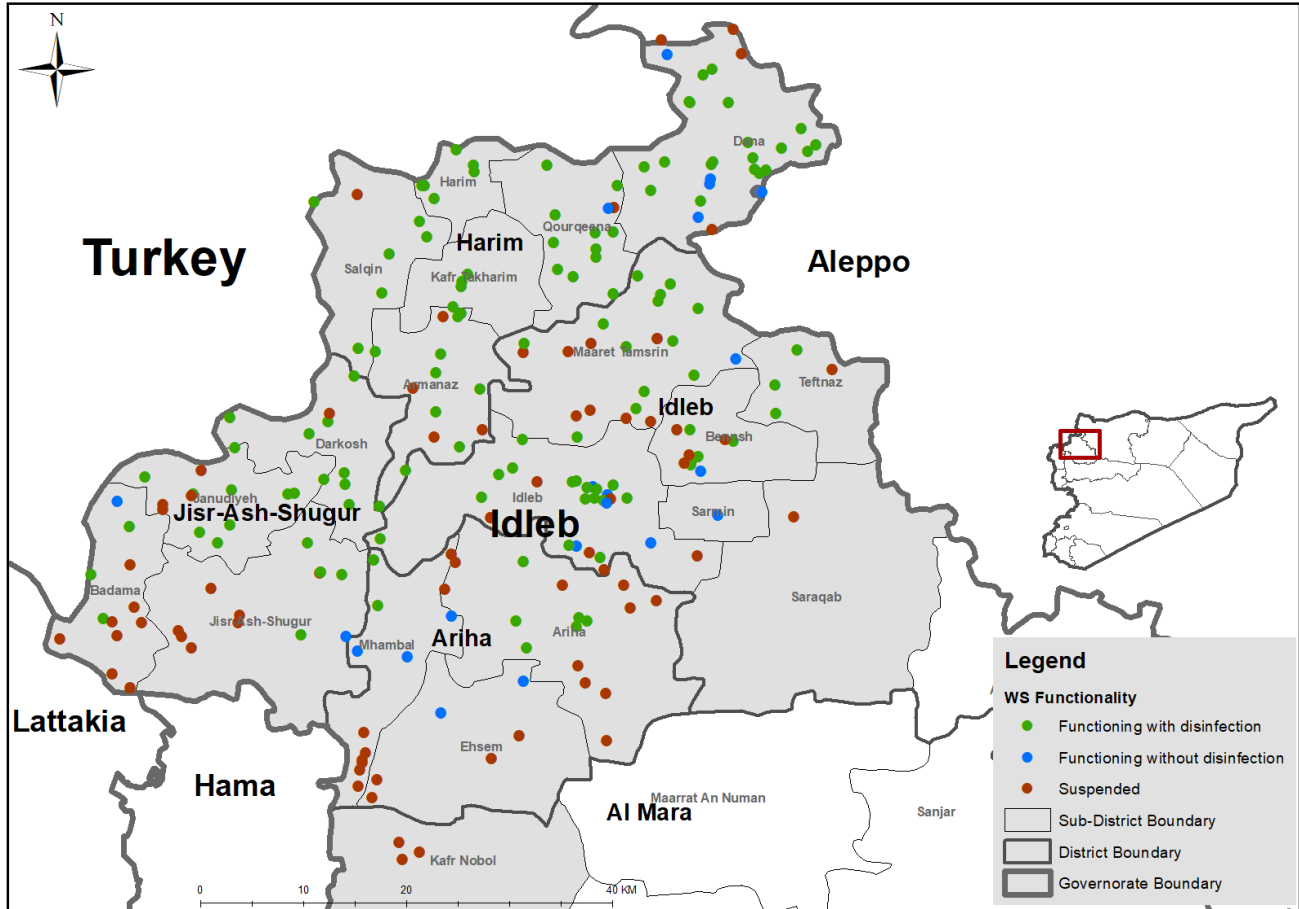


Drinking Water Stations Distribution in Idleb (Camps Water Stations)

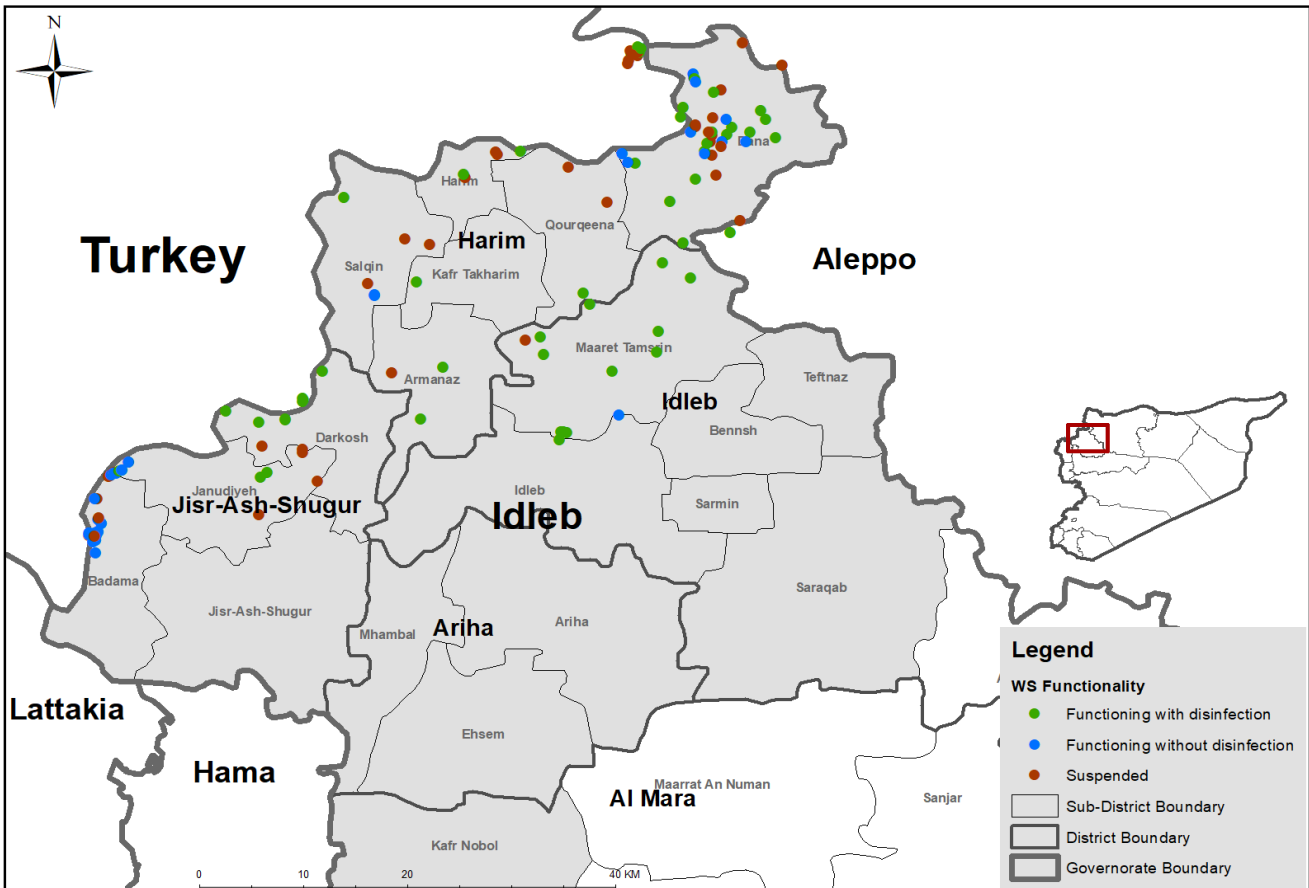


Drinking Water Stations Distribution in Hama

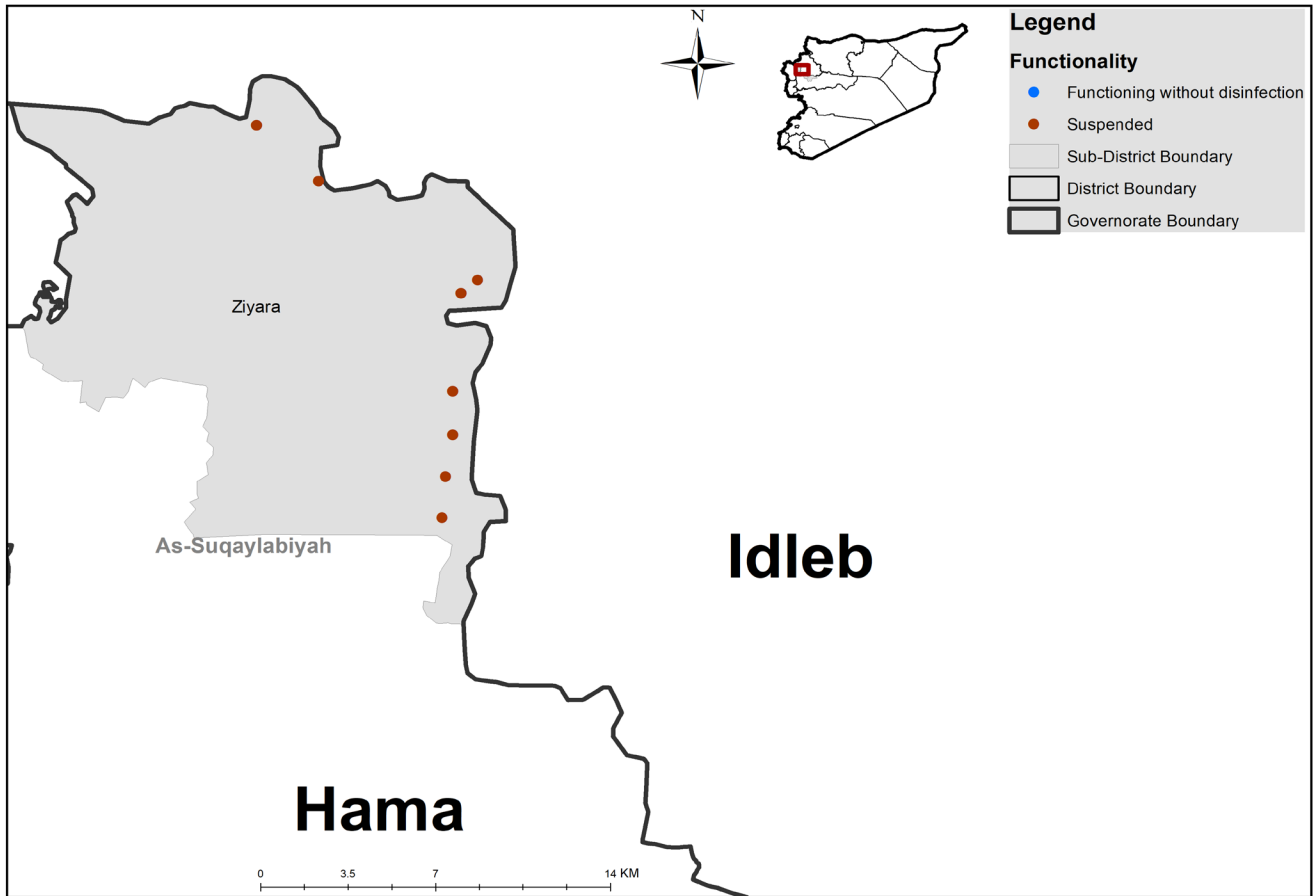

Drinking Water Stations Distribution in Ar-raqqa

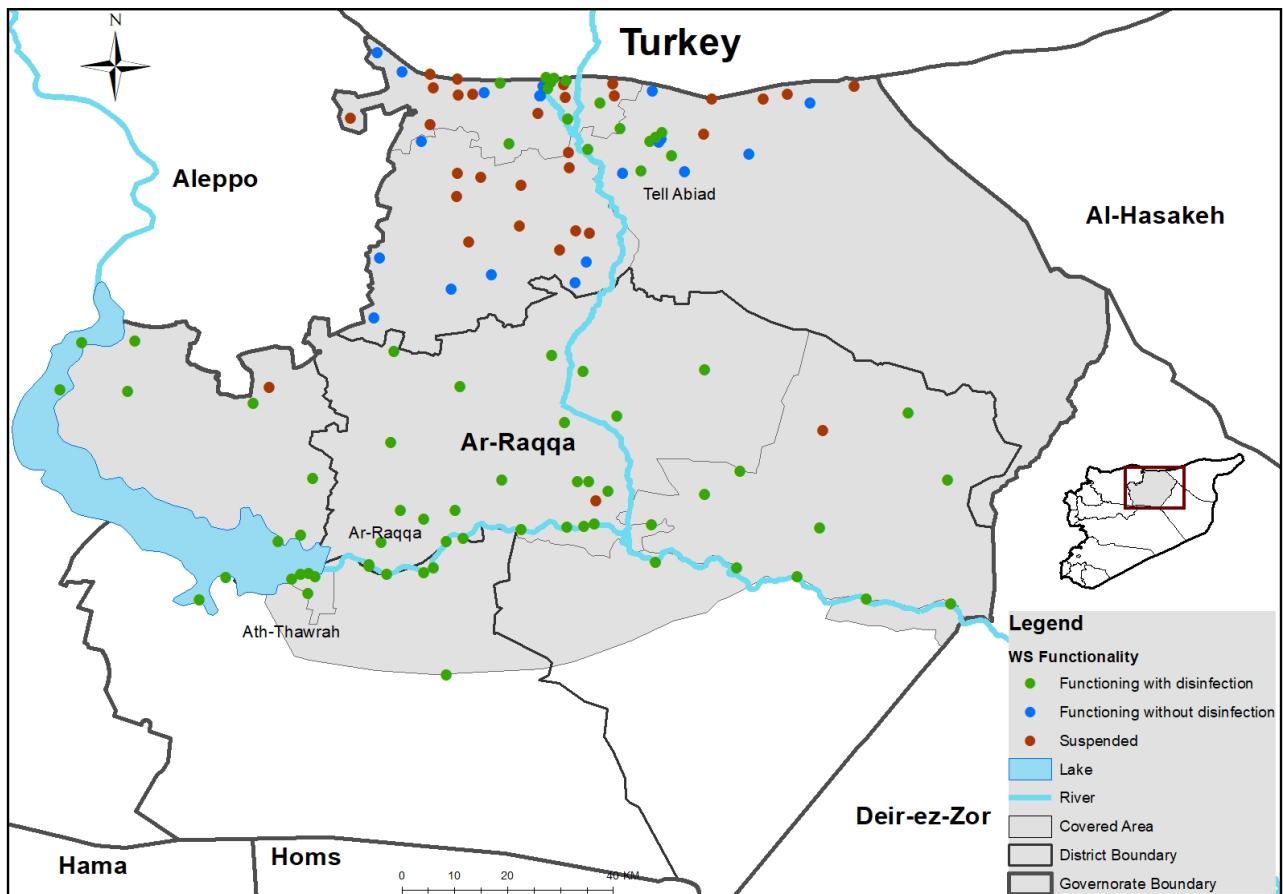

Drinking Water Stations Distribution in Deir-ez-Zor

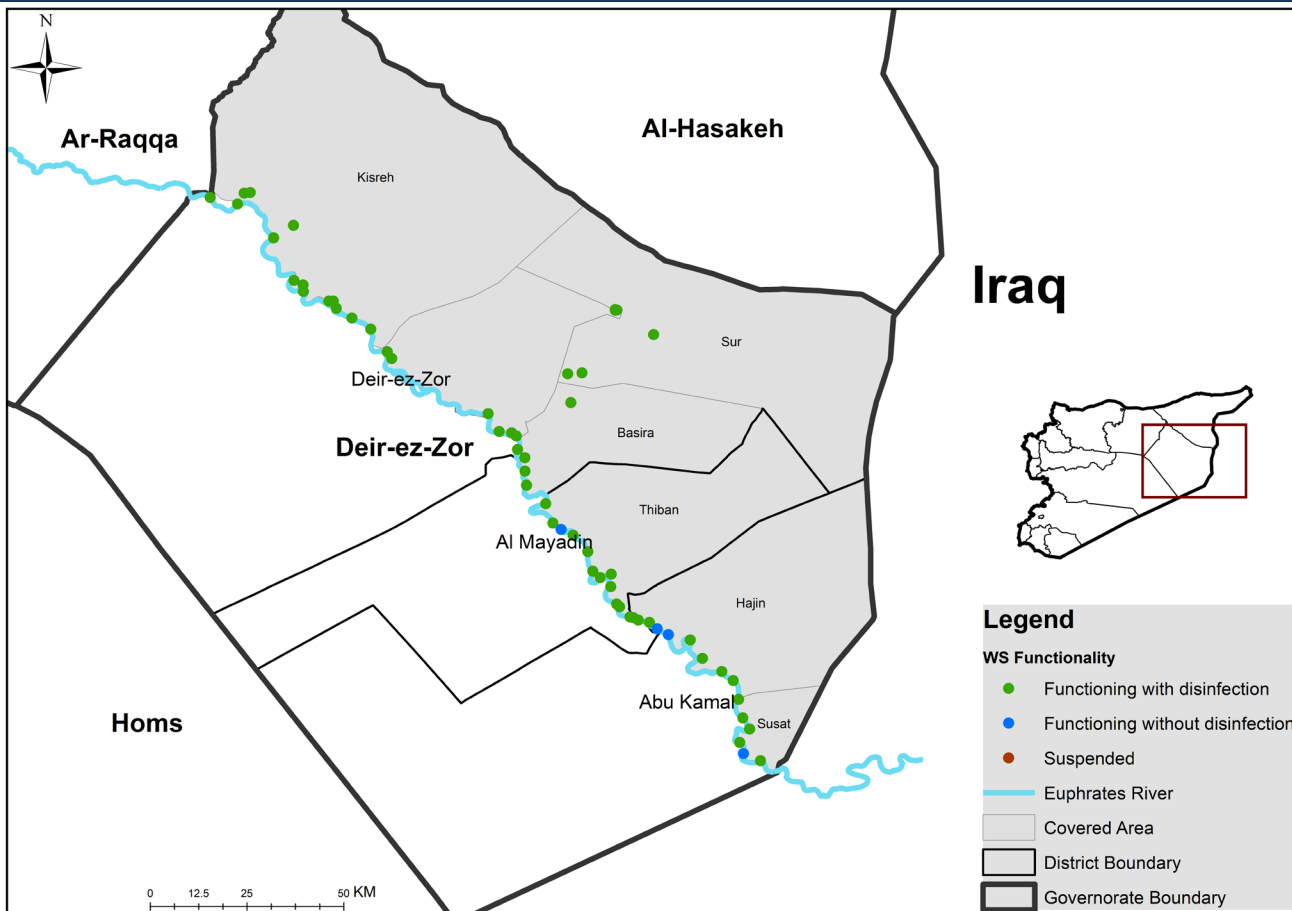

Drinking Water Stations Distribution in Al-Hasakeh

